

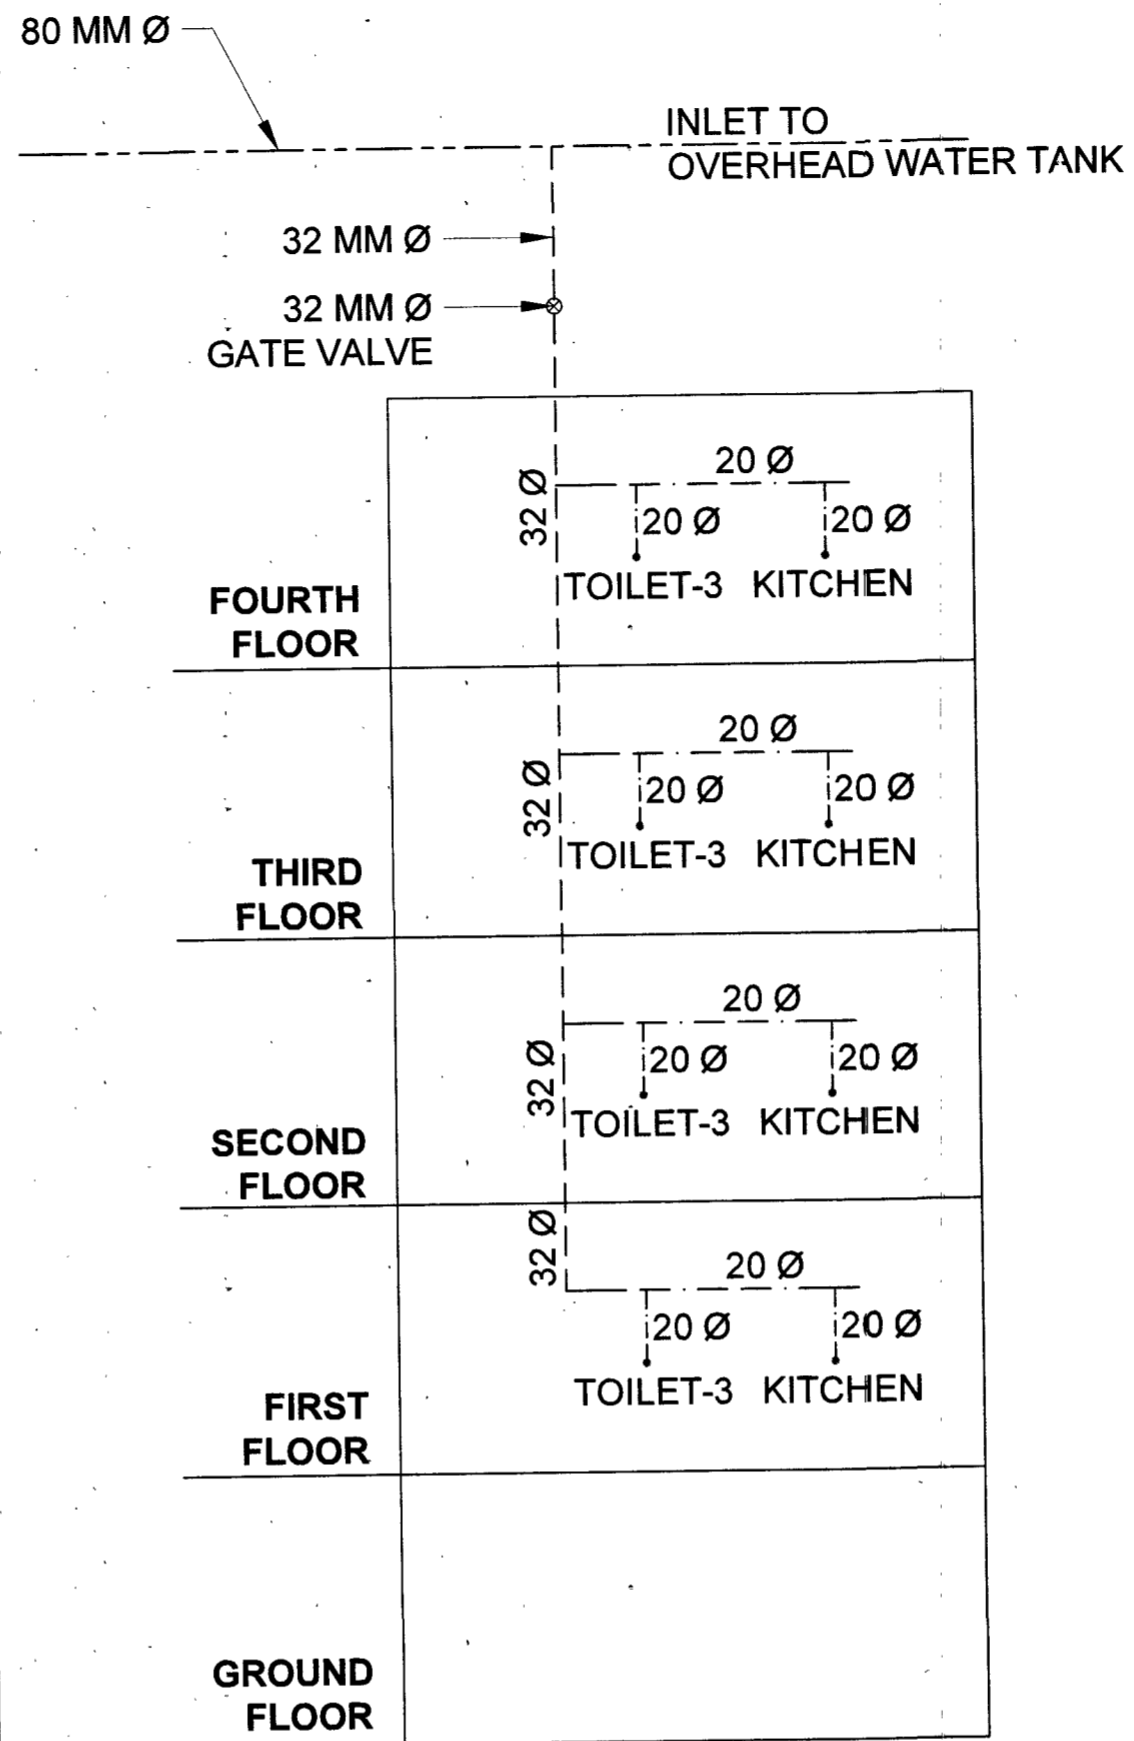


TYPICAL SCHEMATIC DIAGRAM FOR INTERNAL WATER SUPPLY (FOR 1 QTR)

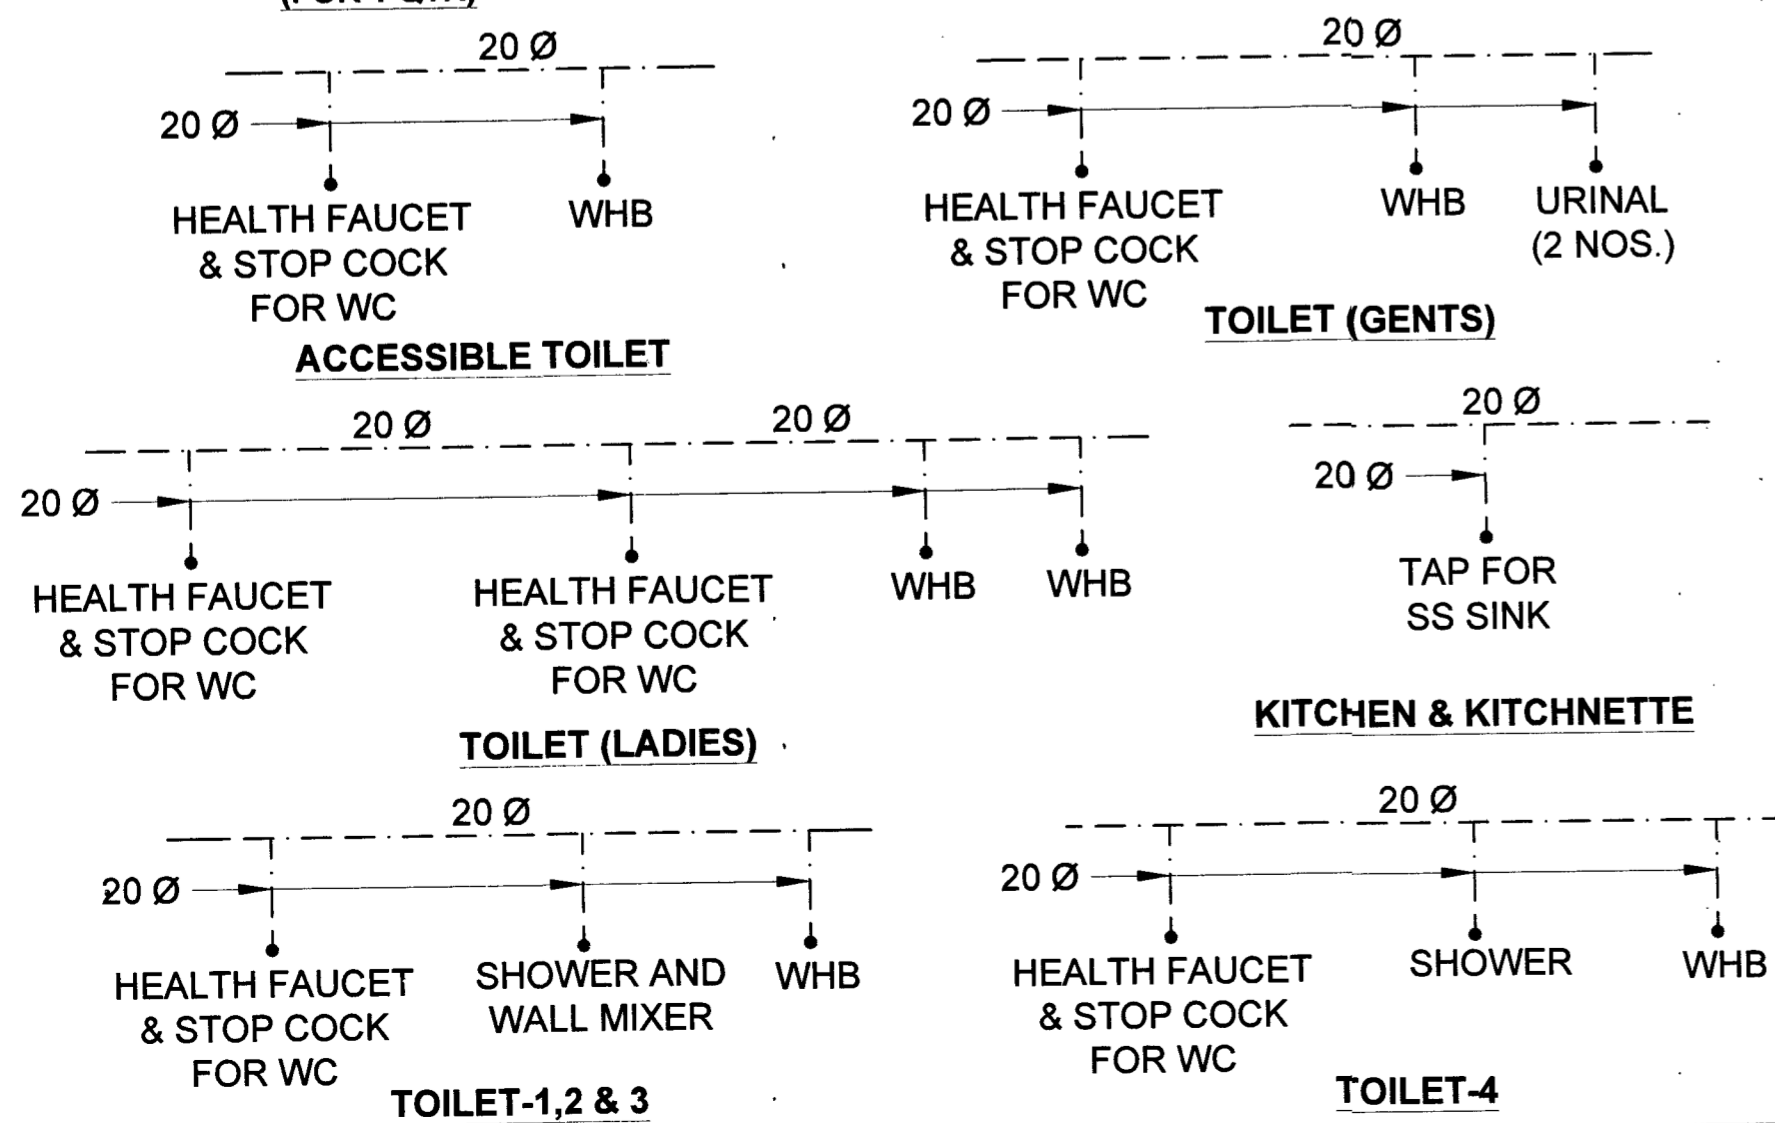

TYPICAL SCHEMATIC DIAGRAM FOR FRESH WATER SUPPLY (FOR 1 QTR)

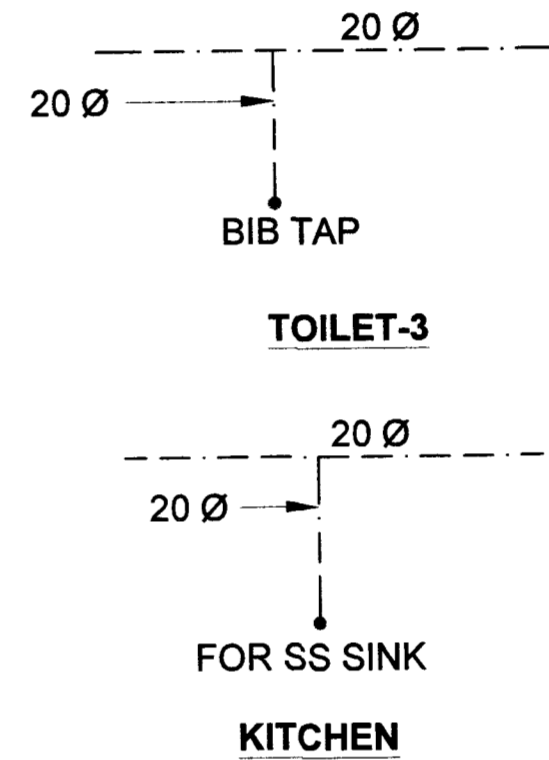

LEGEND		
SR NO.	MKD. AS	DESCRIPTION
1	-----	80 MM DIA G.I. PIPE
2	-----	32 MM OUTER DIA UPVC PIPE
3	-----	20 MM OUTER DIA UPVC PIPE
4	⊗	GATE VALVE
5	WC	WATER CLOSET
6	WHB	WASH HAND BASIN

NOTES:

- CONTRACTOR TO CHECK AND VERIFY ALL DIMENSIONS BEFORE EXECUTION OF THE WORK.
- FIGURED DIMENSIONS SHALL BE FOLLOWED.
- ALL THE GRID LINES ARE PASSING THROUGH CENTER OF 230 THK OR AT ONE FACE OF 115 THK WALLS ON FIRST FLOOR.
- FOR OTHER NOTES REF. LIST OF DRAWINGS AND NOTES DRG NO. CEJZ/LOD/1936/2025 SHT NO 1R/1

THIS DRGS IS BASED ON DRG NO -CEJZ/WD-1936/2025 SH NO 13R/14

SL NO	DATE	DESCRIPTION	INITIAL
		REVISION	

PROVN OF MD ACCN FOR OFFRS, JCOS AND ORS AT FEROZPUR

16 MAJOR MD ACCN (G + 4)

WATER DISTRIBUTION DIAGRAMS

DATE	10/10/2025	CHIEF ENGINEER JALANDHAR ZONE	SHEET NO.
DRAWN			13
CHKD			14
SCALE	AS SHOWN	DRG NO. CEJZ/WD-1938 / 2025	

AAD (ARCH)
 RAD (PLG)
 OFFG DIR E-2 (PLG) FOR CHIEF ENGINEER