



- NOTES:**
1. CONTRACTOR TO CHECK AND VERIFY ALL DIMENSIONS BEFORE EXECUTION OF THE WORK. FIGURED DIMENSIONS SHALL BE FOLLOWED.
 2. ALL THE GRID LINES ARE PASSING THROUGH CENTER OF 230 THK OR AT ONE FACE OF 115 THK WALLS ON FIRST FLOOR.
 3. FOR OTHER NOTES REF. LIST OF DRAWINGS AND NOTES DRG NO: CEJZ/LOD/1936/2025 SHT NO 1R/1

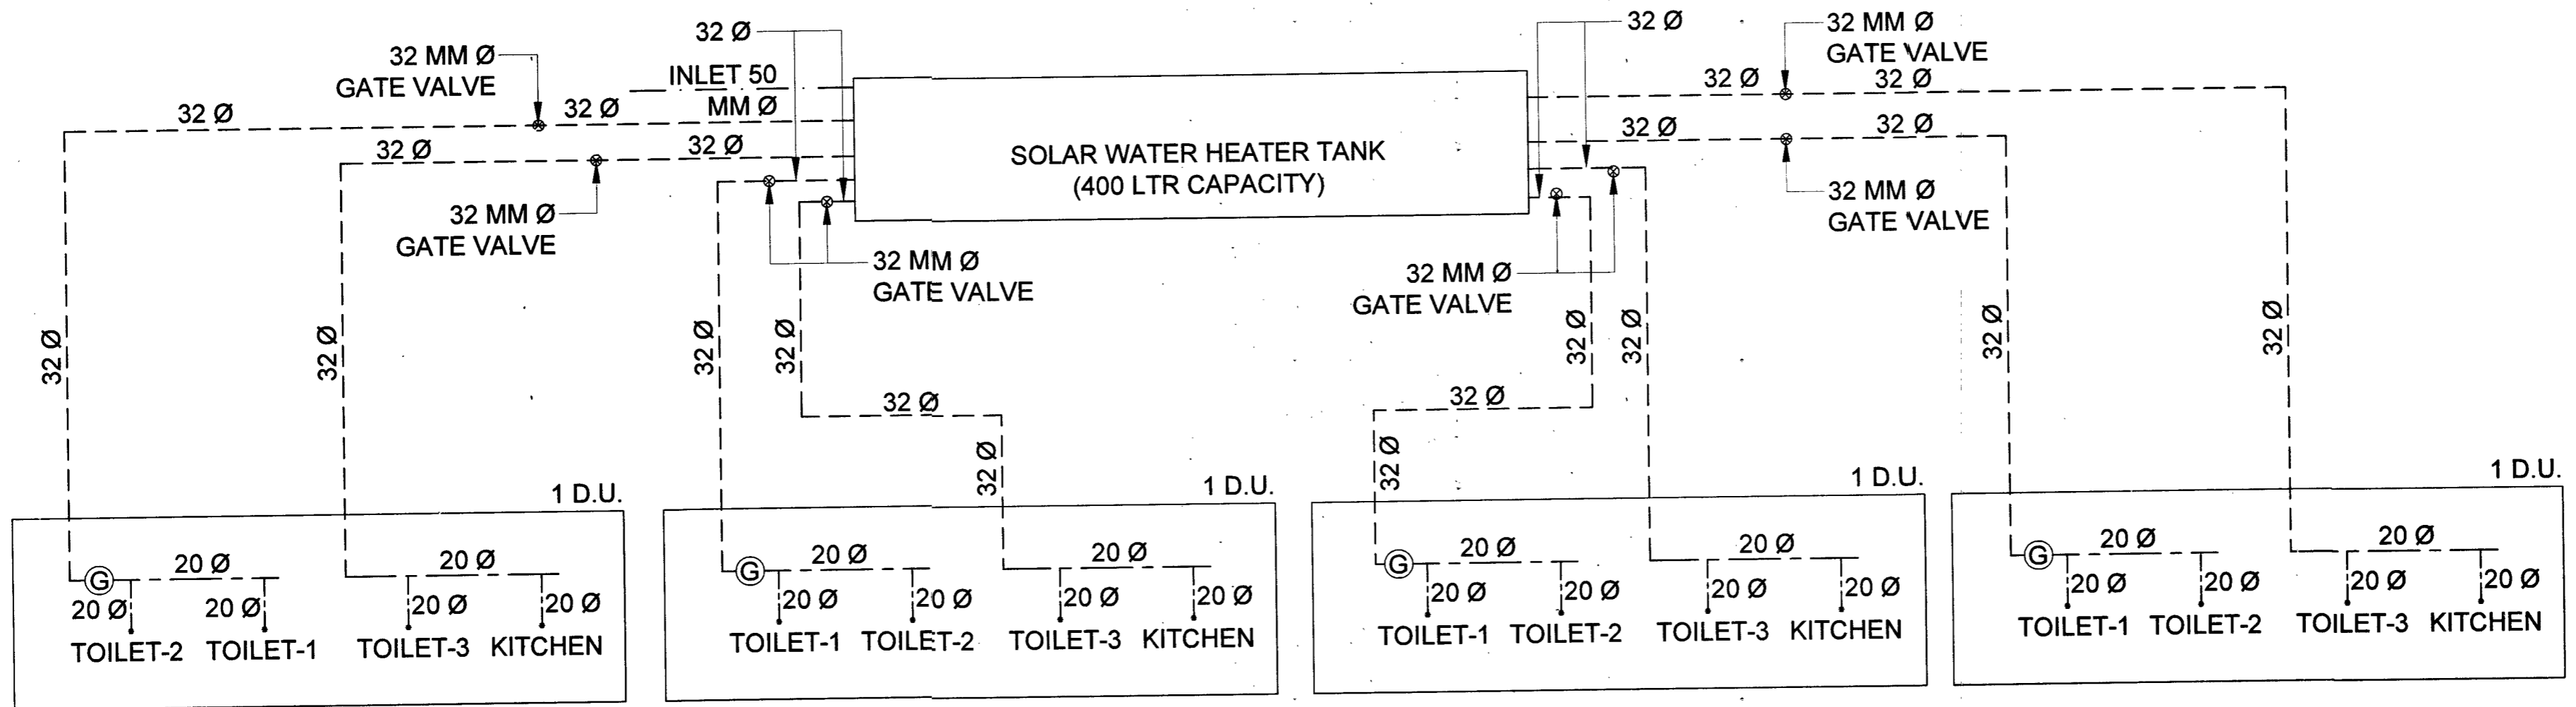

SCHEMATIC DIAGRAM FOR INTERNAL HOT WATER SUPPLY FOR TYPICAL FLOOR (FOR FIRST FLOOR TO FOURTH FLOOR)

LEGEND		
SR NO.	MKD. AS	DESCRIPTION
1	---	50 MM DIA G.I. PIPE
2	----	32 MM OUTER DIA CPVC PIPE
3	-----	20 MM OUTER DIA CPVC PIPE
4	⊗	GATE VALVE
5	⊙	ELECTRIC GEYSER 25 LTR. CAPACITY
6	WHB	WASH HAND BASIN

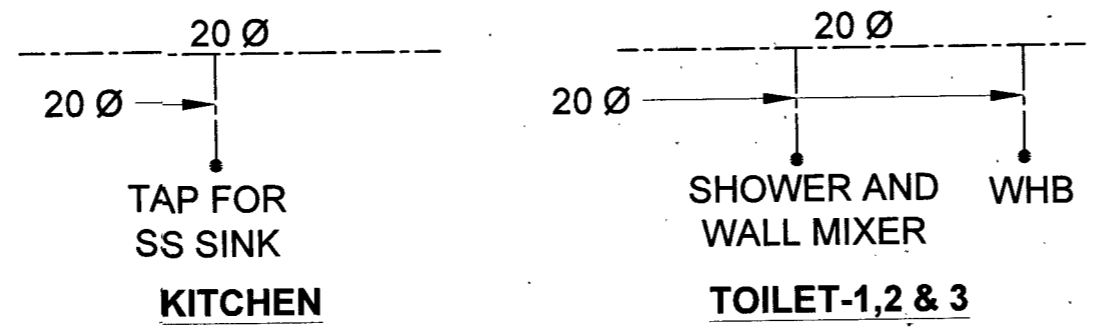

THIS DRGS IS BASED ON DRG NO -CEJZ/WD-1936/2025 SH NO 14R/14

SL NO	DATE	DESCRIPTION	INITIAL
REVISION			
PROVN OF MD ACCN FOR OFFRS, JCOS AND ORS AT FEROPUR			
16 MAJOR MD ACCN (G + 4)			
WATER DISTRIBUTION DIAGRAMS (FRESH WATER)			
DATE	10/10/2025	CHIEF ENGINEER	
DRAWN		JALANDHAR ZONE	
CHKD			14
SCALE	AS SHOWN	DRG NO. CEJZ/WD-1938 /	2025
AAD (ARCH)		OFFC. DIR E-2 (PLG) FOR CHIEF ENGINEER	