

15. MASONRY WORK SHALL BE REPLACED WITH R.C.C. JAMBS IN SITUATION WITH FOUR NUMBERS # 10 BARS AND # 8 TIES @ 200 MM C/C IF THE LENGTH OF MASONRY WALL BETWEEN THE TWO OPENINGS IS LESS THAN 500 MM OR OPENINGS ARE ADJACENT TO CORNER WALLS.

16. THE TOOTHED JOINT SHALL BE MADE IN PERPENDICULAR WALLS ALTERNATIVELY IN LIFTS OF ABOUT 450MM AS PER FIG-8

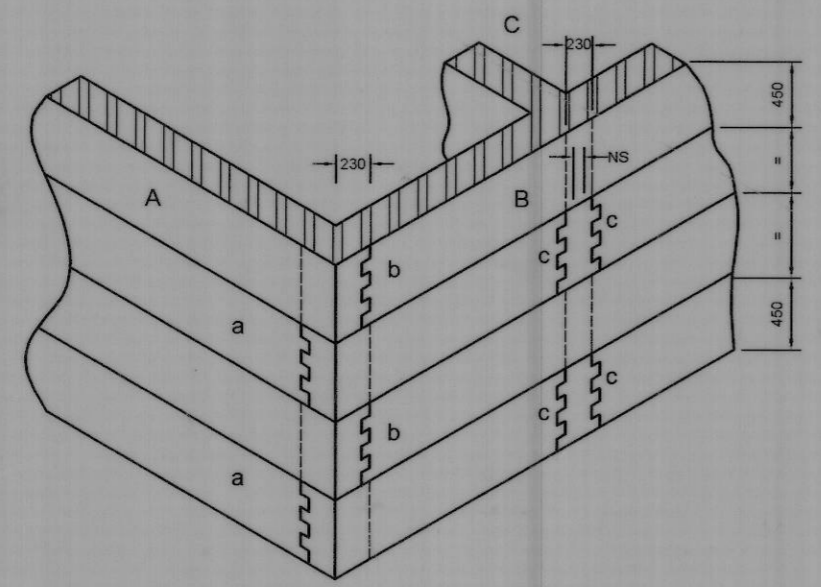




FIG.- 8 a,b,c = TOOTHED JOINTS IN WALL AND A,B,C

SNO.	DATE	DESCRIPTION	TO. INITIAL	SO-I
REVISIONS				
DATE	31-3-06	<b>CHIEF ENGINEER JALANDHAR ZONE</b>  <b>SEISMIC PROVISIONS</b>  <b>SEISMIC STRENGTHENING MEASURES IN MASONRY BUILDINGS</b>		
DRN	RENUKA			
TCD				
CKD				
SCALE	AS SHOWN			
SHT. SIZE	A3			
 (DEVI SINGH) TECH.OFFICER AAD (ARCH)		DRG. NO.	SHEET NO.	
 (YOGESH K SINGHAL) SE DIRECTOR (DESIGN) FOR CHIEF ENGINEER		DRG NO CEJZ / 510-216 /06	5/8	