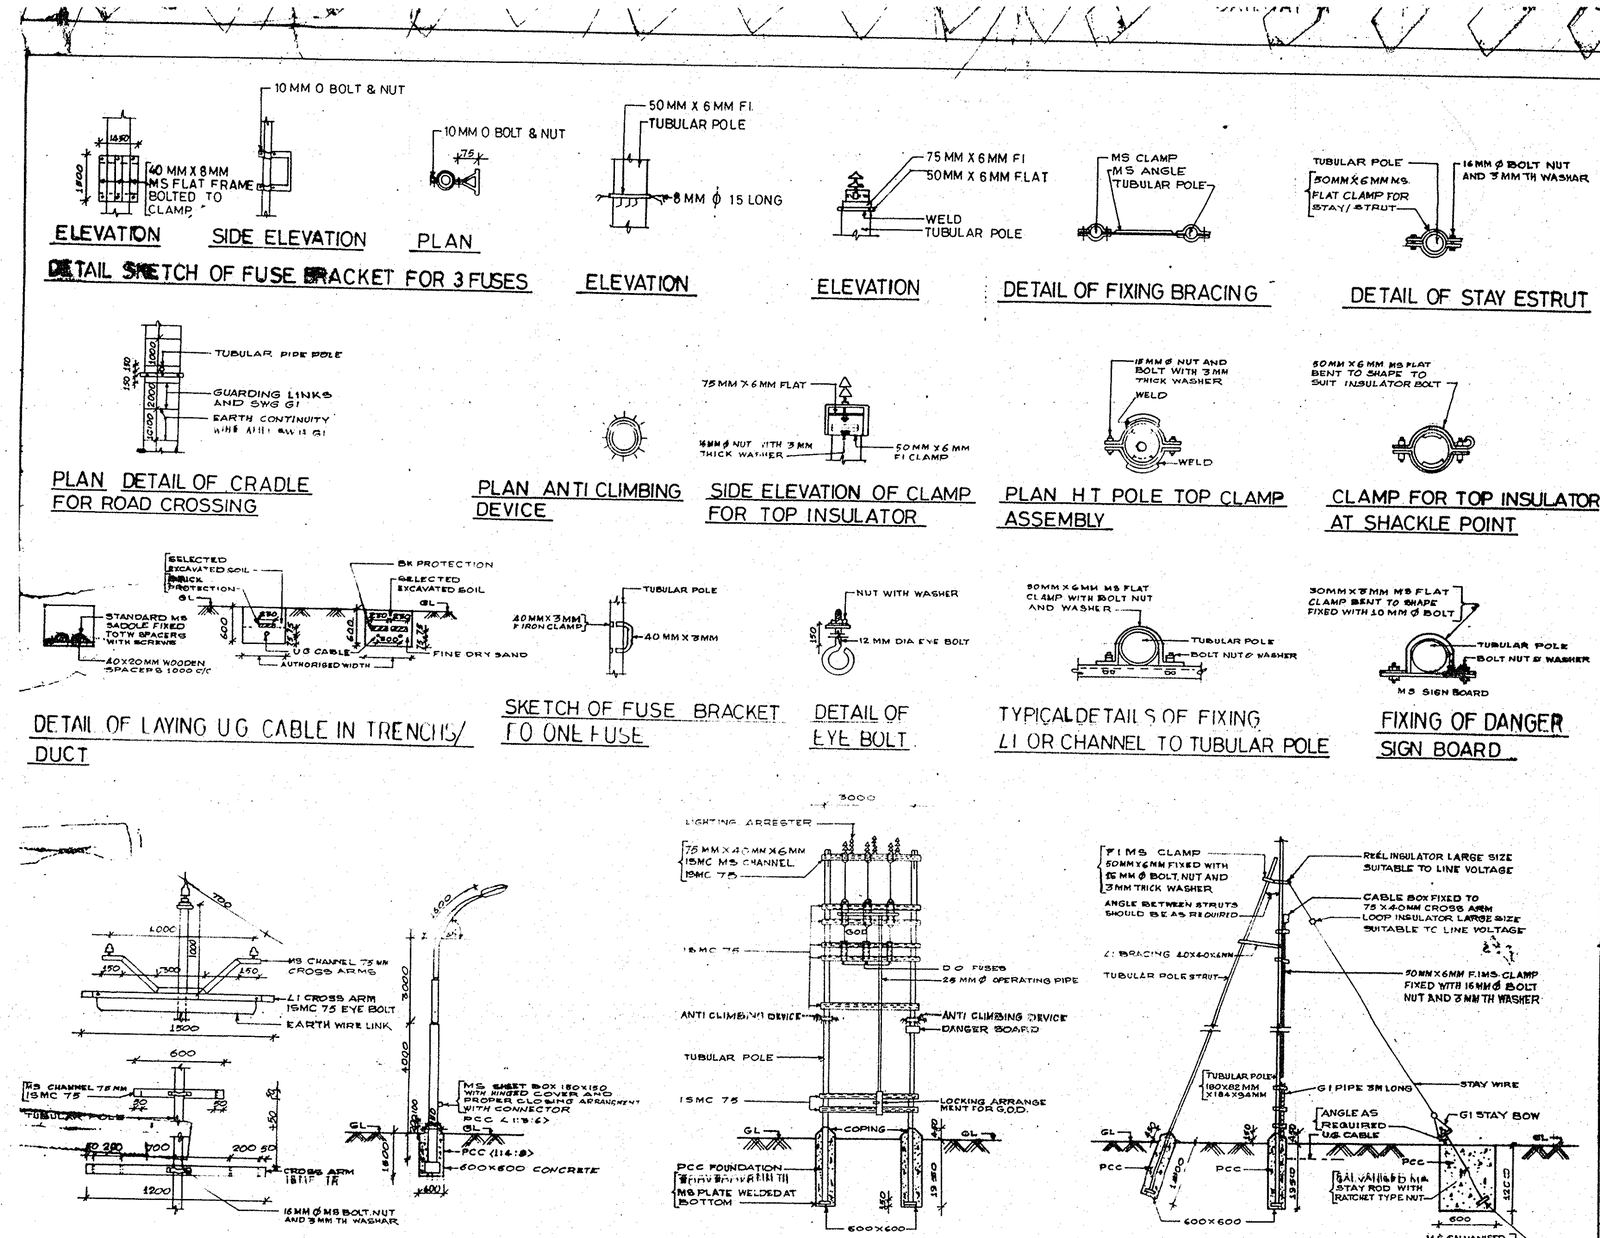

DRG NO CEPZ/98/TD/6 SHT NO 1/2

NOTES

1	CONTRACTOR TO CHECK [redacted] BEFORE EXECUTION OF THE WORK.
2	FIGURED DIMENSIONS SHALL BE FOLLOWED.
3	ALL DIMENSIONS ARE GIVEN IN MILLIMETRES UNLESS OTHERWISE STATED
4	PROVIDE 300 MM TH MURRUM FILLING UNDER THE FOUNDATION OF THE POLES DULY CONSOLIDATED.
5	THE RETURN FILLING AROUND THE FOUNDATION OF THE POLES AND STAY WIRE SHALL BE NONE WITH MURRUM.
6	PROVIDE STAY WIRE WITH ADEQUATE ANCHORAGE FOR EVERY FIFTH POLES AS WELL AS AT CORNER AND JUNCTION POLES.
7	THIS DRAWING SUPERSEEDS DRG NO. CEPZ/91/TD/6 M SHEET 1/2 AND 2/2

DETAILS OF LT HT POLE, STREET LIGHT POLE, TWO POLE STRUCTURE, DETAILS OF STRUTS AND OTHER FIXING DETAILS

DRN NK KAILASH	CHIEF ENGINEER PUNE ZONE PUNE	DATE 21-4-98
TCD "		SCALE AS SHOWN
CKD		
CD MAN		

DY ARCHITECT

SO II E/M

SO I E/M FOR CHIEF ENGINEER

DRG NO CEPZ/98/TD/6 SHT NO

56