



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebmail.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



Tender notice no. : Anj/CMC/R&M/e-Tn-118/2026

NAME OF WORK :

Stub Strengthening of 220KV Nakhatrana Panandhroa D/C line and 220KV Nakhatrana Nanikhakhar D/C line under Nakhatrana AM Division under Anjar AM Circle (Work approved under R&M 2026-27)

TECHNICAL BID

**GUJARAT ENERGY TRANSMISSION CORPORATION LTD**

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebm.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com**Tender notice no. : Anj/CMC/R&M/e-Tn-118 /2026**

Superintending Engineer, AM Circle GETCO **Anjar** invites "On line Tenders" (e-tendering) for the work of **Stub Strengthening of 220KV Nakhatrana Panandhroa D/C line and 220KV Nakhatrana Nanikhakhar D/C line under Nakhatrana AM Division under Anjar AM Circle (Work approved under R&M 2026-27)** from registered contractors in appropriate class with GETCO and who has executed similar nature of work successfully as mentioned in Qualification requirement criteria given in the tender document. Bidders should fulfill all the qualification criteria. Otherwise their bids will not be considered & price bid will not be opened. All the bidders should have valid e-tender vender registration. Tender papers & specifications may be down loaded from web site <https://getco.nprocure.com> (for view, download and online submission) and GUVNL/GETCO websites www.getcogujarat.com (for view & download only).

All tender documents are to be uploaded (Notarized / self attested copies of original - as specified in tender document) through on line only (which is mandatory) on (n) procure portal

The Superintending Engineer (AM)

**Gujarat Energy Transmission Corporation Limited.,
Circle office GETCO - Anjar, Power house, Bhuj Road,
Anjar - 370110 District : Kutch, Gujarat**

Sr. No.	Name of Work	Estimated Cost Rs.	Time Limit	Tender Fee (include 18% GST)(Non refundable) Rs.	EMD amount (As per purchase policy for labour) in Rs.	Appropriate class
1.	Stub Strengthening of 220KV Nakhatrana Panandhroa D/C line and 220KV Nakhatrana Nanikhakhar D/C line under Nakhatrana AM Division under Anjar AM Circle (Work approved under R&M 2026-27)	5612728.36 (Labour cost incl. 18% GST)	03 months	5000.00+ 900.00 =5900.00	Rs. 56128/-	The bidder shall be registered contractor of GETCO of any class

1	On line (E-tendering) tender/ offer submission last date up to 15.00 hours only (This is mandatory)	11.09.2026
2	Date of opening of technical bid- on line opening at 16:00 hrs.	11.09.2026
3	Tentative Date of on - line opening of Price bid	After evaluation of technical bids

Note: 1. The detail drawings are available at the concerned **GETCO, AM Division** for reference on any working day. It is binding upon to Contractor and Presumed that the same is read and gone through. (Even though if it is not attached with Tender Copy).

2. Utilization of CBUD(Call Before you Dig) before excavation/digging:

As per Government guide line before excavation/digging apply in CBUD application to protect the underground assets of various departments. As per guide line before excavation/digging mandatory to use the CBUD application

Tender for Stub Strengthening of 220KV Nakhatrana Panandhroa D/C line and 220KV Nakhatrana Nanikhakhar D/C line under Nakhatrana AM Division under Anjar AM Circle (Work approved under R&M 2026-27) Seal and signature of contractor

**GUJARAT ENERGY TRANSMISSION CORPORATION LTD**

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebmail.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com**IMPORTANT:**

1. All the Appendices, forms, formats, declaration, undertaking, etc (To be submitted on bidder's letterhead), Tender acceptance letter (on bidder's letterhead), price bid, tender documents specified in the tender must be submitted through online on n-procure portal (mandatory) (All the documents to be duly self attested by the bidder). For any differences or wrong entry bidder shall be sole responsible for that documents.
2. Bidder has to upload scanned copies of original documents (Notarized / self attested copies of original – as specified in tender document) online **in PDF form** on n-procure portal and no physical documents to be submitted by the bidder
3. Bidder has to submit Tender fee, EMD Otherwise the offer will not be considered and no any further communication in the matter will be entertained.
4. It shall be sole responsibility of the bidder that the uploaded scanned documents **(in PDF form)** remain legible (readable) and should not be password protected.
5. In case of short submission of documents with bid and / or clarification if any required from the bidder, the required details / documents may be asked from the bidder in physical form.
6. Suitable payment options (from any of below mentioned) can be selected for Tender fees and EMD by the bidder:

a) Payment can be done by RTGS/NEFT.

In case of payment through RTGS/NEFT the scan copy of payment has to be uploaded online with the Tender documents on n-procure portal and the bidder has to mail following details:

Sr. No.	Required Details
1.	Name, Postal Address with Pin code, Contact No. & E-mail address of the bidder
2.	Bidder GST No.
3.	Tender No. with due date
4.	Mode of Transfer
5.	Ref. ID with Bank Details
6.	Amount Paid
7.	Payment against (Tender Fee / EMD)

Mail To: cashttr.anjar@gebmail.com**and cc To:** aotr.anjar@gebmail.com; decmlanj.getco@gebmail.com

NOTE: Bidder has to provide all above details on the same date of payment so that receipt can be generated. GETCO Beneficiary Bank Details are as under:

1.	Name of Account Holder	GETCO
2.	Account No.	90830200001383
3.	Name of Bank	BANK OF BARODA, NAYA ANJAR BRANCH
4.	Branch Code	29
5.	Address of Bank	NAYA ANJAR BRANCH
6.	IFSC Code	BARB0DBNAYA (Fifth digit numerical zero)
7.	PAN No.	AABCG4029R
8.	TAN No.	RKTG00928E
9.	GST No.	24AABCG4029R2ZC

7. **No Tender fee, EMD t shall be accepted in case of receipt after due date and time as specified in the tender document, any reasons and the Corporation shall not assume any responsibility for late receipt of the same.**
8. Tender without EMD and tender fee shall be rejected.



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



9. **Bidders are requested to remain in touch with the n-procure portal for any amendment/corrigendum or extension of due date etc**

10. The GETCO reserves the right to award the work to one or more bidders, considering their technical and financial capacity OR to reject any or all tenders or accept any tender without assigning any reason thereof.

Any technical questions, information and clarification that may be required pertaining to this enquiry should be referred to: **The Superintending Engineer (AM), Gujarat Energy Transmission Corporation Limited., Circle office Anjar**

GETCO reserves the right to reject any OR all tenders without assigning any reasons thereof.

Yours faithfully,

**Superintending Engineer (AM)
Transmission Circle office
GETCO Anjar**

To view the PDF file please use "Acrobat Reader" software which can be downloaded from "Adobe" website.

Note: In case bidder needs any difficulty in accessing / submission of on line bid / clarification or if training required for participating in online tender, they can contact the following office:

(n) Procure Cell, (n) code solutions-A division of GNFC Ltd.,
403, GNFC Info tower, S.G. Road,
Bodakdev Ahmedabad – 380054 (Gujarat)
Toll Free: 1-800-233-1010 (Ext. 501, 512, 516 , 517 , 525) ,
Phone No. 079-26857315 / 316 / 317, Fax: 079-26857321 / 40007533, Email: nprocure@gnvfc.net



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



GUJARAT ENERGY TRANSMISSION CORPORATION LIMITED BARODA

Date :

I N T E G R I T Y P A C T

OUR ENEAVOUR

To create environment where Business Confidence is built through Best Business Practices and is fostered in an atmosphere of trust and respect between providers of goods and services and their users for the ultimate benefit of society a the nation.

GETCO COMMITMENT

- ☐ To maintain the highest ethical standards in business and professional
- ☐ Ensure maximum transparency to the Satisfaction of stakeholders.
- ☐ To ensure to fulfill the terms of agreement / contract and to consider objectively the viewpoint of parties.
- ☐ To ensure regular and timely release of payment on due dates for work done.
- ☐ To ensure that no improper demand is made by employees or by anyone on our behalf.
- ☐ To give maximum possible assistance to all the Vendors / Suppliers / Service provider and other to enable them to complete the contract in time.
- ☐ To provide all information to suppliers/ contractors relating to contract / Job which facilitate him to complete the contract / job successfully in time.
- ☐ To ensure minimum hurdles to Vendors/ suppliers / contractors in complete of agreement / contract / work order.

PARTY'S COMMITMENT

- ☐ Not to bring pressure / recommendations outside GETCO to influence its decision.
- ☐ Not to use intimidation, threat, inducement or Pressure of any kind on GETCO or any of it's employees under any circumstances.
- ☐ To be prompt and reasonable in fulfilling the contract, agreement, legal obligations.
- ☐ To provide goods and / or services timely as per agreed quality and specifications at minimum cost of GETCO.
- ☐ To abide by the general discipline to be maintained in our dealings.
- ☐ To be true and honest in furnishing information including payment to agents / sub-agent.
- ☐ Not to divulge any information, business details available during the course of business relationship to others without the written consent of GETCO.
- ☐ Not to enter into carter / syndicate / understanding whether formal / non-formal so as to influence the price.

Seal & Signature
(GETCO Authorized Signatory)

Name :
Designation :

Seal & Signature
(Party's Authorized Person)

Name :



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



TENDER INDEX

Sr. No.	Particulars	Page No.
1	Tender Notice	
2	Qualification requirement	
3	DETAILS TO BE FURNISHED BY THE TENDERER.	
4	General Conditions	
5	Safety Bond and condition	
6	Terms & Conditions regarding Industrial Laws and Other Related Matters.	
7	Specification for Erection of 66 kV "H" Frame/Tower Line	
8	Price-Bid	

Note: The detail drawings are available at the concerned **GETCO, AM Division office** for reference on any working day. It is binding upon to Contractor and Presumed that the same is read and gone through. (Even though if it is not attached with Tender Copy).



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



TECHNICAL QUALIFICATION REQUIREMENT

The bidder should satisfy following minimum technical requirements....

1. **Registration :**

The bidder shall be strictly a GETCO registered contractor of '**Any Class**'.

Technical Criteria:

Bidder who have carried out **stub strengthening work for tower / H-frame Transmission line of 66 kV and above voltage class during last 3 financial years with minimum 50% amount of estimated tender amount** (on due date of opening of technical bid) shall also be permitted.

Experience of sub-order shall not be considered.

(Copy of W.O including Schedule-B + Work completion certificate duly signed by concern EE(Const)/EE(TR)/competent authority)

The above-cited requirements are only indicative. The owner reserves the right to requisition any other relevant information and also reserves the right to reject the Bid proposal of any Bidder, if in the Owner's opinion the Qualification data is incomplete and Bidder is not qualified to perform the Contract satisfactorily.

2. **Financial Criteria:**

The bidder shall submit the Bank solvency of the amount which is 20% of the total estimated cost of tender.

Financial Qualification requirement:

1. GST Tax Registration No. date / issuing authority. **GST No. must be online active**
2. Details of Partners/Directors of the Firm/Company. Partnership deed if applicable or self affidavit on Rs. 300/- stamp paper in case of Proprietorship.
3. Form G in case of Partnership Firm & Certificate of Incorporation in case of Company
4. Copy of power of attorney as the case may be or signing authority on bidder's letterhead.
5. PF registration. **PF No. must be online active**
6. The Bidder should have to submit copy of PAN card.
7. Financial capability (Self attested Copy of audited balance sheet & profit & loss A/c. & self attested IT returns of Last three Financial years)
8. Payment of Tender fee and EMD.
9. Latest Bank Solvency of the amount which is 20% of the total estimated cost of the tender of schedule bank.
10. Experience Certificate of similar work carried out as per above
11. Registration class approved GETCO: -
12. Electrical contractor license copy.
13. Any other documents required for particular and specific work.

Note: Above technical criteria is for technical scrutiny after opening the technical bid. However the GETCO reserves the right to award the work to one or more bidders, considering their technical and financial capacity OR to reject any or all tenders or accept any tender without assigning any reason thereof.



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



SCOPE OF WORK

1. The Scope of the proposal shall be on the basis of a single Bidder's responsibility, completely covering all the services specified under the accompanying Technical Specifications.
2. The Bidder shall complete all the schedules & annexure in the Bid Proposal Sheets, technical Data Sheets and specified elsewhere.
3. The scope of work is **Stub Strengthening of 220KV Nakhatrana Panandhroa D/C line and 220KV Nakhatrana Nanikhakhar D/C line under Nakhatrana AM Division under Anjar AM Circle (Work approved under R&M 2026-27)** as per standard specification and standard practice of GETCO and as per EIC.
4. The above work shall be done as per GETCO's approved drawing/layout.
5. Necessary field quality plan of GETCO shall be implemented and necessary documentation shall also be maintained as per GETCO's norms and instruction of EIC. If required field quality plan shall be available at field offices.
6. During the work of erection of feeder bay/transformer bay safety check list shall be followed. Necessary check list will be available at our field office.
7. Successful bidder has to appoint site Engineer to maintained site register & FQP as per ISO.
8. All work should be done accordingly to ISO & FQP and all require documents including Filled FQP, testing results etc. should be submitted while handing over the completed work.
9. The quantity mentioned in price bid is tentative and may vary in actual work order.



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebmail.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



SAFETY CLAUSE

- The Contractor shall follow and comply with all GETCO Safety Rules, relevant provisions of applicable laws pertaining to the safety of workmen, employees, plant and equipment as may be prescribed from time to time without any demur, protest or contest or reservations. In case of any discrepancy between statutory requirement and GETCO Safety Rules referred above, the latter shall be binding on the Contractor unless the statutory provisions are more stringent.

- In case if any safety related fatal Elect. / Mech. accident occurred to any employee of agency or outsider due to negligence or non-compliance of GETCO safety norms then in addition to the compensation and liability as per statutory requirement, contractor / agency shall be penalized as under:

Sr. No	Amount of Contract in Rs.	Penalty amount per person
1	Up to → 1 Lac	Rs.5000/- plus APPLICABLE TAXES (IF ANY) as applicable
2	Above 1 Lac to → 10 Lacs	Rs.25000/- plus APPLICABLE TAXES (IF ANY) as applicable
3	10 to → 100 Lacs	Rs.100,000/- plus APPLICABLE TAXES (IF ANY) as applicable
4	> 100 Lacs	1.0 % plus APPLICABLE TAXES (IF ANY) as applicable

2. **Reporting:-**

- The contractor shall inform concerned Ex. Engineer Const/TR in writing within 24 hours of fatal/Non-fatal accident occurred to human being.
- The GETCO investigating officer findings in to accident shall be final and binding to the contractor /Agency.

3. **Safety Requirement:**

- Kick off Meeting exclusively for safety shall be done in each contract in presence of contractor's site in charge and supervisor. Safety document shall be handed over and vital safety norms and key points of safety related to project shall be explained and recorded for commitment by erection contractor. Such records are mandatory for clearing first erection bill.
- During site visit by GETCO official of Executive Engineer and above rank, the following checks during execution of work shall be covered.
 - Safety equipment available and utilize.
 - Helmet.
 - Safety belt.
 - Safety shoes.
 - Live line Voltage detector
 - Safety procedure adopted.
 - Permit to work
 - Earthing at the place of work.
 - Adequate supervision.
 - T & P physical Check. (Healthiness and Quality)
 - P.P.rope.
 - Wire rope and sling.
 - Earthing rod



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebm.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



IV. If above-mentioned safety requirements found violated in any of the above three conditions shall attract penalty of Rs.1000/- plus **APPLICABLE TAXES (IF ANY)** as applicable per occasion. (Max.Rs.3000/-for violation of three conditions)

V. During subsequent visit, if violation is found, then double penalty plus **APPLICABLE TAXES (IF ANY)** as applicable shall be deducted from the bill of the Contractor/Agency.

4. The contractor will have to give indemnity bond & safety cum indemnity on stamp paper of Rs. 300/- to GETCO against any possible claim of compensation for damage to contractor's equipment or staff or any of third parties during the execution of work.

WORK & SAFETY REGULATIONS

1. The contractor shall ensure proper safety of all the workmen, materials, equipment & plant & belonging to him or to GETCO or to others, working at the site. The contractor shall also be responsible for provision of all safety notices and safety equipment required both by the relevant legislations and Engineer, as he may deem necessary.
2. Contractor has to provide ISI marked ELCB / MCB having sufficient capacity of standard make at point of supply.
3. All equipment used in construction and erection by contractor shall meet Indian/International Standards and where such standards do not exist, the contractor shall ensure these to be absolutely safe. All equipment shall be strictly operated and maintained by the contractor in accordance with manufacturer's operation manual and safety instructions and as per guidelines/ rules of GETCO in this regard.
4. Periodical examinations and all tests for all lifting/ hoisting equipment & tackles shall be carried - out in accordance with the relevant provisions of Factories Act 1948, Indian Electricity Act 1910 and associated Laws/Rules in force from time to time. A register of such examinations and tests shall be properly maintained by the contractor and will be promptly produces as and when desired by Engineer or by the person authorized.
5. The contractor shall provide suitable safety equipment of prescribed standard to all employees and workmen according to the need.
6. The contractor shall provide safe working conditions to all workmen and employees at the site including safe means of access, railings, stairs, ladders, scaffoldings etc. the scaffoldings shall be erected under the control and supervision of an experienced and competent person. The contractor only shall use good and standard quality of material.
7. The contractor shall not interfere or disturb electric fuses, wiring and other electrical equipment belonging to the owner / other contractors under any circumstances, whatsoever, unless expressly permitted in writing to handle such fuses, wiring or electrical equipment.
8. Before the contractor connects any electrical appliances to any plug or socket belonging to the other contractor or owner, he shall:
 - a. Satisfy the Engineer that the appliance is in good working condition;
 - b. Inform the Engineer of the max. current rating & voltage of the appliances;
 - c. Obtain permission of the Engineer detailing the sockets to which the appliances may be connected.
9. The Engineer will not grant permission to connect until he is satisfied that;
 - a. The appliance is in good condition and is fitted with suitable plug
 - b. The appliance is fitted with a suitable cable having two earth conductors, ones of which shall be an earthed metal sheath surrounding the cores.
10. No electric cable in use by the contractor/ Owner will be disturbed without prior permission. No weight of any description will be imposed on any cable and no ladder or similar equipment will rest against or attached to it.
11. No repair work shall be carried out on any live equipment. The equipment must be declared safe by the Engineer and a permit to work shall be issued by the Engineer before any repair work is carried out by the contractor. While working on electric lines/ equipment, whether live or dead, suitable type and



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebmail.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



sufficiently quantity of tools will have to be provided by the contractor to electricians/ workmen/ officers.

12. In case any accident occurs during the construction/ erection or other associated activities undertaken by the contractor thereby causing any minor or major fatal injury to his employees due to any reason, whatsoever, it shall be the responsibility of the contractor provide medical facility / treatment & to promptly inform the same to the Engineer in prescribed form and to also to all the authorities envisaged under the applicable laws.
13. The Engineer shall have the right at his sole discretion to stop the work, if in his opinion the work is being carried out in such a way that it may cause accidents and endanger the safety of the persons and/or property and/or equipment. In such cases, the contractor shall be informed in writing about the nature of hazards and possible injury/ accident and he shall comply to remove shortcomings promptly. The contractor after stopping the specific work can, if felt necessary, appeal against the order of stoppage of work to the Engineer within 3 days of such stoppage of work and decision of the Engineer in this respect shall be conclusive and binding on the contractor.
14. The contractor shall not be entitled for any damages/ compensation for stoppage of work due to safety reasons and the period of such stoppage of work will not be taken as an extension of time for completion of work and will not be the ground for waiver of levy of liquidated damages.
15. it is mandatory for the contractor to observe during the execution of the works, requirements of safety rules which would generally include but not limited to following:
 - a. Each employee shall be provided with initial indoctrination regarding safety by the contractor, so as to enable him to conduct his work in a safe manner.
 - b. No employee shall be given a new assignment of work unfamiliar to him without proper introduction as to the hazards incident thereto, both himself & his fellow employees.
 - c. Employee must not leave naked fires unattended, smoking shall not be permitted around fire prone areas and adequate firefighting equipment shall be provided at crucial location.
 - d. There shall be a suitable arrangement at every work site for rendering prompt and sufficient first aid to the injured.
 - e. Requirements of ventilation in underwater working to licensed and experienced divers, use of gumboots for working in slushy or in inundated conditions are essential requirements to be fulfilled.
16. The contractor shall follow and comply with all GETCO safety Rules, relevant provisions of applicable laws pertaining to the safety of workmen, employees, plant and equipment as may be prescribed from time to time without any demur, protest or contest or reservations. In case of any discrepancy between statutory requirement and GETCO safety rules referred above the latter shall be binding on the contractor unless the statutory provisions are more stringent.

a. Fatal injury or accident	Rs. 1,00,000/- per	These are applicable
Causing death	person plus APPLICABLE TAXES (IF ANY)	as applicable for death
b. Major injuries or accident causing	Rs. 20,000/-	injury to any
25% or more permanent disablement	per person	person,
To workmen or employees	plus APPLICABLE TAXES (IF ANY)	as applicable

Permanent disablement shall have same meaning as indicated in workmen's compensation Act. The compensation mentioned above shall be in addition to the compensation payable to the workmen/ employees under the relevant provisions of the laws as applicable from time to time. In case the owner is made to pay such compensation then the contractor is liable to reimburse the owner such amount in addition to the compensation indicated above.



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



ANNEXURE-A

OUR ENDEVOUR - Safety a habit

To create environment where Business Confidence is built through Best Business Practices and is fostered in an atmosphere of trust and respect between providers of goods and services and their users for the ultimate benefit of society a the nation, safety guidelines are agreed upon by the agency as under.

Safety is our prime concern and zero accident is our goal. In order to prevent the accident, while execution of works in indoor and outdoor systems of GETCO, the following guideline and preventive measures are identified.

Indoor safety precaution	Outdoor safety precaution
The method of work required T&P and Man powershould be discussed between GETCO supervisor, contractor's supervisor and gang leaders.	The method of work required T&P and Man powershould be discussed between GETCO supervisor, contractor's supervisor and gang leaders.
Prior to execution of work a joint survey Must be conducted by GETCO supervisor and contractor's supervisor for risk assessment. - Clearly identify the work location, to distinguish between the equipment that is dead and other equipment/part that may be live. - Disconnect equipment from supply. - Protect against other live parts. - Take special precautions when close to bare conductors/ Busbar.	Prior to execution of work a joint survey mustbeconductedbyGETCOsupervisor,contractor'ssupervisorandDISCOMlinemaninordertoidentifythefollowing: - HT/LT line or tap line crossing under Each span of line of the work. - Isolation point of each line crossing. - Each line crossing & isolation point under each span must be discussed and noted in maintenance register with sketch.
Following safety guidelines are mandatory For all contractors operating in GETCO premises for Electrical, non-electrical & civil works. - The contractors must provide advance planning of work to concerned in-charge of substation in writing. - Before startingany work whether switchyard, "permit to allow to work" must be taken from control room in-charge. - Utilizing Electrical / non-electrical equipments, safety rules must be implemented. - If the work is to be carried out on Sunday or public holiday, the necessary permission must be taken in advance, requesting in writing. - Unwanted person including children of labourswill not be allowed at working site/ in the switchyard and in the prohibited area. - Any electrical work or electrical connections to equipment for any other work must be carried out by certified	Contractor's supervisor and GETCO Supervisor must ensure all isolations physically with adequate earthingtechnically prior to give clearance to gang leader for taking up job. While execution of stringing work, the identified line crossing must be isolated /de-energized and written clearance should be obtained from concerned DISCOM supervisor. The isolation of Tap line must be physically seen and verified by Contractor and GETCO supervisor. At D.O. fuse junction contractors person should be posted to ensure that no person restore D.O. supply while work is under execution Contractor's supervisor must ensure that concern officer take LCP for EHV line and power line crossing.



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



electrician/wiremen with adequate size of wire through MCB as per I.E. Rule. - Live penal area / bus bar must be isolated and sealed / bifurcated with red colour tape for visible warning. - Display Board must hang on LCP panel. - Transformer must be switched off whenever and wherever contractor and line workers are not satisfied with isolation, earthing or any equipment performance of GETCO, it will be pointed out and work shall begin only after resolution. Contractor shall not take up job in absence of GETCO authorized person. All wire temporary connection & material whenever erection activity has any connection and disconnection work of bus bar, string bus.	
All workers / labour of contractor & supervisors must use personal protective equipment (PPE) during the work like gloves, safety belt, Safety shoes, Helmet, earthing rods, etc, duly approved by GETCO.	All workers / labour of contractor & supervisors must use personal protective equipment (PPE) during the work like gloves, safety belt, Safety shoes, Helmet, earthing rods, Live line detector etc, duly approved by GETCO.
The localearthing must be done at the place of work before execution of any work.	The local earthing must be done at the place of work before execution of any work.
11kV breaker in panel must be switched off and racked out only after ensuring no voltage in breaker and without door opening.	Circuit breaker opening is not an isolation and isolator on either side must be opened. No work during rains and cloudy weather condition.
	Transmission line activities. 1) Used of Voltage detector to ensure outage. 2) Earthing at three point, local, left & right side of bus bar / string bus. 3) Match line colour code with colour of wristband.
	Local earthing of electrical equipments like filter M/c, welding machine, testing kits etc. is must. Crane shall only be used for material handling and erection. Working platform shall only be used for work in switchyard.



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel VidyutBhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



GENERAL COMMERCIAL CONDITIONS

The Gujarat Energy Transmission Corporation Ltd., Anjar hereinafter called 'GETCO'/ 'OWNER' intends to receive bids for **Stub Strengthening of 220KV Nakhatrana Panandhroa D/C line and 220KV Nakhatrana Nanikhakhar D/C line under Nakhatrana AM Division under Anjar AM Circle (Work approved under R&M 2026-27)** detailed in the accompanying specifications in accordance with Terms and Conditions herein. The bids shall be prepared and furnished as per these instructions.

1. The validity of tender is **180 days** from the date of opening of technical bid
2. **Earnest Money Deposit :**
 - A. Bidders are requested to pay an earnest money deposit (EMD for labour 1% of estimated amount) by RTGS / NEFT only for the amount as specified in the tender notice.
 - B. The EMD shall be submitted along with submission of Technical bid only.
 - C. Tenders not accompanied by EMD shall be rejected.
 - D. If during the tender validity period, i.e. 180 days, the tenderer withdraws his tender, the EMD shall be forfeited and the tenderer may be disqualified from tendering for future works of GETCO.
 - E. The EMD will be returned promptly to the unsuccessful tenderer. The EMD will be returned to the successful tenderer after he furnishes the Security Deposit for performance and duly enters into the contract. If he fails to furnish the SD or to execute the contract for the work offered to him, his EMD shall be forfeited and the tenderer may be disqualified from tendering for further works for GETCO.
3. All commercial terms and conditions except rates shall be indicated in the technical & commercial bid only.
4. The tenderers shall specifically note that the Tenders are invited on percentage basis only.
5. The tenderers will ensure submission of the Tenders duly filled in before the due date and time.

1. Security deposit: -

The contractor will have to pay the Security Deposit at 5% of the order value by demand draft / in the name of 'GUJARAT ENERGY TRANSMISSION CORPORATION LTD/ PAYABLE AT ANJAR, A/c. name of bidder' upon placement of the LOI within 15 days. Alternatively you may pay the entire S.D. in the form of B.G. in case S.D value is more than Rs. one lakh as per approved format of the GETCO issued by only Nationalized/Scheduled Bank as per List attached herewith. The security deposit will be refunded only after the completion of guarantee period of 1 year of work done or finalization of final bill whichever is later.

(A) Guarantees issued by following Banks will be accepted as SD on payment basis.

1. All National Banks.

(B) Guarantees issued by following Banks will be accepted as SD for the period up to **March 31, 2027.**

The validity cut-off date in GR is with respect to date of issue of Bank Guarantee irrespective of date of termination of Bank Guarantee.

1. AXIS Bank
2. AU Small Finance Bank
3. Bandhan Bank
4. City Union Bank
5. CSB Bank
6. DBS Bank India Limited



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebmail.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



7. DCB Bank
8. Dhanlaxmi Bank
9. Equitas Small Finance Bank
10. FEDERAL Bank
11. HDFC Bank
12. HSBC Bank
13. ICICI Bank
14. IDBI Bank
15. IDFC Bank
16. IndusInd Bank
17. Jammu and Kashmir Bank
18. Jana Small Finance Bank
19. Karnataka Bank
20. Karur Vysya Bank
21. Kotak Mahindra Bank
22. RBL Bank
23. South Indian Bank
24. Standard Chartered Bank
25. Tamilnadu Mercantile Bank
26. Ujjivan Small Finance Bank
27. YES Bank
28. Ahmedabad Mercantile Co-op. Bank
29. Nutan Nagarik Sahakari Bank Ltd.
30. Rajkot Nagarik Sahakari Bank Ltd.
31. Saraswat Co-operative Bank Ltd.
32. SBPP Co-operative Bank Ltd.
33. SVC Co-operative Bank LTD.
34. The Cosmo Co-op Bank Ltd.
35. The Gujarat State Co-operative Bank
36. The Surat District Co-operative Bank
37. The Surat People's Co-op. Bank Ltd.
38. The Baroda Central Co-operative Bank
39. The Panchmahal District Co-operative Bank
40. The Kalupur Commercial Co-op. Bank
41. The Rajkot Commercial Co-operative Bank
42. The Banaskantha Mercantile Co-op. Bank
43. Gujarat Gramin Bank
- 44.

Bank Guarantee of other than above mentioned banks towards EMD, Performance Bank Guarantee for Supply, Erection & Warranty will not be acceptable

No interest will be allowed on amount of Security deposit.

The Security Deposit- total shall be kept deposited up to completion of GUARANTEE / WARRANTY PERIOD OR finalization of final bill whichever is later

The same shall be return on receipt of N.O.C. by the concerned nodal division for billing & payment.

This security deposit is for the performance of contract and the same is liable to be forfeited by the in event of non-fulfillment of the term and conditions of this contract by the contractor.



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



6. **Contract Period** :- The time allowed for completion the work is **03(Three) Months** from the date of the commencement of the work, failing which the **penalty ½% per week or part thereof plus applicable taxes (if any) on** delayed portion of work and / or supply value subject to ceiling of 10% of the total contract value will be imposed.
7. The time limit for the work may be reduced and contractor should make all his efforts to complete the work within stipulated time limit as may be given by the Engineer in charge depending upon emergency of work, GETCO reserves the right to reduce the time limit without giving any notice.
8. **TAXES AND DUTIES**
1. GOODS AND SERVICE TAX (GST): GST and cess as applicable shall be payable/ receivable as mentioned in clause no.33 of GCC supra
 2. The prices quoted shall be all inclusive of freight, transportation, loading, —unloading stacking at site of materials supplied by Contractor as well as owner supplied item if any.
 3. No extra payment toward any type of templates and erection tools /materials will be made.
 4. **Statutory Variations:**
Any statutory increase or decrease in the taxes and duties including GST and Cess as applicable or in the event of introduction of new tax/cess or cessation of existing tax/cess subsequent to suppliers offer if it takes place within the original contractual delivery date will be to COMPANY's account subject to the claim being supported by documentary evidence. However, if any decrease takes place after the contractual delivery date, the advantage will have to be passed on to COMPANY.

Statutory Variation clause will not be applicable in case of Supplier / Contractor has opted for Composition Scheme under GST.

Goods and Service Tax (GST):

1. The F.O.R. Destination prices are excluding GST at the rate of 9% CGST plus 9% SGST or 18% IGST, under the GST Law or as applicable to Works Contract Services from time to time which will be paid extra on a given taxable goods and/or services within the original contractual delivery period. The amount and % of GST and Cess should clearly be indicated separately. GST/Cess means all applicable Tax/Cess under GST Laws. (GST Laws means IGST Act, GST(Compensation to the State for Loss of Revenue) Act, CGST Act, UTGST Act and SGST Act, 2017 and all related ancillary legislations).
2. You shall have to submit a C.A Certificate & duly authorized Signatory of successful bidder, certifying that you have not claimed Refund of any applicable GST and Cess, charged to COMPANY or shall not claim any such Refund, on a future date, from the concerned Authorities and if, any Refund, in respect of such GST and Cess, is claimed by you, it will be immediately passed on to the COMPANY, without COMPANY making any specific Claim, for the same, either from the Department or from you.
3. The offers having price INCLUSIVE OF GST is likely to be rejected if the rate of GST is not mentioned clearly.
4. Contractor should charge GST in Invoice at the rate as agreed to / mentioned in acceptance of tender only and any deviation in the same shall not be accepted. Further, any additional liability of GST (later on due to wrong mentioning of GST rate, mis-interpretation of HSN/SAC Code, etc.) over and above as charged in the invoice shall be borne by the Contractor. However, any refund received by the contractor on account of GST charged from the company; such refund



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebmail.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



- shall have to be passed on to the company, along with interest if any. Such refund along with interest needs to be passed on suo-moto by the supplier / contractor.
- 5 Further, the Company has a right to recover the amount of GST along with penal interest at the rate of 15% per annum or any other amount charged by GST Dept. whichever is higher if GST charged is not paid / short paid to the government or fail to upload the details or uploads inaccurate particulars on GSTIN portal by the Contractor within the stipulated time limit.
 - 6 In case, Govt. revises the rate of GST rate / Code during the tenure of the contract, the provision of GETCO's statutory variation clause shall apply.
 - 7 INPUT TAX CREDIT BENEFIT In the event of any statutory increase in the rate of Input Tax Credit and / or due to inclusion of any other additional item of their inputs / input services under the ambit of the Input Tax Credit provisions under the GST Act, subsequent to the date of submission of the offer, the same should be passed on to COMPANY and you should inform such changes to COMPANY from time to time.
 - 8 GST, other taxes and other levies and duties including custom duty solely in respect of the transaction between the owner and the contractor under this contract, if any, shall be included in the bid price. These shall also be indicated separately wherever applicable as mentioned in the Tender.
 - 9 As regards the income Tax, surcharge on income tax and any other corporate tax, including GST if any the owner shall not bear any tax liability whatsoever. The bidder shall be liable and responsible for payment of such taxes as attracted under the provisions of the law.
 - 10 Notwithstanding the tax liabilities as per the sub-clause 35.9 above, the owner shall have the right to make deduction at source from the amounts payable to the contractor in respect of Income Tax (on the cost of items of supply included in the works contract) as may be mandatory in terms of the law. The owner shall not bear any liability in this regard but shall issue necessary certificate in respect of such deduction made.
 - 11 Whenever concessional rate of GST is indicated by the bidders; it shall be confirmed whether any increase in the rates that becomes applicable during the performance of the contract would be absorbed by the supplier. Bidder shall note that in case of absence of such confirmation; the tenders will be evaluated taking into account the maximum rate of GST applicable.
 - 12 In case any tax or duty is newly introduced by the Government applicable for this contract with effect from the next day of the date submission of the bid and if the contractor is required to pay additional tax or duty, then the owner shall reimburse the contractor the additional tax or duty so paid by the contractor against submission by the contractor of documentary evidence to the satisfaction of the owner. This provision will not be applicable to transaction between the contractor and his sub-suppliers, sub-contractors for raw materials etc and will be applicable only to the direct transactions between the contractors and owner. Besides the said statutory variation, no other statutory variation shall be payable by the owner.
 - 13 The owner's liability for all taxes and duties including GST under the contract shall be limited to those indicated by the Bidder in the Bid Proposal Sheets, subject to the statutory variations and variations as per Clause No. 35.4.
 - 14 If the cost to the Contractor during the performance of the 'Contract' shall be increased or reduced by reasons of the making, passing or promulgation of any law after the date of submission of bid or by any order, regulation or bye-law having the force of law, the amount of such increase or reduction shall be added to or deducted from the "Contract Price" as the case may be for direct transactions between contractor & owner. It is the Bidders responsibility to furnish details of taxes, duties, levies etc. applicable as on the date of submission of the bid.



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



- 15 No claim for any increase towards the statutory variation regarding enhancement of existing tax or duty or introduction of a new tax or duty applicable shall be entertained by the Owner during the extended period of contract, if any, provided the extension of the contract is required by causes attributable to the contractor. However, the decrease in any taxes/duties shall be passed on to GETCO.
- 16 The provision of statutory variation regarding enhancement of existing tax or duty or introduction of a new tax or duty will be applicable only to the direct transaction between the contractor and the owner.
- 17 Before quoting, the bidder may ascertain from the concerned tax authorities of Government for the applicability of Entry Tax, GST etc. in respect of this work and include the same in the quoted price. No separate claim in this regard will be entertained by the Owner, as it is the responsibility of the Bidder to pay all these taxes.

18 Final bill shall be passed & paid only if contractor has duly discharged its GST liability related to the contract and submit C.A. certificate and under taking.

Income Tax

Income-tax at source at the prevailing rate will be deducted from bills in accordance with the provision of Income-Tax Laws and to that effect a certificate will be issued to you.

Welfare cess:

As per the Welfare Cess Act, the welfare cess @ 1% is applicable on supply, erection items for supply, erection, testing & commissioning of substation, transmission lines, EPC/Turnkey projects and civil works.

- Contractor shall get registered under Welfare Cess Act before commencement of work. Office of the Factory Inspector is authorized at present as a registering authority.
- The welfare cess@1% is considered in the price schedules so, the bidders are requested to quote accordingly.
- GETCO shall pay the welfare cess by way of reimbursing to contractors on production of documentary evidence of payment.
- The contracts for which supply or part supply of material are in the scope of GETCO, then contractors shall deposit welfare cess on estimated cost of supplied items to GETCO on progressive basis of utilization. As this part of welfare cess is on GETCO account, the same shall be reimbursed to the contractor on receipt of request letter along with documentary evidence of payment. For calculation of welfare cess on supply part, valuation as per MR shall be taken and informed to the contractor for payment. This will be over and above the A/T value.

The modality of payment/ reimbursement of welfare cess will be as under.

- On receipt of A/T, the contractor/ bidder will get them registered under Welfare Cess Act and submit the documentary evidence to the concern office.
- Before release of payment of first R.A.Bill, the contractor has to submit the documentary evidence of registration. Only thereafter, the bill will be processed for payment.
- Before release of payment of subsequent R.A.Bills, the contractor has to submit the documentary evidence of payment of welfare cess of previous R.A.Bill.
- Before release of payment of Final Bill, the contractor has to submit the documentary evidence of payment of welfare cess of previous R.A.Bill as well as of this final bill.



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



- If the R.A. Bill happens to be first and final bill, then before release of payment, contractor has to submit documentary evidence of registration under Welfare Cess Act and evidence of payment of welfare cess.
 - The welfare cess shall be reimbursed to the contractor on submission of copy of documentary evidence of payment by observing due formalities.
10. The contractor will have to give indemnity bond on Non-judicial Stamp paper of value Rs. 300/- to GETCO for material as per attached format. The cost of stamp paper will be born by the contractor.
 11. Also the successful bidder will have to execute Agreement on stamp paper of value Rs.300/- at our Circle office Anjar before commencement of works as per GETCO's prescribed Performa. The cost of stamp paper will be born by the contractor.
 12. The contractor will have to give safety cum indemnity on Non-judicial Stamp paper of value Rs. 300/- to GETCO against any possible claim of compensation for damage to contractor's staff or any of third party during the execution of work. The cost of stamp paper will be born by the contractor.
 13. Also the successful bidder will have to execute Agreement on stamp paper of value Rs.300/- at our Transmission Circle, Anjar GETCO, before commencement of works as per GETCO's prescribed Performa. The cost of stamp paper will be borne by the contractor.
 14. **Guarantee:** - It is the responsibility of the contractor to handover the complete work free of all defects. If within a period of **One (1) year** from the date of handing over the work it is noticed that any defects occurs due to bad workmanship, it is the duty of the contractor to rectify / replace the same at his own cost. If within seven days from the date of receipt of such notice, the contractor does not take up the work, same will be carried out at his risk and cost.
 18. 10% retention money will be deducted from each R.A. Bills against material issued to contractor.
 19. 10% amount of bill will be retained from each RA bill for the work executed after the scheduled date of completion and on finalization of time limit extension by competent authority; this amount will be released after deducting amount towards the time limit penalty if any.
 20. As regard damage the materials, equipment and worker of the contractor, he himself will be responsible. If there is any compensation to be paid in respect of "WORKMAN" compensation act of any other statutory provisions, the same will have to be paid by the contractor direct. If he thinks fit he may take necessary insurance cover, at his cost.
 21. The quantum of the work as mentioned in estimate/ schedule -'B' is tentative and it can be varied or differed as per site condition. The payment shall be made only on actual work executed or order quantity, whichever is less.
 22. The tenderer will be abided by and fulfill all the terms and provisions of the "Tender & Contract" for works as applicable and incase of any default there to the GETCO shall forfeit the S.D. or any other action as may be decided by Superintending Engineer (TR), GETCO, Anjar.
 23. The cost of damages, if any will be recovered from the Contractor's bill. The assessment of which will be done by field Engineer at his sole discretion and his decision shall be binding to the contractor and shall be considered as final and unchallengeable.
 24. GETCO shall deduct the Income-Tax and other taxes as per prevailing rules from each and every bill.
 25. No part rate or reduced rate shall be allowed in final bill.
 26. The contractor has to follow all labour laws, safety rules and regulations. The GETCO does not take any responsibility in case of accident or injury to the workers. The safety/ security of men, materials and equipments shall be sole responsibility of the contractor.
 27. The compliances of all Central/ State Govt. rules, safety and insurance rules etc. and that of local body, is a must condition for the agency.
 28. The Gujarat Energy Transmission Corporation Limited does not bind itself to accept the lowest or any tender. GETCO reserves the right to reject any or all tender without signing any reasons whatsoever.



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebmail.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



29. The erection work should be commenced immediately from the date of receipt of instructions from office and should be completed within thereafter.
30. The tender includes all minor accessories and items of work which are not have been specifically mentioned in the specification schedule etc. but are essential for completion of work. The contractor will not be eligible for any extra payment in respect of such minor accessories and items of work.
31. Tenderer will be qualified only who have submitted all the required documents as mentioned in tender notice.
32. No higher rate or revised rate will be applicable for the work, if work is held up/ closed due to whatever so reasons.
33. GETCO will not pay any idle charge for any site conditions or any circumstances.
34. In case of any dispute/ doubt, the decision of Superintending Engineer (TR), GETCO, Anjar shall be unchallengeable, final and binding to the contractor.
35. The contractor has to remain in close day to day contact with Engineer in charge of work i.e. DE S/s /Line concern who will issue detailed instruction for the commencement of the work.
36. Contractor will abide by and fulfill all the terms and conditions and general terms and condition of the contract for works available in the office.
37. All other general terms and conditions as prevailing in the GETCO shall be applicable to the contract.
38. The contractor will have to complete entire job as per directive and instruction of Engineer in charge. If he fails to do so entire work will be carried out at contractor's risk and cost.
39. The contractor must engage sufficient knowledgeable persons round the clock, exclusively for oil filter machine provided by GETCO for oil filtration work. No loss of oil should occur and in case if occurs; its cost will be recovered from contractor's bill. The contractor has to apply sufficient nos. of cycles for oil filtration works as decided by the Engineer in charge.
40. The tender shall be issued to only the experienced contractor who has completed such job of similar nature and magnitude satisfactorily in time. However, filling of on line tender, does not qualifies the tenderer to offer the bid.
41. Tender offer without payment of EMD required certificate, documents, list of tools, tackles, equipments etc. required for execution of job will be out rightly rejected without assigning any reason thereof and decision of Superintending Engineer (TR), GETCO, Anjar will be final and unchallengeable.
42. The Contractor will be governed by The GETCO's general conditions of works contract. The Booklet will be available in the concerned office in any working days. In the event of placing order, the contractor will have to sign this booklet along with other document and agreement. All the usual terms and conditions of the GETCO, through the same might have not been mentioned in this specification or contractor booklet will applicable to this contract, and the decision of the Superintending Engineer shall be binding on the contractor.
43. After completion of the work, all the surplus materials issued by the GETCO shall be returned by you to the respective center of the GETCO as per instruction of Engineer in charge at your cost.
44. Specification in any items mentioned in tender are subject to change without any prior notice and binding to the contractor.
45. If the work is required to be carried out during fix outage then the contractor has to deploy adequate man power, material, tools etc. well in advance and has to complete the entire work during this specific outage period only, failing to which GETCO shall be at liberally to deduct the amount of revenue loss due to prolong outage.
46. If required by GETCO you shall have to provide free to and fro traveling facility to our Junior Engineer or Technical staff for the work.
47. The contractor shall not refuse to execute the work order at any time and it will be his sole responsibility to execute and complete this work as per the instruction of Engineer in charge.
48. For shortages of any materials issued by the GETCO for the work, recovery shall be made from you, on the basis of prices of the materials (prevailing on the date of settlement of materials account) plus 15% supervision charges.



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebmil.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



49. No subcontractor, Power of Attorney shall be allowed without prior approval of competent authority.
50. All the materials issued by GETCO shall be transported to the work site on same day and to be preserved in safe custody failing to which GETCO shall initiate legal action if required. Similarly as per instruction of Engineer in charge, you have to credit the material at GETCO store without any loss of time failing to which GETCO shall initiate legal action if required.
51. No tools, tackles, manpower, crane facilities etc. will be provided by the GETCO.
52. The contractor has to submit the list of tools, tackles, equipments with him along with his tender offer. The tender without this list and other required documents (as mentioned above herein the tender) should be rejected out rightly.
53. The contractor has to deploy minimum 8 to 10 skill labours/ fitters at site daily failing to which GETCO shall deduct 1,000/- per day from the bill.
54. The bidder shall specifically note that GETCO will not pay any extra amount towards any type of claim except for the description indicated in Schedule – 'B'. The party has to carry out all other/ additional required activities/ works as directed by Engineer in charge which is not mentioned in Schedule but required to be completed as per site condition and for this work no extra payment shall be made by GETCO.
55. **GENERAL:-**
- a) **The interpretation of specifications doubts etc.:-**In case of any doubts about what is mentioned in specification or schedule or elsewhere, the tenderer should get all doubts cleared from the Department in writing and in advance of filling in the Tender. In case of difference of opinion about interpretation of specification etc the decision of Superintending Engineer, Transmission Circle, GETCO, Anjar I will be final and shall be binding to the contractor.
- b) **Accounts of Materials issued:-**The contractor shall have to maintain accurate day to day and item wise account of use of issued materials which shall be got checked from time to time by the representative of the GETCO. The contractor will be responsible for custody and preserving the issued materials till the work is handed over by the contractor after completion.
- c) The contractor has to maintain site register, covering all the daily details of material receipt and utilization, progress of work etc. This register shall be checked and signed by Engineer in charge and Executive Engineer during the site visit. Any bill without site register shall not be passed.
56. The contractor shall be responsible for breakages, losses and theft of material during transit or erection after the materials issued from the stores till the completion of work and is taken over by the GETCO.
57. The contractor will be responsible for the loss, distribution of deterioration of the materials, stores or articles supplied to him by the GETCO, even if such a loss distribution or deterioration has occurred under any circumstances whatsoever beyond his control as if the materials, stores or articles so supplied were his property.
58. The contractor shall co-operate with the GETCO in recording measurement etc. as expeditiously as possible and he shall fulfill all the requirements which are necessary to finalize the accounts on the basis of its records and pay him such amount as if found due to him together with the amount of security deposit. If any remaining payable to him after deduction there from the amount due by him to the GETCO. The GETCO shall not entertain further claim from thereafter.
59. The competent authority can delete any item in schedule of the tender, if he feels that the rate quoted by the contractor for that item is abnormally high when compared to the estimated rates.
60. **Delivery of Material:-**All material/ equipment required for this work as per schedule shall be delivered at any store centers of GETCO and contractor has to take delivery from these stores or at his own cost only.
61. You will ensure that completion of erection work i.e. all works connected with substation having been completed correctly as per Indian Electricity Rules & procedure. Any extra cost involved due to incompleteness of work or bad workmanship found out Subsequently shall be set right forth with by you at your own cost.



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebmail.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



62. Billing and Payment Terms

1. Payment will be made by running account bill monthly after taking joint measurement and following procedure given in Clause of the Tender and contract for works. If there is any delay on the part of GETCO to make payment of R. A. Bill as per clause mentioned above, you will not claim any extra for the same. The R.A. Bill should be submitted to concerned **Executive Engineer (AMD)**
 2. The payment of the above order will be processed through VMS portal of GUVNL hence you are required to get yourself registered on <https://vms.guvnl.com> and submit the digitally signed invoices, GST CA certificates, E-way bill, delivery challan and other supporting documents to Consignee location using your login ID and password on the VMS portal of GUVNL.
- (a) The contractor shall have to submit the RA bill of order to the concerned Deputy Engineer of sub-division of concerned division for payment once in a month period.
- (b) 90% payment of amount claimed covering various activities such as excavation, foundation, erection, earthing, stringing of bus bar and earth wire including insulator hoisting works against R.A. bills duly certified by EIC within 60 days from the date of R.A. bill.
- (c) Balance 10% of erection value shall be paid within 60 days against completion of work only after settlement of material account statement of items supplied, used, erected and successful commissioning of Sub-Station line the same amount will be release in final bill only and payment will be made only after passing of final bill.
- (d) If net payable amount is more than Rs 10 Lacs, payment will be released from circle office/corporate office.
- (e) The payment will be released within 60 days. However, in case of any delay due to any eventuality no interest charges shall be paid.
- (f) All the bills in accordance with the above clauses must be submitted with the following information:
- 1) Item wise work done during billing period.
 - 2) Item wise cumulative work done.
 - 3) Account for material consumed and balance stock.
 - 4) For non-submission or part submission of above information, an additional 5% amount of the respective RA bill shall be withheld and shall only be released at the time of final bill.
- (g) Any outstanding recoveries of GETCO for any other than this transaction or anywhere done in GETCO can be recovered from this contractor's/ supplier's payment which is authentically approved by competent authority.

63. PROTECTION OF PROPERTY AND CONTRACTOR'S LIABILITY

The Contractor shall be responsible for any damage resulting from his operations. He shall also be responsible for protection of all persons including members of public and employees of the Owner and the employees of other Contractors and Sub-Contractors and all public and private property.

64. Quantities given in the Schedule of erection in price Bid are to be executed by the contractor at the rates accepted by the Board in the A/T. In case of any deviation in tower quantity / type of tower / length of line, excavation / concreting resulting into an increase in which event the field officer shall obtain prior approval of the Head Office and excess quantity shall be paid only at the accepted rate of the A / T. No any Excess work / amount to be executed without prior approval of competent authority.



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



65. The erection work beyond contractual ceiling amount shall be done only after approval from the GETCO authority.
66. **CONTRACTOR'S SITE ESTABLISHMENT**
The Contractor shall at all times keep posted an authorized representative for the purpose of the Contract. Any written order or instruction of the Engineer or his duly authorized representative shall be communicated to the said authorized resident representative of the Contractor and the representative shall be available at a stated address for this purpose.
67. **CO-OPERATION WITH OTHER CONTRACTORS**
Contractor shall co-operate with all other Contractors or tradesmen of the Owner, who may be performing other works on behalf of the Owner and the workmen who may be employed by the Owner and doing work in the vicinity of the Works under the Contract. The Contractor shall also so arrange to perform his work as to minimize, to the maximum extent possible, interference with the work of other Contractors and their workmen. Any injury or damage that may be sustained by the employees of the other Contractors and the Owner, due to the Contractor's work shall promptly be made good at the Contractor's own expense.
68. **PROTECTION OF WORK**
The Contractor shall have total responsibility for protecting his works till it is finally taken over by the Engineer. No claim will be entertained by the Owner or by the Engineer for any damage or loss to the Contractor's works and the Contractor shall be responsible for complete restoration of the damaged works to original conditions to comply with the specification and drawings.

Contractor Signature with stamp



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



SPECIAL COMMERCIAL CONDITION FOR TENDERER

1. TAKING DELIVERY AND INSURANCE:-

- 1.1 The contractor has keep S/S/ line materials in safe custody and transport to the respective sites and will be responsible for any damages to or loss of all materials at any stage during transportation or erection or taking over of the line by GETCO.
- 1.2 The Contractor has to open site store and ensure for safe custody of all the stored materials at his own cost.
- 1.3 The Contractor shall have total responsibility for the entire materials stored loose, semi assembled and/or erected by him at site in his custody. The Contractor shall make suitable security arrangements is at own cost to ensure the protection of all materials, equipments and works from theft, fire pilferage and any other damages and loss, it shall be the responsibility of the contractor to arrange for security till the works are finally taken over by the Corporation.

2 STORAGE-CUM-ERECTION-INSURANCE:-

- 2.1 The contractor shall take suitable storage-cum-erection insurance cover at his cost to the extent of 100% cost of sub-station/line materials, which are required to complete the sub-station /line. Bidder shall have to take the comprehensive **Marine cum Erection (MCE)** insurance policy against any loss, damage, theft, pilferage, fire etc. for the complete period of storage, fire etc. for the complete period of storage, erection and commissioning up to the time of taking over of the sub-station/line by GETCO. The contractor shall deal directly and pursue the claim with the Insurance Company and shall be responsible in regard to maintenance of all insurance coverage as well as for settlement of claim. The proof of insurance policy taken by the successful contractor shall be furnished/submitted to Engineer-in-charge of GETCO.

No material shall be issued to bidder/erection agency in absence of such insurance policy. The risk shall be covered for lifting of materials from store to final handing over to GETCO. Further in absence of the above insurance policy, R.A. bill payment will be withheld.

- 2.2 In the event of any damage, theft, loss, pilferage, fire etc, Contractor will be responsible to lodge, pursue and settle all the claims with the insurance company for all items, materials and the corporation shall be kept informed about it. Contractor shall replace the lost/damaged materials/items promptly irrespective of the settlement of the claims by underwriter and ensure that the work progress is as per agreed schedule. The loss, if any, such replacement will have to be borne by the contractor and GETCO will not entertain any claim/representation in this regard. However it will be contractor's responsibility to insure the entire project till the line / sub-station or any other project / works is taken over by the GETCO.

- 2.3 The estimated cost of line material is **As per instruction of Engineer incharge**

3.0 INSURANCE

- 3.1 The Contractor at his cost shall arrange, secure and maintain all insurance as may be pertinent to the Works and obligatory in terms of law to protect his interest and interests of the Owner against all perils detailed herein. The form and the limit of such insurance as defined herein together with the underwriter in each case shall be acceptable to the Owner. However, irrespective of such acceptance, the responsibility to maintain adequate insurance coverage at all time during the period of Contract shall be of Contractor alone. The Contractor's failure in this regard shall not relieve him of any of his contractual responsibilities and obligations. The insurance covers to be taken by the Contractor shall be in the joint name of the Owner and the Contractor. The Contractor shall, however, be authorized to deal directly with Insurance Company or Companies and shall be responsible in regard to maintenance of all insurance covers. Further the insurance should be in freely convertible currency.
- 3.2 Any loss or damage to the material during handling, transportation, storage, erection, and all activities to be performed till the successful completion of commissioning of the line shall be to the account of the Contractor. The Contractor shall be responsible for preference of all claims and make good the damages or loss by way of repairs and/or replacement of the equipment, damaged or lost. The transfer of title



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebmail.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



shall not in any way relieve the Contractor of the above responsibilities during the period of Contract. The Contractor shall provide the Owner with copy of all insurance policies and documents taken out by him in pursuance of the Contract. Such copies of documents shall be submitted to the Owner immediately after such insurance coverage. The Contractor shall also inform the Owner in writing at least sixty (60) days in advance regarding the expiry/cancellation and/or change in any of such documents and ensure revalidation, renewal etc., as may be necessary well in time.

- 3.3 The perils required to be covered under the insurance shall include, but not be limited to fire and allied risks, miscellaneous accidents (erection risks) workman compensation risks, loss or damage in transit, theft, pilferage, riot and strikes and malicious damages, civil commotion, weather conditions, accidents of all kinds, etc. The scope of such insurance shall be adequate to cover the replacement/reinstatement cost of the equipment for all risks up to and including delivery of goods and other costs till the equipment is delivered at Site. The insurance policies to be taken should be on replacement value basis and/or incorporating escalation clause. Notwithstanding the extent of insurance cover and the amount of claim available from the underwriters, the Contractor shall be liable to make good the full replacement/rectification value of all equipment/materials and to ensure their availability as per project requirements.

3.4 Workmen's Compensation Insurance

This insurance shall protect the Contractor against all claims applicable under the Workmen's Compensation Act, 1948 (Government of India). This policy shall also cover the Contractor against claims for injury, disability, disease or death of his or his SubContractor's employee, which for any reason are not covered under the Workmen's Compensation Act, 1948. The liabilities shall not be less than:

Workmen's Compensation : As per statutory Provisions

Employee's liability : As per statutory Provisions

3.5 Comprehensive General Liability Insurance

The insurance shall protect the Contractor against all claims arising from injuries, disabilities, disease or death of members of public or damage to property of others, due to any act of omission on the part of the Contractor, his agents, his employees, his representatives and Sub-Contractors or from riots, strikes and civil commotion.

- 3.6 The hazards to be covered will pertain to all the works and areas where the Contractor, his agents and his employees have to perform work pursuant to the Contract.

- 3.7 The above are only illustrative list of insurance covers normally required and it will be the responsibility of the Contractors to maintain all necessary insurance coverage to the extent both in time and amount to take care of all his liabilities either direct or indirect, in pursuance of the Contract.

STORAGE-CUM-ERECTION INSURANCE:- The contractor shall take suitable storage-cum- erection insurance cover at his cost to the extent of 100 % cost of S/S materials, which are required to complete the work. Bidder shall have to take the comprehensive **Marine cum erection (MCE) insurance** policy against any loss, damage, theft, pilferage, fire etc. for the complete period of storage, erection and commissioning up to the time of taking over of the work by GETCO. However, if the work is not completed within the stipulated time limit as mentioned into work order, the MCE shall be extended by the contractor up to the work completion and taking over of the line or S/S by GETCO. Moreover, the charge for extension of insurance shall be borne by contractor if the delay is attributed to the contractor. The charge for



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebmail.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



extension of insurance shall be reimbursed by GETCO to the contractor on production of proof for extension of MCE if the delay is attributed on the part of GETCO.

The Contractor shall deal directly and pursue the claim with the Insurance Company and shall be responsible in regard to maintenance of all insurance coverage as well as for settlement of claim. The proof of insurance policy taken by the successful Contractor shall be furnished/submitted to Engineer-In-Charge of GETCO.

No material shall be issued to bidder/erection agency in absence of such insurance policy. The risk shall be covered for lifting of materials from store to final handing over to GETCO. Further, in absence of the above insurance policy, R.A. Bill payment will be withheld.

The contractor shall take suitable storage cum erection insurance cover for the entire project including all materials, which are required to complete the line, at his own cost. Such insurance will cover against destruction, loss by theft, damage in transit during erection, or otherwise or by fire, flood under exposure to the weather or through riot, civil commotion, for the full value thereof, until takeover of line.

However, it will be contractor's responsibility to Insure entire project till the line is taken over by the GETCO.

The approximate amount of the material required for erection to complete the scope of work whose insurance is to be taken is As per instruction of EIC.

The contractor shall take suitable storage cum erection insurance cover for the entire project including all materials, which are required to complete the line, at his own cost. Such insurance will cover against destruction, loss by theft, damage in transit during erection, or otherwise or by fire, flood under exposure to the weather or through riot, civil commotion, for the full value thereof, until takeover of line.

However, it will be contractor's responsibility to Insure entire project till the line is taken over by the GETCO.

The successful contractor shall be Informed the value for which he has to avail the storage cum erection insurance.

PENALTY FOR DELAY:-

1. The bidder should note that the completion time allowed for carrying out the work should be strictly observed. Any delay that may take place in supply and erection beyond contractual cutoff date stated as per stipulated delivery period shall be subject to the **penalty ½% per week or part thereof plus plus applicable taxes (if any)** as applicable on delayed portion of work and / or supply value subject to ceiling of 10% of the total contract value plus **APPLICABLE TAXES (IF ANY)** as applicable will be imposed.
2. **In event of failure of the Contractor to pay the amount of Penalty as demanded, the Owner shall be entitled to deduct the amount of Penalty for delay from the amounts payable to the Contractors under any bills raised under this contract or any other contract with the GUVNL and its Subsidiary Companies i.e. GETCO, GUVNL, GSECL, MGVCL, DGVCL, PGVCL UGVCL. It is permissible for the Owner to adjust the amount of Penalty of delay against any Bank Guarantee furnished by the Contractor under this contract or any other contract with GUVNL and/or its subsidiary companies.**
3. The parties agree that delay in completion of contract will result into loss of revenue and consequently loss of profit to the owner, however, the amount of loss of revenue on account of delay in commissioning the works cannot be calculated accurately at this stage the parties, therefore, agree the penalty stipulated



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebmail.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



above is a genuine estimate of the loss/damage which will be suffered on account of delay and/or breach on the part of the contractor and the said amount will be payable by the contractor on demand.

4. If it is found that the work is unsatisfactory or not progressing as per the program / BARCHART / Target period, any action taken by the GETCO, as may be deemed fit, to see that work is completed as required by the GETCO, would be at the risk and cost of the contractor..
5. Any delay causing extension of outages shall be contractor's responsibility and appropriate amount (in term of Rupees) as decided by concerned **Ex. Engineer (AMD)** shall be recovered from Contractor's bill as a penalty.

Taxes and Duties:

3.5.1 As regards the income Tax, surcharge on income tax and any other corporate tax, Excluding GST and excluding welfare cess at prevailing rate the owner shall not bear any tax liability whatsoever. The bidder shall be liable and responsible for payment of such taxes as attracted under the provisions of the law.

3.5.2 Notwithstanding the tax liabilities as per the sub-clause 14.1 above the owner shall have the right to make deduction at source from the amounts payable to the contractor in respect of Income Tax (on the cost of items of supply included in the works contract) as may be mandatory in terms of the law. The owner shall not bear any liability in this regard but shall issue necessary certificate in respect of such deduction made.

3.5.3 In case any tax or duty is newly introduced by the Government applicable for this contract with effect from the next day of the date submission of the bid and if the contractor is required to pay additional tax or duty, then the owner shall reimburse the contractor the additional tax or duty so paid by the contractor against submission by the

contractor of documentary evidence to the satisfaction of the owner. This provision will not be applicable to transaction between the contractor and his sub-contractors. Besides the said statutory variation, no other statutory variation shall be payable by the owner.

3.5.4 The owner's liability for all taxes and duties under the contract shall be limited to those indicated by the Bidder in the Sign & Seal of Contractor Page 8 Bid Proposal Sheets, subject to the statutory variations and variations as per Clause No. 14.3. If the cost to the Contractor during the performance of the 'Contract' shall be increased or reduced by reasons of the making, passing or promulgation of any law after the date of submission of bid or by any order, regulation or bye-law having the force of law the amount of such increase or reduction shall be added to or deducted from the "Contract Price" as the case may be for direct transactions between contractor & owner, and not for bought out items. It is the Bidders responsibility to furnish details of taxes, duties, levies etc. applicable as on the date of submission of the bid.

3.5.5 No claim for any increase towards the statutory variation regarding enhancement of existing tax or duty or introduction of a new tax or duty applicable shall be entertained by the Owner during the extended period of contract, if any, provided the extension of the contract is required by causes attributable to the contractor.

3.5.6 The provision of statutory variation regarding enhancement of existing tax or duty or introduction of a new tax or duty will be applicable only to the direct transaction between the contractor and the owner.

3.5.7 Before quoting, the bidder may ascertain from the concerned tax authorities of Government of Gujarat the applicability of Work Contract Tax. Entry Tax, GST etc. in respect of this work and include the same in the quoted price. No separate claim in this regard will be entertained by the Owner, as it is the responsibility of the Bidder to pay all these taxes.



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebmail.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



GST:

"Supplier contractor should charge GST in Invoice at the rate as agreed to / mentioned in acceptance of tender only and any deviation in the same shall not be accepted. Further, any additional liability of GST (later on due to wrong mentioning of GST rate, mis-interpretation of HSN/SAC Code etc.) over and above as charged in the invoice shall be borne by the supplier / Contractor. However, any refund received by the supplier / contractor on account of GST Charged from the company; such refund shall have to be passed on to the company, along with interest needs to be passed on suo-moto by the supplier contractor.

Further the Company has a right to recover the amount of GST along with penal interest at the of 15% per annum if GST charged is not paid / short paid to the government or fail to upload the details or uploads inaccurate particular on GSTIN portal by the Supplier / Contractor within the stipulated time limit.

In case, GOVT. revise the rate of GST rate / code during the tenure of the contract the *provision of statutory variation clause shall apply.*"

"RIGHTS OF THE OWNER:

Whenever any claim or claims for payment of a sum of money arises out of or under the contract against the Contractor, the Owner shall be entitled to withhold and also have a lien to retain such sum or sums in whole or in part from the security, If any, deposited by the Contractor and for the purpose aforesaid, the Owner shall be entitled to encash and withhold the amount of Performance Bank Guarantee or other security, if any, furnished as the case may be. The Owner shall also have a lien over the same pending finalization or adjudication of any such claim. In the event Of the security is insufficient to cover the claimed amount or amounts, the Owner shall be entitled to withhold and have lien to retain to the extent of the such claimed amount or amounts referred to above, from any sum or sums found payable or which at any time thereafter may become payable to the Contractor under the same contract or any other contract with the Owner or GUVNL or its subsidiary companies pending finalization or adjudication of any such claim.

Line in respect of Claims in other Contracts:

a) Any sum of money due and payable, to the Contractor (Including the security deposit) under the contract may be withheld or retained by way of lien by the Owner against any of its claim in respect of payment of a sum of money arising out of or under any other contract made by the Contractor with the Owner or GUVNI or any of its subsidiary companies.

b) It is on agreed that the sum of money so withheld or retained under this clause by the Owner will be kept withheld or retained as such by the Owner till its claim arising out of the same contract or any other contract is either mutually settled or determined by the arbitrator or competent court, as the case may be, and the Contractor shall have no claim for interest or damages whatsoever on this account or on any other ground in respect of any sum of money withheld or retained under this clause and as may be duly notified to the Contractor.



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebbmail.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



This is put up herewith for perusal and approval so that above stated enabling clauses may be incorporated in the terms and conditions of Tender / Contracts by our Procurement Department, Project Department, Transmission Department, R&M Department and Civil department. Further, we may ask CE (Project) to instruct the field offices for incorporating the above clauses in field tenders.

TERMS & CONDITIONS REGARDING INDUSTRIAL LAWS AND OTHER RELATED MATTERS

1) Wages to be paid at time of payment etc. by the contractor.

- a. The contractor shall pay minimum prevailing rates per day or as may be specified hereafter or rates fixed under the minimum wages Act. Whichever is higher. The wages or very contract labour employed by him under this contract shall be paid by him before the expiry of 7th day of the month in respective of which the wages are payable (i.e. wages of a month have to be paid by him in the first week of the next month). The payment shall be disbursed in the presence of management representative during the working hours in factory premises and the contractor shall get the entries certified in the register of wages by the representative of the GETCO. Any default will result in cancellation of contract forthwith or also the contractor shall be paid punishable to the extent of Rs.100/- fine per each day.
- b. The contractor shall give his telephone number and address to the GETCO so that in case of labour troubles etc. the contractor can be contacted. The contractor shall arrange to have his office outside the factory premises and the contractor shall keep himself present throughout the working hours.

2) Labour Laws

- (A) Person below the age of 18 years shall not be employed for the work.
- (B) No. female worker shall be employed in the night shift between 7 p.m. to 6 a.m.
- (C) Contractor shall maintain a valid labor license under the contract labour (Regulation and Abolition) Act for employing necessary manpower to be required by him. In the absence of such license the contract shall be liable to be terminated without assigning any reason thereof.
- (D) The contractor shall at his own expenses comply with all labour laws and keep the GETCO indemnified in respective thereof. Some of the major liabilities under various labour and industrial laws which the contractor shall comply with areas under :-
 - (i) Payment of contribution by way of employer's contribution towards provident fund, family pension scheme, Deposit linked insurance scheme, Administrative charge etc. at the rates make applicable from time to time by Government of Gujarat/Government of India or other statutory authority.
 - (ii) Payment of deposit in respect of each contract labour at the rate as per admissible with the office of commissioner of Labour as per the contract Labour (Regulation and abolition Act.).
 - (iii) License fee as prescribed under the contract labour (Regulation and abolition Act) and rules framed there under depending upon the number of workmen employed by the contractor.
 - (iv) Paid leave facility and wages as per the provision of the factories Act at the rate of one day for every 20 days of working.
 - (v) Identify cards as prescribed under the factories Act with photo at fixe there to the same identification. Liabilities as per industrial Disputes Act any payment to the contractor's employees arising out of any claim or disputes under the industrial Disputes Act, 1947 or any other labour laws.
 - (vi) Payment of compensation in case accidental injury.
 - (vii) Maternity leave as per the provisions of the maternity Benefit Act. The above are some of the major liabilities of the contractor in addition to other liabilities. Prescribed under the various labour laws in force from time to time from statutory authorities like State Government/ Government of India which the contractor shall have to comply with.



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebmail.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



3) **Provident fund & Family pension Scheme:-**

The contractor shall submit along with his bill (month wise) a statement regarding deduction against employees provident fund and family pension scheme in respective of each concerned employee, provident fund and family pension scheme at the rate at admissible (or at the rate made applicable by the Government from time to time) of the wages. The contractor's contribution and his workers contribution towards provident fund and family pension scheme shall be deposited by the contractor with concern regional Provident Fund Commissioner office.

4) **Deposit Linked Insurance Scheme :-**

The contractor shall have to deposit ½ % of the wage in respect of employees who is a member of the Provident Fund as the contribution to the deposit.

Linked insurance Scheme with concern Regional Provident Fund Commissioner office.

(5) **Administrative Charges:-**

Administrative charges for maintaining provident fund A/C shall be deposited by the contractor with concern Regional Provident Fund Commissioner office at the rates applicable.

(6) **Paid Leave Facility:-**

Paid leave facility at the rate of one day for every twenty days worked by the contract labour shall be provided by the contractor to his workers. He shall maintain leave Records/leave cards for individual labourer which shall be duly verified and approved/certified by the authorized officer of the GETCO.

(7) **Workmen's compensation fund & Employer's Liability Insurance:-**

The contractor shall cover all his employees under workmen's compensation fund and under the liability insurance. Insurance shall be affected for the entire contractor's employee engaged in the performance of this contract. If any of the work is subject the contractor shall require the sub-contractor to provide workmen's compensation and employer's liability insurance for the latter's employees unless such employees are covered under the contractor's insurance.

(8) **The contractor shall employ adequate number of experienced staff at site for dial supervision and for maintenance of various register and records required under the law and contract No. payment for supervision shall be admissible.**

(9) **Contractor to Identify the GETCO:-**

The contractor shall indemnify the GETCO and every member officer and employees of the GETCO also, engineering in charge and his staff against all actions, proceeding, claims demands, costs and expenses which may be made against the GETCO or Government for or in respective of formance of his obligation under the contract documents. The GETCO shall not liable for or in respective of or in consequence of any accident or injury to any workman or other person in the employment of the contractor or his sub-contractor and the contractor shall indemnify and keep indemnified the GETCO against all such damage and compensation and against all claims, demands, proceedings costs, charges and expenses whatever in respective thereof in relation thereto.

(10) **The GETCO reserves the right to terminate this rate contract at any time during its tendency without giving notice of termination or any reasons thereof.**

(11) **The GETCO will be entitled to deduct directly from the bills, to be paid to the contractor any sum or payable by you and which sum/sums the GETCO is required to pay as principal employer on account of your default in respect of all liabilities referred to in above clauses.**

Contractor Signature with stamp



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebmail.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



GENERAL TECHNICAL CONDITION:

1. The erection work should be carried out according to the specification and as per instructions and programmed laid out by the Engineer in-charge of the work.
2. The contractor should employ as Supervisor with sufficient qualification and experience who can supervise the execution of work throughout. He should always be present on the site.
3. Cutting, bending, welding, brazing, wherever necessary is to be done by the contractor.
4. The contractor has to carry out all the works in accordance with revised and latest provision under I.E. Rules Act made there under and as per instruction of Engineer in charge.
5. Contractor has to co-ordinate E.I.C. for planning of outage and work schedule thereof, so as to complete all the planned work in outage. Contractor has to deploy adequate manpower accordingly.
6. In addition to the general of the construction particular, attention shall be paid to the final finish and every effort shall be made to have the entire work contented with standard of workmanship by the contractor.
7. **Electricity Rules:** - All the works shall be carried out in accordance with latest rules under Electricity Act.
8. **Testing:** - Complete installation shall be put to the necessary test as required and shall be got approved by Government Electrical Inspector.
9. **CONTRACTOR'S MATERIALS BROUGHT TO SITE**
 - a) The Contractor shall bring to Site all materials, including construction equipment, tools and tackles for the purpose of the works under intimation to the Engineer. All such goods shall, from the time of their being brought vest in the Owner, but may be used for the purpose of the works only and shall not on any account be removed or taken away by the Contractor without the written permission of the Engineer. The Contractor shall nevertheless be solely liable and responsible for any loss or destruction thereof and damage thereto.
 - b) After the completion of the Works, the Contractor shall remove from the Site under the direction of the Engineer the materials such as construction equipment, erection tools and tackles, scaffolding etc. with the written permission of the Engineer.

10. FIELD OFFICE RECORDS

The Contractor shall maintain up to date copies of all drawings, specifications and other Contract Documents and any other supplementary data complete with all the latest revisions thereto. The Contractor shall also maintain in addition the continuous record of all changes to the above Contract Documents, drawings, specifications, and supplementary data, etc. effected at the field and on completion of his total assignment under the Contract shall incorporate all such changes on the drawings and other Engineering data to indicate as installed conditions of the equipment furnished and erected under the Contract. Such drawings and Engineering data shall be submitted to the Engineer in required number of copies.

11. Contractor shall purchase all brought out items as per schedule-B with taking prior approval from concerned **Executive Engineer (AM), GETCO, Division**. Any item without approval shall not be permitted and GETCO shall not be responsible for accept such items.

12. DISCIPLINE OF WORKMEN

The Contractor shall adhere to the disciplinary procedure set by the Engineer in respect of his employees and workmen at Site. The Engineer shall be at liberty to object to the presence of any representative or employee of the Contractor at the Site, if in the opinion of the Engineer such employee has misconduct himself or is incompetent or negligent or otherwise undesirable and then the Contractor shall remove such a person objected to and provide in his place a competent replacement.

13. CONTRACTOR'S FIELD OPERATION



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



- 1 The Contractor shall keep the Engineer informed in advance regarding his field activity plans and schedules for carrying-out each part of the works. Any review of such plan or schedule or method of work by the Engineer shall not relieve the Contractor of any of his responsibilities towards the field activities. Such reviews shall also not be considered as an assumption of any risk or liability by the Engineer or the Owner or any of his representatives and no claim of the Contractor will be entertained because of the failure or inefficiency of any such plan or schedule or method of work reviewed. The Contractor shall be solely responsible for the safety, adequacy and efficiency of plant and equipment and his erection methods.
- 2 The Contractor shall have the complete responsibility for the conditions of the Work-site including the safety of all persons employed by him or his Sub-Contractor and all the properties under his custody during the performance of the work. This requirement shall apply continuously till the completion of the Contract and shall not be limited to normal working hours.
14. **PROGRESS REPORT**
The Contractor shall furnish three (3) copies each to the Engineer of progress including if any, photographs of the work done at Site. The monthly progress report detailing-out the progress achieved on all erection activities shall highlight comparison to the schedules. The report shall also indicate the reasons for the variance between the scheduled and actual progress and the action proposed for corrective measures, wherever necessary.
15. **MAN-POWER REPORT**
The Contractor shall submit to the Engineer, on the first day of every month, a man hours schedule for the month, detailing the man hours scheduled for the month, skill-wise and area-wise.
16. **Contract Quality assurance:**

The Bidder shall include in his proposal the Quality Assurance Programme containing the overall quality management and procedures which he proposes to follow in the performance of the Works during various phases. At the time of Award of Contract, the detailed Quality Assurance Programme to be followed for the execution of the Contract will be **mutually discussed and agreed and such agreed Programme shall form a part of the Contract.**

Contractor Signature with stamp



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebmail.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



SPECIAL TECHNICAL CONDITION:

- i. All work is to be carried out as per the manual of OEM (Original equipment manufacturer), FQP, approved drawing, specification and instruction of E.I.C.
- ii. All erection work includes erection insurance to be arranged by the contractor at his cost.
- iii. All the required tools and tackles like compression jointing machine for conductor, earth wire, cutting machine, welding set, drill machine, etc are to be arranged by the contractor at his cost.
- iv. All the work related to the transmission line like detailed survey, check survey, tower/DP foundations, material testing, tower/DP erection, stringing, final testing, etc. should be carried out as per GETCO'S standard FQP for transmission line.
- v. Successful bidder has to appoint site engineer to maintain site register and FQP as per ISO
- vi. All work should be done according to ISO & FQP and all require documents including filled FQP, testing results, etc should be submitted while handing over the line
- vii. While calculating the weight of stub-setting, the weight of stub, cleat & templates shall also be added in stub weight.
- viii. The rates are with supply of cement by the contractor.
- ix. Red oxide & zinc rich paint shall be applied after tack welding of nuts.
- x. The rate indicated includes taking delivery of all stringing material Board's stock at destination keeping them in safe custody and transporting the same to erection site
- xi. Contractor has to ensure safe shifting dragging erection of all equipments to comply with labour laws I.E. rules etc.
- xii. Earthing pit activities should be done in such a way in presence of GETCO supervisor that final earthing pit resistance should be record as per standard. All expenditure like sufficient watering to maintain earth resistance up to the mark should be born by contractor.
- xiii. Contractor has to make arrangement for skill labours for assisting to commissioning engineer as an when require as per instruction of Engineer in charge.
- xiv. After completion of project successful bidder has to submit all the records like Final as build check survey, profile, clearance, foundation register, soil classification record, stringing chart, material inventory sheet etc in hard and soft copy for handing over the project.
- xv. All items / materials shall be installed / erected in accordance with specified manuals /technical guide lines of the manufacturer and as per instruction of EIC.
- xvi. Successful bidder has to appoint site engineer to maintain site register and FQP as per ISO.
- xvii. All work should be done according to ISO & FQP and all require documents including filled FQP, testing results, etc should be submitted while handing over the project.
- xviii. Contractor has to submit the planning bar chart before starting the work in kickoff meeting.
- xix. Contractor has to complete all the work related to this title in stipulated outage period as per instruction of EIC
- xx. Material from store shall not be issued until contractor will submit proof for taking storage cum erection insurance policy for particular project.

Contractor Signature with stamp



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebmail.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



GENERAL CONDITIONS OF CONTRACT

(C) GENERAL TERMS & CONDITIONS OF CONTRACT

A. INTRODUCTION

1.0 DEFINITION OF TERMS

- 1.1 The 'Contract' means the agreement entered into between the Owner and the Contractor as per the Contract Agreement signed by the parties, including all attachments and appendices thereto and all documents incorporated by reference therein.
- 1.2 'Owner' shall mean the Gujarat Energy Transmission Corporation Ltd, Vadodara or any of its group companies i.e GUVNL, GSECL, MGVL, DGVCL, PGVCL, UGVCL and shall include its legal representatives, successors and assigns.
- 1.3 'Contractor' shall mean the Bidder whose bid is accepted by the Owner for the award of the Works and shall include such successful Bidder's legal representatives, successors and permitted assigns.
- 1.4 'Engineer' shall mean the officer appointed in writing by the Owner to act as Engineer from time to time for the purpose of the Contract.
- 1.5 The terms 'Stores' and 'Materials' shall mean and include equipment, stores and materials to be issued to the Contractor under the Contract.
- 1.6 'Works' shall mean and include taking delivery of line materials labour and services, as per the Specifications and complete erection, testing and putting into satisfactory operation including all transportation, handling, unloading and storage at the Site as defined in the Contract.
- 1.7 'Specifications' shall mean the Specifications and Bidding Document forming a part of the Contract and such other schedules and drawings as may be mutually agreed upon.
- 1.8 Site' shall mean and include the land and other places on, into or through which the works and the related facilities are to be erected or installed and any adjacent land, paths, street or reservoir which may be allocated or used by the Owner or Contractor in the performance of the Contract.
- 1.9 The term 'Contract Price' shall mean the lump-sum price quoted by the Contractor in his bid with additions and/or deletions as may be agreed and incorporated in the Letter of Award and the contract agreement for the entire scope of the works.
- 1.10 The term "Erection portion" of the contract price shall mean the value of field activities of the works including erection, testing, and putting into satisfactory operation including successful completion of performance and guarantee test to be performed at site by the contractor including cost of insurances.
- 1.11 Site Engineer 'Inspector' shall mean the owner's Engineers or any person nominated by the time to inspect the equipment; stores or Works under the Contract and/or the duly authorized representative of the Owner.



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



- 1.12 'Notice of Award of Contract'/'Letter of Award'/'Telex of Award' shall mean the official notice issued by the Owner notifying the Contractor that his bid has been accepted.
- 1.13 'Order' shall mean the official letter issued by the Owner informing the acceptance of the bid.
- 1.14 Date of Contract' shall mean the date on which letter of commencement of work issued by the respective sub division deputy engineer.
- 1.15 'Month' shall mean the calendar month. 'Day' or 'Days' unless herein otherwise expressly defined shall mean calendar day or days of 24 hours each.
- A 'Week' shall mean continuous period of seven (7) days.
- 1.16 Writing' shall include any manuscript, type written or printed statement, under or over signature and/or seal as the case may be.
- 1.17 When the words 'Approved', 'Subject to Approval', 'Satisfactory', 'Equal to', 'Proper', 'Requested', 'As Directed', 'Where Directed', 'When Directed', 'Determined by', 'Accepted', 'Permitted', or words and phrases of like importance are used the approval, judgment, direction etc. is understood to be a function of the Owner/Engineer.
- 1.18 Test on completion shall mean such tests as prescribed in the Contract to be performed by the Contractor before the work is taken over by the Owner.
- 1.19 'Performance and Guarantee Tests', shall mean all operational checks and tests required to determine and demonstrate capacity, efficiency, and operating characteristics as specified in the Contract Documents.
- 1.20 The term 'Final Acceptance'/'Taking Over' shall mean the Owner's written acceptance of the Works performed under the Contract, after successful commissioning/completion of Performance and Guarantee Tests, as specified in the accompanying Technical Specifications or otherwise agreed in the Contract.
- 1.21 'Latent Defects' shall mean such defects caused by faulty designs, material or work-man- ship which cannot be detected during inspection, testing etc, based on the technology available for carrying out such tests.
- 1.22 'Codes' shall mean the following including the latest amendments and/or replacements, if any:
- a) Indian Electricity Act, 1905 and Rules and Regulations made there under.
 - b) Electricity Act 2003 and Rules & Regulations made there under.
 - c) Indian Factory Act, 1948 and Rules and Regulations made there under.
 - d) Indian Explosives Act, 1884 and Rules and Regulations made there under.
 - e) Indian Petroleum Act, 1934 and Rules and Regulations made there under.
 - f) A.S.M.E. Test Codes.



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



- g) A.I.E.E. Test Codes.
- h) American Society of Materials Testing Codes.
- i) Standards of the Indian Standards Institution.
- j) Other Internationally approved standards and/or rules and regulations touching the subject matter of the Contract.

- 1.23 Words imparting the singular only shall also include the plural and vice -versa where the context so requires.
- 1.24 Words imparting 'Person' shall include firms, companies, corporations and associations or bodies of individuals, whether incorporated or not.
- 1.25 Terms and expressions not herein defined shall have the same meaning as are assigned to them in the Indian Sale of Goods Act (1930), failing that in the Indian Contract Act (1872) and failing that in the General Clauses Act (1897) including amendments thereof, if any.

Or

- 1.26 In addition to the above the following definitions shall also apply.
- a) 'All equipment and materials' to be supplied shall also mean 'Goods'.
 - b) 'Constructed' shall also mean 'erected and installed'.
 - c) 'Contract Performance Guarantee' shall also mean 'Contract Performance Security'.

2.0 APPLICATION

These General Conditions shall apply to the extent that they are not superseded by provisions in other parts of the Contract.

3.0 STANDARDS

The works carried out under this Contract shall conform to the all statutory regulation and provisions the acts, mentioned in the Technical Specifications, and, when no regulations or standard is mentioned, to the authoritative regulations or standards/ Act, appropriate to the works and such stipulations shall be the latest issued by the concerned institution.

4.0 LANGUAGE AND MEASURES

All documents pertaining to the Contract including specifications, schedules, notices, correspondences, operating and maintenance instructions, drawings or any other writing shall be written in English language. The Metric System of measurement shall be used exclusively in the Contract.

5.0 CONTRACT DOCUMENTS



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



- 5.1 The term Contract Documents shall mean and include the following which shall be deemed to form an integral part of the Contract:
- a) Invitation to Bid including letter forwarding the Bidding Documents, Instructions to Bidders, General Terms and Conditions of Contract and all other documents included under Volume- I and the Special Conditions of Contract.
 - b) Specifications of the erection of the equipments and other technical services to be provided under the Contract as brought out in the accompanying Technical Specifications.
 - c) Contractor's Bid Proposal and the documents attached there to including the letters of clarifications thereto between the Contractor and the Owner prior to the Award of Contract except to the extent of repugnancy.
 - d) All the materials, literature, data and information of any sort given by the Contractor along with his bid, subject to the approval of the Owner /Consultant.
 - e) Letter of Award and any agreed variations of the conditions of the documents and special terms and conditions of Contract, if any.
- 5.2 In the event of any conflict between the above mentioned documents the matter shall be referred to the Engineer whose decision shall be considered as final and binding upon the parties.

6.0 USE OF CONTRACT DOCUMENTS AND INFORMATION

- 6.1 The Contractor shall not, without the Owner's prior written consent, disclose the Contract, or any provision thereof, or any specification, plan, drawing, pattern, sample or information furnished by or on behalf of the Owner in connection therewith, to any person other than a person employed by the Contractor in the performance of the Contract. Disclosure to any such employed person shall be made in confidence and shall extend only so far as may be necessary for the purpose of such performance.
- 6.2 The Contractor shall not, without the Owner's prior written consent, make use of any document or information enumerated in various Contract documents except for the purpose of performing the Contract.
- 6.3 The Contractor shall not communicate or use in advertising, publicity, sales releases or in any other medium, photographs or other reproduction of the Works under this Contract, or descriptions of the site, dimensions, quantity, quality or other information, concerning the works unless prior written permission has been obtained from the Owner.
- 6.4 Any document, other than the Contract itself, enumerated in various Contract documents shall remain the property of the Owner and shall be returned (in all copies) to the Owner on completion of the Contractor's performance under the Contract if so required by the Owner.

7.0 CONSTRUCTION OF THE CONTRACT

- 7.1 Notwithstanding anything stated elsewhere in the bid documents, the Contract to be entered into will be treated as a single Contract.
- Award shall be placed on the successful Bidder as follows:

Tender for Stub Strengthening of 220KV Nakhatrana Panandhrao D/C line and 220KV Nakhatrana Nanikhakhar D/C line under Nakhatrana AM Division under Anjar AM Circle (Work approved under R&M 2026-27) Seal and signature of contractor



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



For providing services like inland transportation, insurance for delivery at site, unloading, storage, handling at site, installation, testing and commissioning including performance testing in respect of all the equipment material equipment/materials given by the owner after observing standard store procedures for transport from owner's stores, insurance, unloading storage handling at site installation testing & commissioning.

7.2 In case erection Contract, or where the Owner hands over his equipment to the Contractor for executing, then the Contractor shall at the time of taking delivery of the equipment/dispatch documents be required to execute an Indemnity Bond in favor of the Owner in the form acceptable to the **SE(TR) GETCO Anjar** for keeping the equipment in safe custody and to utilize the same exclusively for the purpose of the said Contract. Samples of Performa for the Indemnity Bond will be furnished during award of Contract.

7.3 The Contract shall in all respects be construed and governed according to Indian Laws.

7.4 It is clearly understood that the total consideration for the Contract(s) has been broken up into various components only for the convenience of payment under the Contract(s) and for the measurement of deviations or modifications under the Contract(s).

8.0 JURISDICTION OF CONTRACT

8.1 The laws applicable to the Contract shall be the laws in force in India. The Courts of Vadodara shall have exclusive jurisdiction in all matters arising under this Contract.

9.0 EXECUTION OF CONTRACT:

9.1 The Owner, after the issue of the Letter of Award to the Contractor, will send one copy of the final agreement to the Contractor for his scrutiny and approval.

9.2 The Agreement, unless otherwise agreed to, shall be signed within 10 days of the acceptance of the Letter of Award, at the office the Owner at **Anjar** on a date and time to be mutually agreed. The Contractor shall provide for signing of the Contract, Performance Guarantee, appropriate power of attorney and other requisite materials. In case the Contract is to be signed beyond the stipulated time, the Bid Guarantee submitted with the Proposal will have to be extended accordingly.

9.3 The Agreement will be signed in copies to be specified and the Contractor shall be provided with one signed original and the rest will be retained by the Owner.

9.4 The Contractor shall provide free of cost to the Owner all the Engineering data, drawings, and descriptive materials submitted with the bid, to form a part of the Contract immediately after issue of Letter of Award

9.5 Subsequent to signing of the Contract, the Contractor at his own cost shall provide the Owner with copies of agreement within fifteen (15) days after the signing of the Contractor.

10.0 ENFORCEMENT OF TERMS

10.1 The failure of either party to enforce at any time any of the provisions of this Contract or any rights in respect thereto or to exercise any option therein provided, shall in no way be construed to be a waiver



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebmail.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



of such provisions, rights or options or in any way to affect the validity of the Contract. The exercise by either party of any of its rights herein shall not preclude or prejudice either party from exercising the same or any other right it may have under the Contract.

11.0 COMPLETION OF CONTRACT

11.1 Unless otherwise terminated under the provisions of any other relevant clause, this Contract shall be deemed to have been completed on the expiry of the guarantee period as provided for under the clause entitled 'Guarantee' in this section of the Volume-I.

B. GUARANTEES & LIABILITIES

12.0 TIME - THE ESSENCE OF CONTRACT

12.1 The time and the date of completion of the Contract as stipulated in the Contract by the Owner without or with modifications, if any, and so incorporated in the Letter of Award, shall be deemed to be the essence of the Contract. The Contractor shall so organize his resources and perform his work as to complete it not later than the date agreed to.

12.2 The Contractor shall submit a detailed bar chart within the time frame agreed consisting of adequate number of activities covering various key phases of the work such as field erection activities within five (5) days of the date of Notification of Award. This network shall also indicate the interface facilities to be provided by the Owner and the dates by which such facilities are needed. The Contractor shall discuss the network so submitted with the Owner and the agreed network shall form part of the Contract documents. During the performance of the Contract, if in the opinion of the Engineer, proper progress is not maintained, suitable changes shall be made in the Contractor's operations to ensure proper progress without any cost implication to the Owner. The interface facilities to be provided by the Owner in accordance with the agreed network shall also be reviewed while reviewing the progress of the Contractor.

12.3 Based on the above agreed network/bar chart fortnightly reports shall be submitted by the Contractor as directed by the Engineer.

12.4 Subsequent to the finalization of the network, the Contractor shall make available to the Engineer a detailed program in line with the agreed Contract network. Such program shall be reviewed, updated and submitted to the Engineer every month thereafter.

12.5 The above bar charts/ program shall be compatible with the Owner's computer environment and furnished to the Owner on such media as may be desired by the Owner.

13.0 EFFECTIVENESS OF CONTRACT

The Contract shall be considered as having come into force from the date of the commencement given by the respective construction sub division unless otherwise provided in the notification of award.

14.0 PENALTY FOR DELAY

14.1 The total amount of penalty for delay under the Contract will be ½ % per week plus applicable taxes (if any) on delayed work amount subject to a maximum of 10% of the Contract prices detailed in the Special Conditions of Contract (SCC).



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



15.0 GUARANTEE

- 15.1 In the event of any emergency where in the judgment of the Engineer, delay would cause serious loss or damages, repairs or adjustment may be made by the Engineer or a third party chosen by the Engineer without advance notice to the Contractor and the cost of such work shall be paid by the Contractor. In the event such action is taken by the Engineer, the Contractor will be notified promptly and he shall assist wherever possible in making necessary corrections. This shall not relieve the Contractor of his liabilities under the terms and conditions of the Contract.
- 15.3 If it becomes necessary for the Contractor to rectify or renew any defective portions of the works the provision of this clause shall apply to portion of the works so rectified or corrected until the expiry of six (6) months from the date of such rectification or correction. If any defects are not rectified within a reasonable time, the Engineer may proceed to do the work at the Contractor's risk and cost but without prejudice to any other rights which the Owner may have against the Contractor in respect of such defects.
- 15.4 The rectification or correction of the work will be carried out free of cost by the Contractor. If any rectification or correction is carried out on his behalf at the site, the Contractor shall bear the cost of such rectification or correction.
- 15.5 The acceptance of the works by the Engineer shall in no way relieve the Contractor of his obligations under this clause.
- 15.6 At the end of the guarantee period, the Contractor's liability ceases except for latent defects. For latent defects, the Contractor's liability as mentioned in Clause Nos. 15.1 through 15.5 above, shall remain till the end of 6 months from the date of completion of guarantee period.

16.0 TAXES, PERMITS & LICENCES

The Contractor shall be liable and pay all non-Indian taxes, duties, levies lawfully assessed against the Owner or the Contractor in pursuance of the Contract. In addition to this the Contractor shall be responsible for payment of all Indian duties, levies and taxes lawfully assessed against the Contractor for his personal income & property only.

18.0 DEFENCE OF SUITS

If any action in court is brought against the Owner or Engineer or an officer or agent of the Owner, for the failure, omission or neglect on the part of the Contractor to perform any acts, matters, covenants or things under the Contract, or for damage or injury caused by the alleged omission or negligence on the part of the Contractor, his agents, representatives or his Sub-Contractors, or in connection with any claim based on lawful demands of Sub-Contractors, workmen, suppliers or employees, the Contractor shall in all such cases indemnify and keep the Owner, and the Engineer and/or his representative, harmless from all losses, damages, expenses or decrees arising of such action.

20.0 LIMITATION OF LIABILITIES

The final payment by the Owner in pursuance of the Contract shall mean the release of the Contractor from all his liabilities under the Contract. Such final payment shall be made only at the end of the Guarantee/Warranty period or after finalization of material account and final bill and till such time as the Contractual liabilities and responsibilities of the Contractor, shall prevail. All other payments made under the Contract shall be treated as on-account payments.



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebmail.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



21.0 ENGINEER'S DECISION

21.1 In respect of all matters which are left to the decision of the Engineer including the granting or withholding of the certificates, the Engineer shall, if required to do so by the Contractor, give in writing a decision thereon.

21.2 If, in the opinion of the Contractor, a decision made by the Engineer is not in accordance with the meaning and intent of the Contract, the Contractor may file with the Engineer, within fifteen (15) days after receipt of the decision, a written objection to the decision.

Failure to file an objection within the allotted time will be considered as an acceptance of the Engineer's decision and the decision shall become final and binding.

21.3 The Engineer's decision and the filing of the written objection thereto shall be a condition precedent to the right to request arbitration. It is the intent of the Agreement that there shall be no delay in the execution of the works and the decision of the Engineer as rendered shall be promptly observed.

22.0 POWER TO VARY OR OMIT WORK

22.1 No alterations, amendments, omissions, suspensions or variations of the Works (hereinafter referred to as 'variation') under the Contract as detailed in the Contract Documents, shall be made by the Contractor except as directed in writing by the Engineer, but the Engineer shall have full powers subject to the provisions hereinafter contained, from time to time during the execution of the Contract, by notice in writing to instruct the Contractor to make such variation without prejudice to the Contract. The Contractor shall carry out such variation and be bound by the same conditions as far as applicable as though the said variations occurred in the Contract Documents. If any suggested variations would, in the opinion of the Contractor, if carried out, prevent him from fulfilling any of his obligations or guarantees under the Contract, he shall notify the Engineer thereof in writing and the Engineer shall decide forthwith whether or not, the same shall be carried out and if the Engineer confirms his instructions, the Contractor's obligations and guarantees shall be modified to such an extent as may be mutually agreed. Any agreed difference in cost occasioned by any such variation shall be added to or deducted from the Contract Price as the case may be.

22.2 In the event of Engineer requiring any variation, a reasonable and proper notice shall be given to the Contractor to enable him to work his arrangement accordingly, and in cases where goods or materials are already prepared or any design, drawings or pattern made or work done as per the contract requires to be altered, a reasonable and agreed sum in respect thereof shall be paid to the Contractor.

22.3 In any case in which the Contractor has received instructions from the Engineer as to the requirement of carrying out the alterations or additional or substituted work which either then or later on, will in the opinion of the Contractor, involve a claim for additional payment, the Contractor shall immediately and in no case later than thirty (30) days, after receipt of the instructions aforesaid and before carrying out the instructions, advise the Engineer to that effect. But the Engineer shall not become liable for payment of any charges in respect of any such variations, unless the instructions for the performance of the same shall be confirmed in writing by the Engineer.

22.4 If any variation in the Works results in reduction of Contract Price, the parties shall agree, in writing, so to the extent of any change in the price, before the Contractor proceeds with the change.

22.5 In all the above cases, in the event of a disagreement as to the reasonableness of the said sum, the decision of the Engineer shall prevail.



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



22.6 Notwithstanding anything stated above in this clause, the Engineer shall have the full power to instruct the Contractor, in writing, during the execution of the Contract to vary the quantities of the items or groups of items in accordance with the provisions of clause entitled 'Change of Quantity' in section GCC of this Volume-I. The Contractor shall carry out such variations and be bound by the same conditions as though the said variations occurred in the Contract Documents. However, the Contract Price shall be adjusted at the rates and the prices provided for the original quantities in the Contract.

23.0 ASSIGNMENT AND SUB-LETTING OF CONTRACT:

No subletting of contract is allowed. Contractor should carry out work on his own under his or his authorized supervisor and by labours employed by him.

24.0 CHANGE OF QUANTITY

24.1 During the execution of the Contract, the Owner reserves the right to increase or decrease the quantities of items under the Contract but without any change in unit price or other terms & conditions. Such variations unless otherwise specified in the accompanying Special Conditions of Contract and/or Technical Specifications, shall not be subjected to any limitation for the individual items but the total variations in all such items under the Contract shall be limited to a percentage of the Contract price as specified in the Special Conditions of Contract.

24.2 The Contract price shall accordingly be adjusted based on the unit rates available in the Contract for the change in quantities as above. The base unit rates, as identified in the Contract shall however remain constant during the currency of the Contract, except as provided for in Clause 33.0 below. In case the unit rates are not available for the change in quantity, the same shall be subjected to mutual agreement.

26.0 COOPERATION WITH OTHER CONTRACTORS AND CONSULTING ENGINEERS

The Contractor shall agree to cooperate with the Owner's other Contractors and Consulting Engineers and freely exchange with them such technical information as is necessary to obtain the most efficient and economical design and to avoid unnecessary duplication of efforts. The Engineer shall be provided with three copies of all correspondence addressed by the Contractor to other Contractors and Consulting Engineers of the Owner in respect of such exchange of technical information, wherever needed.

27.0 NO WAIVER OF RIGHTS

Neither the inspection by the Owner or the Engineer or any of their officials, employees, or agents nor any order by the Owner or the Engineer for payment of money or any payment for or acceptance of, the whole or any part of the Works by the Owner or the Engineer, nor any extension of time, nor any possession taken by the Engineer shall operate as a waiver of any provision of the Contract, or of any power herein reserved to the Owner or any right to damages herein provided nor shall any waiver of any breach in the Contract be held to be a waiver of any other or subsequent breach.

28.0 CERTIFICATE NOT TO AFFECT RIGHT OF OWNER AND LIABILITY OF THE CONTRACTOR.

No interim payment certificate of the Engineer, nor any sum paid on account by the Owner, nor any extension of time for execution of the Works granted by the Engineer shall affect or prejudice the rights of the Owner against the Contractor or relieve the Contractor of his obligation for the due performance of the Contract, or be interpreted as approval of the Works done or of the equipment furnished and no certificate shall create liability for the Owner to pay for alterations, amendments, variations or additional works not ordered, in writing, by the Engineer or discharge the liability of the Contractor for



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



the payment of damages whether due, ascertained, or certified or not or any sum against the payment of which he is bound to indemnify the Owner, nor shall any such certificate nor the acceptance by him of any sum paid on account or otherwise affect or prejudice the rights of the Owner against the Contractor.

29.0 PROGRESS REPORTS

During the various stages of the work in pursuance of the Contract, the Contractor shall at his own cost submit periodic progress reports as may be reasonably required by the Engineer with such materials as, charts, net-works, photographs, test certificates, etc. Such progress reports shall be in the form and size as may be required by the Engineer.

30.0 TAKING OVER

Upon successful completion of work of erection of tower line by the Contractor, the Engineer shall issue to the Contractor a completion Certificate as a proof of the final acceptance of the erected line. Such certificate shall not unreasonably be withheld nor will the Engineer delay the issuance thereof on account of minor omissions or defects which do not affect the commercial operation and/or cause any serious risk to the erected line. Such certificate shall not relieve the Contractor of any of his obligations which otherwise survive, by the terms and conditions of the Contract after issue of such certificate.

C. CONTRACT SECURITY AND PAYMENTS

31.0 CONTRACT PERFORMANCE GUARANTEE

The Contractor shall furnish Contract Performance Guarantee(s) for the proper fulfillment of the Contract in the prescribed form within fifteen (15) days of "Notice of Award of Contract". The performance guarantee(s) shall be as per terms prescribed

32.0 PAYMENT

32.1 The payment to the Contractor for the performance of the works under the Contract will be made by the Owner as per the guidelines and conditions specified herein. All payments made during the Contract shall be on account payments only. The final payment will be made on completion of all Works and on fulfillment by the Contractor of all his liabilities under the Contract.

32.2 Currency of Payment

All payments under the Contract shall be in Indian Rupees only.

32.3 Terms.

Payment terms will be as prescribed in the special conditions of contract and on fulfillment of conditions specified thereof.

33.1 Application for Payment

33.2 The Contractor shall submit application for the payment in the prescribed proforma of the Owner. Proforma for application for payment will be as prescribed.

34.1 Each such application shall state the amount claimed and shall set forth in detail, in the order of the Payment Schedule, particulars of the Works including the Works executed at Site and of the equipment shipped/brought on to the site pursuant to the Contract upto the date mentioned in the application and for the period covered since the last preceding certificate, if any.

34.2 Every interim payment certificate shall certify the Contract value of the Works executed upto the date mentioned in the application for the payment certificate, provided that no sum shall be included in any



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebmail.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



interim payment certificate in respect of the works that, according to the decision of the Engineer, does not comply with the Contract.

34.3 Mode of Payment

34.4 Payment due on completion of work shall be made by the Owner through Owner's Bank or directly to the Contractor as per the payment schedule.

34.5.1 All payments under the Contract shall be made as stipulated in the Special Conditions of Contract after signing the Contract Agreement.

Progressive payments linked with erection shall only be made after the issue of certificates by the Engineer, one for the quantum of work completed and the other for the successful completion of quality check points involved in the quantum of work billed.

35.0 DEDUCTIONS FROM CONTRACT PRICE

All costs, damages or expenses which the Owner may have paid, for which under the Contract the Contractor is liable, or any other retention award will be claimed by the Owner. All such claims shall be billed by the Owner to the Contractor regularly as and when they fall due. Such bills shall be supported by appropriate and certified vouchers or explanations, to enable the Contractor to properly identify such claims. Such claims shall be paid by the Contractor within thirty (30) days of the receipt of the corresponding bills and if not paid by the Contractor within the said period, the Owner may then deduct the amount, from any monies due or becoming due by him to the Contractor under the Contract or may be recovered by sections of Law or otherwise.

D. RISK DISTRIBUTION

37.0 INSURANCE

37.1 The Contractor at his cost shall arrange, secure and maintain all insurance as may be pertinent to the Works and obligatory in terms of law to protect his interest and interests of the Owner against all perils detailed herein. The form and the limit of such insurance as defined herein together with the underwriter in each case shall be acceptable to the Owner. However, irrespective of such acceptance, the responsibility to maintain adequate insurance coverage at all time during the period of Contract shall be of Contractor alone. The Contractor's failure in this regard shall not relieve him of any of his contractual responsibilities and obligations. The insurance covers to be taken by the Contractor shall be in the joint name of the Owner and the Contractor. The Contractor shall, however, be authorized to deal directly with Insurance Company or Companies and shall be responsible in regard to maintenance of all insurance covers. Further the insurance should be in freely convertible currency.

37.2 Any loss or damage to the material during handling, transportation, storage, erection, and all activities to be performed till the successful completion of commissioning of the line shall be to the account of the Contractor. The Contractor shall be responsible for preference of all claims and make good the damages or loss by way of repairs and/or replacement of the equipment, damaged or lost. The transfer of title shall not in any way relieve the Contractor of the above responsibilities during the period of Contract. The Contractor shall provide the Owner with copy of all insurance policies and documents taken out by him in pursuance of the Contract. Such copies of documents shall be submitted to the Owner immediately after such insurance coverage. The Contractor shall also inform the Owner in writing at



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebmail.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



least sixty (60) days in advance regarding the expiry/cancellation and/or change in any of such documents and ensure revalidation, renewal etc., as may be necessary well in time.

37.3 The perils required to be covered under the insurance shall include, but not be limited to fire and allied risks, miscellaneous accidents (erection risks) workman compensation risks, loss or damage in transit, theft, pilferage, riot and strikes and malicious damages, civil commotion, weather conditions, accidents of all kinds, etc. The scope of such insurance shall be adequate to cover the replacement/reinstatement cost of the equipment for all risks up to and including delivery of goods and other costs till the equipment is delivered at Site. The insurance policies to be taken should be on replacement value basis and/or incorporating escalation clause. Notwithstanding the extent of insurance cover and the amount of claim available from the underwriters, the Contractor shall be liable to make good the full replacement/rectification value of all equipment/materials and to ensure their availability as per project requirements.

37.4 All costs on account of insurance liabilities covered under the Contract will be on Contractor's account and will be included in Contract Price, However, the Owner may from time to time, during the pendency of the Contract, ask the Contractor in writing to limit the insurance coverage, risks and in such a case, the parties to the Contract will agree for a mutual settlement, for reduction in Contract price to the extent of reduced premium amount. The Contractor, while arranging the insurance shall ensure to obtain all discounts on premium which may be available for higher volume or for reason of financing arrangement of the project.

37.5 The clause entitled 'Insurance' under the section ECC of this Volume-I, covers the additional insurance requirements for the portion of the works to be performed at the Site.

37.6 Special Conditions of Contract details out the various insurance liabilities.

38.0 LIABILITY FOR ACCIDENTS AND DAMAGES

Under the Contract, the Contractor shall be responsible for loss or damage to the plant until the successful completion of commissioning as defined elsewhere in the Bid document.

39.0 DELAYS BY OWNER OR HIS AUTHORISED AGENTS

39.1 In case the Contractor's performance is delayed due to any act of omission on the part of the Owner or his authorized agents, then the Contractor shall be given due extension of time for the completion of the Works, to the extent such omission on the part of the Owner has caused delay in the Contractor's performance of the Contract.

Regarding reasonableness or otherwise of the extension of time, the decision of the Engineer shall be final.

39.2 In addition, the Contractor shall be entitled to claim demonstrable and reasonable compensation if such delays have resulted in any increase in cost. The Owner shall examine the justification for such a request for claim and if satisfied, the extent of compensation shall be mutually agreed depending upon the circumstances at the time of such an occurrence.

40.0 DEMURRAGE, WHARFAGE, ETC.

All demurrage, warfare and other expenses incurred due to delayed clearance of the material or any other reason shall be to the account of the Contractor.



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



41.0 FORCE MAJEURE

41.1 Force majeure is herein defined as any cause which is beyond the control of the Contractor or the Owner as the case may be, which they could not foresee or with a reasonable amount of diligence could not have foreseen and which substantially affects the performance of the Contract, such as:

- a. Natural phenomena, including but not limited to floods, droughts, earthquakes and epidemics;
- b. Acts of any Government, domestic or foreign, including but not limited to war, declared or undeclared, priorities, guarantees, and embargoes.

Provided either party shall within fifteen (15) days from the occurrence of such a cause notify the other in writing of such causes.

41.2 The Contractor or the Owner shall not be liable for delays in performing his obligations resulting from any force majeure cause as referred to and/or defined above:

The date of completion will, subject to hereinafter provided, be extended by a reasonable time even though such cause may occur after Contractor's performance of obligation has been delayed due to other causes.

42.0 SUSPENSION OF WORK

42.1 The Owner reserves the right to suspend and reinstate execution of the whole or any part of the Works without invalidating the provisions of the Contract. Orders for suspension or reinstatement of the Works will be issued by the Engineer to the Contractor in writing. The time for completion of the works will be extended for a period equal to duration of the suspension.

42.2 Any necessary and demonstrable cost incurred by the Contractor as a result of such suspension of the works will be paid by the Owner, provided such costs are substantiated to the satisfaction of the Engineer. The Owner shall not be responsible for any liabilities if suspension or delay is due to some default on the part of the Contractor or his Sub-Contractor.

43.0 CONTRACTOR'S DEFAULT

43.1 If the Contractor shall neglect to execute the works with due diligence and expedition or shall refuse or neglect to comply with any reasonable order given to him, in writing by the Engineer in connection with the works or shall contravene the provisions of the Contract, the Owner may give notice in writing to the Contractor to make good the failure, neglect or contravention complained of. Should the Contractor fail to comply with the notice within thirty (30) days from the date of serving the notice, then and in such case the Owner shall be at liberty to employ other workmen and forthwith execute such part of the works as the Contractor may have neglected to do or if the Owner shall think fit, without prejudice to any other right he may have under the Contract to take the work wholly or in part out of the Contractor's hands and re-contract with any other person or persons to complete the works or any part thereof and in that event the Owner shall have free use of all Contractor's equipment that may have been at the time on the Site in connection with the works without being responsible to the Contractor for fair wear and tear thereof and to the exclusion of any right of the Contractor over the same, If the sum that the contractor is entitled to be paid plus the costs incurred by the Owner in completing the works, exceeds the Contract Price or the entire works if entire works have been



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



completed or the price for part of the work if part of the works have been completed, the Contractor shall be liable for such excess.

If such excess is greater than the sums due to the Contractor, the Contractor shall pay the balance to the Owner and if such excess is less than the sums due to the Contractor, Owner shall pay the balance to the Contractor. For facilitating such payment, Owner shall pay the balance to the contractor. For facilitating such payment, Owner shall encash the Bank Guarantees of Contractor available with Owner/s and retain such other payment due to the Contractor under the Contract in question or any other Contract that the Owner/s may have with the Contractor. Such payment of excess amount shall be independent of the liquidated damages for delay which the Contractor shall have to pay if the completion of works is delayed.

- 43.2 In addition, such action by the Owner as aforesaid shall not relieve the Contractor of his liability to pay liquidated damages for delay in completion of Works as defined in Clause 14.0 of this Section.
- 43.3 Such action by the Owner as aforesaid the termination of the Contract under this clause shall not entitle the Contractor to reduce the value of the Contract Performance Guarantee nor the time thereof. The Contract Performance Guarantee shall be valid for the full value and for the full period of the Contract including guarantee period.

44.0 TERMINATION OF CONTRACT ON OWNER'S INITIATIVE

- 44.1 The Owner reserves the right to terminate the Contract either in part or in full due to reasons other than those mentioned under clause entitled 'Contractor's Default'. The Owner shall in such an event give fifteen (15) days notice in writing to the Contractor of his decision to do so.
- 44.2 The Contractor upon receipt of such notice shall discontinue the work on the date and to the extent specified in the notice, make all reasonable efforts to obtain cancellation of all orders and Contracts to the extent they are related to the work terminated and terms satisfactory to the Owner, stop all further sub-contracting or purchasing activity related to the work terminated, and assist Owner in maintenance, protection, and disposition of the works acquired under the Contract by the Owner.

In the event of such a termination the Contractor shall be paid compensation, equitable and reasonable, dictated by the circumstances prevalent at the time of termination.

- 44.3 If the Contractor is an individual or a proprietary concern and the individual or the proprietor dies and if the Contractor is a partnership concern and one of the partners dies then unless the Owner is satisfied that the legal representatives of the individual Contractor or of the proprietor of the propriety concern and in the case of partnership, the surviving partners, are capable of carrying out and completing the Contract the Owner shall be entitled to cancel the Contract as to its incomplete part without being in any way liable to payment of any compensation to the estate of deceased Contractor and/or to the surviving partners of the Contractor's firm on account of the cancellation of the Contract. The decision of the Owner that the legal representatives of the deceased Contractor or surviving partners of the Contractor's firm cannot carry out and complete the Contract shall be final and binding on the parties. In the event of such cancellation the Owner shall not hold the estate of the deceased Contractor and/or the surviving partners of the estate of the deceased Contractor and/or the surviving partners of the Contractor's firm liable to damages for not completing the Contract.

45.0 FRUSTRATION OF CONTRACT

Tender for Stub Strengthening of 220KV Nakhatrana Panandhrao D/C line and 220KV Nakhatrana Nanikhakhar D/C line under Nakhatrana AM Division under Anjar AM Circle (Work approved under R&M 2026-27) Seal and signature of contractor



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebmail.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



45.1 In the event of frustration of the Contract because of supervening impossibility in terms of Section 56 of the Indian Contract Act, parties shall be absolved of their responsibility to perform the balance portion of the Contract, subject to provisions contained in sub-clause 45.3 below.

45.2 In the event of non-availability or suspension of funds for any reasons, whatsoever (except for reason of willful or flagrant breach by the Owner) and/or Contractor then the works under the Contract shall be suspended.

Furthermore, if the Owner is unable to make satisfactory alternative arrangements for financing to the Contractor in accordance with the terms of the Contract within three months of the event, the parties hereto shall be relieved from carrying out further obligations under the Contract treating it as frustration of the Contract.

45.3 In the event referred to in sub-clauses 45.1 & 45.2 above the parties shall mutually discuss to arrive at reasonable settlement on all issues including amounts due to either party for the work already done on quantum merit_ basis which shall be determined by mutual agreement between the parties.

46.0 GRAFTS AND COMMISSIONS ETC.

Any graft, commission, gift or advantage given, promised or offered by or on behalf of the Contractor or his partner(s), agent(s), officer(s), director(s), employee(s) or servant(s) or any one on his or their behalf in relation to the obtaining or to the execution of this or any other Contract with the Owner, shall in addition to any criminal liability which it may incur, subject the Contractor to the cancellation of this and all other Contracts and also to payment of any loss or damage to the Owner resulting from any cancellation. The Owner shall then be entitled to deduct the amount so payable from any monies otherwise due to Contractor under the Contract.

E. RESOLUTION OF DISPUTES

47.0 SETTLEMENT OF DISPUTES

47.1 Any dispute(s) or difference(s) arising out of or in connection with the Contract shall, to the extent possible, be settled amicably between the parties.

47.2 If any dispute or difference of any kind, whatsoever, shall arise between the Owner and the Contractor, arising out of the Contract for the performance of the Works whether during the progress of the Works or after its completion or whether before or after the termination, abandonment or breach of the Contract, it shall, in the first place, be referred to and settled by the Engineer, who, within a period of thirty (30) days after being requested by either party to do so, shall give written notice of his decision to the Owner and the Contractor.

47.3 Save as hereinafter provided, such decision in respect of every matters so referred shall be final and binding upon the parties until the completion of the Works and shall forthwith be given effect to by the Contractor who shall proceed with the Works with all due diligence, whether he or the Owner requires arbitration as hereinafter provided or not.

47.4 If after the Engineer has given written notice of his decision to the parties, no claim to arbitration has been communicated to him by either party within thirty (30) days from the receipt of such notice, the said decision shall become final and binding on the parties.



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



47.5 In the event of the Engineer failing to notify his decision as aforesaid within thirty (30) days after being requested as aforesaid, or in the event of either the Owner or the Contractor being dissatisfied with any such decision, or within thirty (30) days after the expiry of the first mentioned period of thirty days, as the case may be, either party may require that the matters in dispute be referred to arbitration as hereinafter provided.

48.0 Arbitration Clause

FOR WORKS CONTRACTS & COMPOSITE CONTRACTS

(1) Amicable Settlement

Any dispute, difference, controversy or claim between the Parties arising out of or relating to this contract with reference to the construction, interpretation, breach, termination or validity thereof (hereinafter referred as "the Dispute") shall, upon the written request of either Party be referred to the authorized representatives of the Disputing Parties for resolution. The authorized representatives shall promptly meet and attempt to negotiate in good faith a resolution of the Dispute within thirty days of the service of the request.

(2) Arbitration

If the parties fail to amicably resolve the disputes or differences or contrary claims as indicated herewith in sub clause (1) of Clause, arising under or in connection with the present works contracts, whether pertaining to works contracts alone or works and procurement both, the same shall be referred to arbitration under the Gujarat Public Works Contracts Disputes Arbitration Tribunal Act, 1992."

49.0 RECONCILIATION OF ACCOUNTS

The Contractor shall prepare and submit every two months, a statement covering payments claimed and the payments received vis-a-vis the works executed, for reconciliation of accounts with the Owner. The Contractor shall also prepare and submit a detailed account of Owner Issue materials received and utilized by him for reconciliation purpose in a format to be discussed & finalized with the Owner before the award of Contract.

50.0 RELATIONSHIP WITH EMPLOYEE

Every bidder at the time of submission of bid give an declaration as under

If in any bidder company / firm the interest (i.e. shareholding in company and share in partnership firm) of any employee of the tendering company or his/her relative as defined in section 2(77) of company's act 2013 in 10% or more the tendering company will not deal with such company or firm at all

Tenderer therefore must specifically disclose this fact in his technical bid. Non disclosure of such fact would immediately disqualify the tenderer for further dealing with the tendering company.

51.0 CONFLICT OF INTEREST AMONG BIDDERS/AGENTS

As approved by GUVNL B R No. 95 121 20/1951 dt 12.3.2023 to incorporate clause regarding "Conflict of interest" in tender of works.



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



A bidder shall not have conflict of interest with other bidders for particular quoted item. Such conflict of interest can lead to anti-competitive practice to the detriment of procuring entity's interests. The bidder found to have conflict of interest shall be disqualified. Bidder may be considered to have a conflict of interest with one or more parties in bidding process for particular quoted item if, only on base of context covered in earlier instruction will remain unaltered.

Every bidder should at the time of submission of bid give a declaration that bidder shall not have conflict of interest with other bidders for particular quoted item as above.

Date:

Superintending Engineer (TR)

(Signature of Contractor)

GETCO, C.O., **Anjar**

GENERAL CONDITION

A. GENERAL TERMS :-

1. The Gujarat Energy Transmission Corporation Limited does not bind itself to accept the lowest or any tender. The **Superintending Engineer (AM), Anjar** reserves the right to reject any or all tender without signing any reasons whatsoever and decision of the **Superintending Engineer (AM), Anjar** will be final and unchallengeable.
2. In case of any dispute / doubt, the decision of The **Superintending Engineer (AM), Anjar** shall be unchallengeable, final and binding to the Contractor.
3. Tender offer without payment of E.M.D/Tender Fee, required Certificate, Documents, bar chart list of Tools, Tackles, Equipments, blank tender etc. required for execution of job will be out rightly rejected. The tenderer should furnish details of past experience of such job of similar nature completed by him satisfactorily within the time limit in GETCO without this certificate offer shall be rejected out rightly.
4. The competent authority can delete any items in schedule of the tender, if he feels that the rate quoted by contractor act. That item is abnormally high completed to the estimated rates. Specification in any items mentioned in tender are subject to change without any prior notice and binding to the Contractor.

B. GENERAL TERMS FOR CONTRACTOR :-

1. The erection work should be carried out according to the specification and as per Instructions & programmed laid out by the DE / Executive Engineer-in-charge of the work. Contractor has to co-ordinate E.I.C. of planning of outage & work schedule thereof, so as to complete all the planned work in outage. Contractor has to deploy adequate manpower accordingly.
2. The contractor should appoint supervisor with sufficient qualification and experience who could supervise the execution of work throughout. He should always be present on the site as far as possible. Qualification & experience certificate of deputed supervisor to be submitted to GETCO.
3. The erection work should be commenced immediately from the date of receipt of instructions from office and should be completed within thereafter. Prior intimation in writing for starting the job will be given by GETCO for the work.
4. The contractor shall see the line route before quoting the rates.
5. The Contractor has to follow all IE rules, Insurance rules, GETCO rules labours laws, safety rules and regulations at his risk & cost. The GETCO does not take any responsibility in case of accident or injury to the workers. The safety / security of men, materials & equipments shall be sole responsibility of the contractor. Contractor will abide by and fulfill all the terms and conditions and general terms and condition of the contract for works available in the office. All other general terms and conditions as prevailing in the GETCO shall be applicable to this contract. The contractor will be governed by the GETCO's general conditions of works contract. The Booklet will be available in the concerned office in any working days. In the event of placing order, the contractor will have to sign this booklet along with other documents and agreement. All

Tender for Stub Strengthening of 220KV Nakhatrana Panandhrao D/C line and 220KV Nakhatrana Nanikhakar D/C line under Nakhatrana AM Division under Anjar AM Circle (Work approved under R&M 2026-27) Seal and signature of contractor



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebmail.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



- the usual terms and conditions of the GETCO, though the same might have not been mentioned in this specification or contractor booklet will be applicable to this contract, and the decision of the concerned **Executive Engineer (AM)** shall be binding on the contractor.
6. The bidder shall have the experience of erection line should be as mentioned in Technical/Commercial Bid..
 7. The tenderer should quote for complete erection work, testing and commissioning of line as indicated in the Schedule "B" and as per terms and conditions.
 8. It will be bidder sole responsibility for erection of complete line in all respect, accordance with latest rules under Electricity Act and approved by Electrical Inspector.
 9. Above terms and conditions are part and partial of tender and will be observed
 10. The Contractors has to engage required strength of skilled persons for Transportation, Loading & unloading work and proper Supervisor to avoid complication & unnecessary delay to complete work timely. The Contractor will be totally responsible for labour claims arising out of the labour employed for this job.
 11. The detailed drawings of equipments can be seen from concern GETCO office during any working day and the equipments which are to be erected can also be seen physically at **Anjar** store during any working day and time.
 12. Contractor has to ensure safe shifting and erection of all accessories / equipments as per standard norms.
 13. The Contractor has to arrange for minor fabrication (if required) at free cost. The tender includes all minor accessories and items of work which may not have been specifically mentioned in the specification schedule etc. but are essential for completion of work. The contractor will not be eligible for any extra payment in respect of such minor accessories and items of work.
 14. The contractor has to co-ordinate & co-operate fully with Engineer-in-Charge and commissioning Engineer of the supplier for erection of all equipments / structure / accessories, etc., and any other items which are not conveniently included in the specification but requires for completing the job.
 15. The Contractor has to remain in contact in close days with Engineer in charge of work who in turn shall issue detailed instruction for the commencement of the work.
 16. The Contractor will be solely and responsible for any accident / damage either to equipments or any human being during the time of execution of work.
 17. Either you or your authorized person should contact our concern S/Dn as well concerned Div office daily, for the availability of equipments required for this work, failing to which this work order shall be terminated without giving any notice.
 18. The Contractor will have to give indemnity bond to GETCO against any possible claim of compensation for damage to contractor's equipments or staff or any of third party during the execution of work.
 19. The Contractor will have to complete entire job as per directive and instruction of Engineer in charge. If he fails to do so entire work will be carried out at Contractor's risk and cost.
 20. The contractor has the experience of survey work and produces the list of survey instrument and bio-data of Supervisor / Surveyor / Engineer / Technician to be engaged for the job.
 21. If the work is required to be carried out during specified outage then the contractor has to deploy adequate man power, material, tools etc. well advance and has to complete the entire work during this specific outage period only, failing to which GETCO shall be at liberally to deduct the amount of revenue loss due to prolong outage. Contractor has to co-ordinate E.I.C. of planning of outage & work schedule thereof, so as to complete all the planned work in outage.
 22. If required by GETCO you shall have to provide free to & for traveling facility to our field Engineer or Surveyor for the work.
 23. The Contractor shall not refuse to execute the work order at any time and it will be his sole responsibility to execute and complete this work as per the instruction of Engineer - in - charge.
 24. The tender shall invariably furnish a monthly average erection capacity (in km. and rating) along with list of available machinery, tools and tackles etc. for erection of line.
 25. The tenderer shall not submit offer for erection or foundation work.
 26. No subcontractor, Power of Attorney shall be allowed.
 27. Any excess work done beyond specification and drawing shall be at Contractor's risk and cost.



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebmail.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



28. During the stringing work of line if any EHT / 11KV / L.T. line comes on the way the Contractor has to dismantle, restringing, kept on original position etc. work to be carried out. No any charges will be paid extra for this work. Further work to be carried out in co-ordination with concern DISCOM personnel for proper identification of feeder / LT line as well as you have to strictly observed all the safety rules of GETCO.
29. The bidder shall specifically note that GETCO will not pay any extra amount to wards any type of claim except for the description indicated in Schedule "B". The party has to carry out all other / additional required activities / work as directed by Engineer in charge which is not mentioned in Schedule but required to be completed as per the site condition and for this work no extra Payment shall be made by GETCO.
30. In addition to the general of the construction particular attention shall be paid to the final finish and every effort shall be made to have the entire work contented with standard of workmanship by the Contractor.
31. No any idling / gang mobilization charge will be paid by GETCO in any circumstances.
32. No part rate or reduces rate shall be allowed in final bill.
33. **The interpretation of specification doubts etc:** - In case of any doubts about what is mentioned in specification or schedule or elsewhere, the tenderer should get all doubts cleared from the Department in writing and in advance of filling in the tender. In case of difference of opinion about interpretation of specification etc. the decision of **concerned Ex. Engineer (AM)/SE(AM) Anjar** will be final and shall be binding to the contractor to the tenderer.
34. Power supply should be arranged by contractor at his own cost. For that temporary connection to be obtain by contractor from PGVCL for the said work.

C. SIGNING AGREEMENT:- The Contractor will have to sign an agreement as per GETCO's rules in the prescribed form of the GETCO. The cost Rs. 300/- of the Stamp Paper will have to be borne by the Contractor.

D. WORKING DAYS: In case, it is not possible for the contractor to continue, the work either due to heavy rains or other reasonable causes, such facts should be immediate reasons to the notice of the Executive Engineer in writing. If the reasons for stopping the work are genuine, the Engineer may ask the contractor in writing to stop work be cases (for such stoppage) are overcome and the Engineer will ask the Contractor to start the work again in written, the period of such stoppage will not be considered as a part of working month moreover the contractor cannot claim compensation for such work. Contractor will not allow to work after working hours except in special case, if any.

E. TERMS OF PAYMENT:

1. Normally, one R.A. Bills will be paid every month, however, looking to the progress of the work it will be reviewed mutually and 90% of the cost of work done will be paid to the Contractor on his presentation of R.A. Bill giving the material account thereof. Remaining 10% Payment will be made after the entire work is completed satisfactorily in all respect. The Bill should be submitted to concern GETCO's **Executive Engineer (AM)**, with a copy to Concern **SE(AM), Anjar** Final bill will be prepared by **Concern Field Executive Engineer (AM)** within about fortnight from the date of completion of the work by the Contractor.
2. The GETCO will be entitled to deduct directly from the bills to be paid to the contractor any sum or sums payable by you and which sum/sums the GETCO is required to pay as principle employers on account of your default in respect of all liabilities referred to in above clauses.
3. In case of any farmer's objection / ROW, contractor has to mobilize his all efforts to clear the objection in consultation with GETCO authority. No extra Charge will be paid for such effort.
4. The contractor shall co-operative with the GETCO in recording measurement etc. as expeditiously as possible and he shall fulfill all the requirement which are necessary to finalizes the accounts on the basis of its records and pay him such amounts as if found due to him, together with the amount of security deposit if any remaining payable to him after deduction there from the amount due by him to the GETCO. The GETCO shall not entertain further claim from thereafter.
5. THE GETCO shall deduct the Income - Tax & Taxes as per prevailing rules from each and every bill.



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebmail.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



6. All the bills for erection, separately for each line should be presented with the following information on each bill.
 - (i) 90% bills for erection should be serially numbered giving the work done under each item up to period of billing, work done for which the claim is made in the bill and up to date work so far done. Items in erection bill should correspond to items mentioned in schedule of A/T.
 - (ii) Balance payment bills should be prepared at the end of the job for each line section under the jurisdiction of the concerned Deputy Engineer which should give the complete information of work carried out, total payment due, actual payment received up to date and the balance amount claimed, It should also accompany a statement of reconciled material account tower wise and line wise.
7. 10% retention money will be deducted from each R.A. bill.
8. No higher rate or revised rate will be applicable for the work, if work is held-up / closed due to whatever so reasons.
9. R.A. Bill shall be paid if GETCO satisfy with the output of works otherwise only final bill shall be paid.
10. The cost of damages, if any will be recovered from the Contractor's bill. The assessment of which will be done by field Engineer at his sole discretion and his decision shall be binding to the contractor and shall be considered as final and unchallengeable.
11. The contractor shall co-operate with the GETCO in recording measurement etc. as expeditiously as possible and he shall fulfill all the requirements which are necessary to finalize the accounts on the basis of its records and pay him such amount as if found due to him together with the amount of security deposit. If any remaining payable to him after deduction there from the amount due by him to the GETCO.
12. The contractor will not be eligible for any extra payment in respect of minor accessories and items of work.
- F. AVAILABILITY OF MATERIALS AND IDLE LABOUR CHARGE:** Materials are readily available and arrangement made to procure the rest. However, the Contractor should be carrying out the work as and when the materials are received. No idle labour charges will be bourned by the GETCO in case such occasion of idle labour arises, due to want of any materials. However, this idle period will be counted for the period of assessing the time limit for completion of work as mentioned in the work order. Contractor has to collect the material as and when available and should be keeping in his safe custody.
- G. PROGRESS OF WORK & REPORTING :**
 1. Contractor has to submit their working schedule along with tender to complete the line in view of time limit given in tender Bar chart is also to be submitted.
 2. **PROGRESS REPORT:** Fortnightly progress reports in DUPLICATE shall be regularly submitted to the concerned **Executive Engineer (AM)** and the concern Engineer-in-charge with a copy to **SE,(Am) Anjar.** Bar chart duly signed by contractor shall be submitted at the time of commencement of work.
- H. MATERIAL, DELIARY & HANDLING :**
 1. All material / equipment required for this work as per schedule shall be delivered at any store center of GETCO jurisdiction & contractor has to take delivery from these stores at his own cost only.
 2. The contractor shall be responsible for breakages, losses & thefts of material during transit or erection after the materials are issued from stores will, the completed work is taken over by the GETCO.
 3. The contractor will be responsible for loss, distribution or deterioration of the materials, stores or articles supplied to him by the GETCO, even if such a less distribution of deterioration has occurred under any circumstances whatsoever beyond his control as if the materials, stores or articles so supplied were his property.
 4. **STORAGE-CUM-INSURANCE:-** The contractor shall take suitable storage-cum-erection insurance cover at his cost to the extent of 100% cost of s/s or line materials, which are required to complete the s/s or line. Contractor shall have to take Marine cum Erection (MCE) insurance policy against any loss, damage, theft, pilferage, fire etc. for the complete period of storage, erection and commissioning up to the time of taking over of the transmission line or S/S by the Board. The contractor shall deal directly and pursue the claim with the insurance company and shall be responsible in regard to maintenance of all insurance coverage as well as for settlement of claim. The proof of insurance policy taken by the successful contractor shall be furnished to Engineer-In-Charge.



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebmail.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



No material shall be issued to bidder/erection agency in absence of such insurance policy. The risk shall be covered for lifting of material from store to final handling over to GETCO. Further In absence of the above insurance policy, R. A. Bill payment will be with held.

5. **RETURN OF EMPTY CONDUCTOR DRUMS:** The empty wooden drum of earth wire and conductor as well as insulator crates will not be required to be returned back by the contractor to the GETCO stores.
6. **ACCOUNTING OF GETCO MATERIALS:** - The contractor will be fully answerable and responsible for all the material issued to him for the work by the GETCO for any theft, loss of pilferage and shall have to furnish account for the same after completion of the work and before preparation of final bill, If the loss referred to above is not made good before final bill as per rules of the GETCO. Contractor has to maintain Site Register Material Account Register regularly.
7. The structure & equipment required for line erection work shall be delivered at central store by GETCO at free of cost and it must be shifted to site without damaging the equipment must be kept in position as per instruction of In charge Engineer and Manufacturer's manual. The M.S. Girder required for line erection work will be provided at one end of the line by GETCO. The trip of Girder should be of minimum 20 Girders.
8. The Contract has to shift the material at site with packing case and it should open carefully without damaging the equipment. The packing case must be returned to the store in good condition and stacked as directed by Engineer-in-charge.
9. The equipments must be cleaned, washed if required before erection. The initial testing wherever required should be carried out first with the help of Engineer-in-charge before erection, such as measuring continuity test or any other test found necessary.
10. THE GUJARAT ENERGY TRANSMISSION CORPORATION LTD. shall supply Steel Section required, for earth mesh / structure / G.I. / M.S. strip for earthings the equipments structures with nut and bolts, power cable, control cable, L.T. cable, Clamps connectors and C.I. Plate for small pit etc. at free of cost subject to condition mentioned in schedule-B.
11. Wooden charcoal, salt, black cotton soil, G.I. pipe, G.I. strip, G.I. wire, nut & bolts lugs etc. required for earthing shall be procured by the contractor as per specification given is Schedule B.
12. Contractor will fully and solely responsible for any shortage, damage, leakages to the equipments or any it's accessories that may occur during transportation dragging, draining of oil, erection work etc.
13. In case of non - availability of some items / materials you will have to collect the same from other nearby store center for which you shall be paid as per GETCO's rules and S.O.R. rate.
14. After completion of the work, all the surplus materials issued by the GETCO shall be returned by you to the respective center of the GETCO as per instruction of Engineer in charge at your cost.
15. For shortages of any materials issued by the GETCO for the work, recovery shall be made from you, on the basis or prices of the materials (prevailing the date of settlement of materials Account) plus 15% supervision charges.
16. All the materials issued by GETCO shall be transported to the work site on same day and to be preserved in safe custody failing to which GETCO shall initiate Police actions, similarly as per instruction of Engineer-in-charge, you have to credit the material at GETCO store without any loss of time failing to which GETCO shall initiate Police action.
17. **Accounts of Materials issued :-** The contractor shall have to maintain accurate day to day and item wise account of use of issued materials which shall be got checked from time to time by the representative of the GETCO. The contractor will be responsible for custody and preserving the issued materials till the work is handover by the Contractor after completion.
18. The contractor has to maintain site Register, covering all the daily details of Material receipt & utilization, progress of work etc. This register shall be checked and signed by Engineer in charge, concerned **Executive Engineer (AM)** & **SE (AM), Anjar** during the site visit. Any bill without site register shall not be passed. The GETCO shall not entertain further claim from thereafter.

I.

TOOLS :-

1. No tools, tackles, manpower, crane facilities etc. will be provided by the GETCO.



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebmail.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



2. No special tools and tackles such as compression joint machine, jointing dies, come along clamps, dynamo meter etc. shall be given by GETCO.
3. Erection tools required during construction of lines shall be arranged by the contractor at his own cost. Adjustable stub templates will however be supplied by the GETCO which shall be returned by the contractor in Good condition on completion of the works.
4. Contractor will have to make his own arrangement for all tools, tackles, wire ropes etc. for the work.
5. The contractor has to submit the list of tools, tackles, equipments with him along with his tender offer. The tender without this list and other required documents (as mentioned above herein the tender) should be rejected out rightly.
- J. **ELECTRICITY RULES** : All works shall be carried out in accordance with the revised and latest providing under Indian Electricity Act and Rules made the rounder.
- K. **WASTAGE**: You shall make every effort to minimize the breakage/Looses and wastage of line materials, etc. supplied "Free of cost" by the GETCO for erection of line.

The ceiling for wastages permitted is as under :-

- i) Conductor and Earth wire. : For jumpering/sag/sister wire: 0.5%
: For credit length up to 30 Mtr.: 0.5%
: For credit in pieces as good conductor from 30 Mtr. to 100 Mtr: 2%
- ii) Insulators. : 0.25%
- iii) Bolts & Nuts : NIL (No extra Bolts/Nuts will be supplied).
- v) Hardware & Accessories. : NIL.
- L. **INSPECTION BY GETCO REPRESENTATIVES:**
The Engineer-in-charge, higher authority of GETCO or his representatives will be free to visit the contractor's work, their stores site and erection sites and also verify the GETCO's materials in the custody of the contractor as and when required.
- M. **FORCE MAJEURE :-**
 1. Force majored is defined as "Any cause which is beyond control of contractor or the GETCO as the case may be, natural phenomena like floods, draught, - earthquake, epidemics etc. acts of any Government Authorize domestic or foreign including but not limited to war, declare or undeclared, priorities quarantine, embargoes Licensing control or production or distribution restrictions accidents like Fire, Explosions, Break-Downs etc."
 2. All legal complication or disputes are subject to **Anjar** jurisdiction only.
 3. As the case may be, which they could not foresee or with a reasonable amount of diligence could not have foreseen and which substantially affects the performance of the contract such as:
 4. Natural phenomena including but not limited to floods, droughts, earthquakes and epidemics;
 5. Acts of any Government, domestic or foreign including but not limited to war, declared or undeclared, priorities, guarantees and embargoes.
 6. Provided either party shall within fifteen (15) days from the occurrence of such a cause notify the other in writing of such causes.
 7. The contractor or the owner shall not be liable for delays in performing his obligations resulting from any force majeure cause as referred to and/or defined above.
- N. **QUANTITY OF WORK** : The quantities of various items of erection indicated in Schedule-B are tentative, final quantities shall be determined after completion of the details route surveys. The contractor has to carry out the work according to quantities as determined at site for which the rates quoted in the Tender shall be valid. The department reserves the rights for revising or omitting any of the quantities. The quantities actually executed by the contractor will be calculated at the rate given in the contract schedule of the rates. The payment shall be made only on actual work executed or order quantity whichever is less.
- O. **TAKING DELIVERY AND INSURANCE:**
 1. As regard damage the materials, equipment and worker of the contractor, he himself will be responsible. If there is any compensation to be paid in respect of "WORKMAN" compensation act of any other statutory



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebmail.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



provisions, the same will have to be paid by the contractor direct. If he thinks fit he may take necessary insurance cover, at his cost.

2. The contractor has to keep 'H' frame materials & line materials in safe custody and transport to the respective sites and will be fully responsible for any damage to or loss of all materials at any stage during transportation or erection or taking over of the line by GETCO.
 3. The Contractor has to open site store near by the route of the line and ensure for safe custody of all the stored materials at his own cost.
 4. The contractor shall have total responsibility for the entire materials stored, loose, semi assembled and/or erected by him at site in his custody. The contractor shall make suitable security arrangement at his own cost to ensure the protection of all materials, equipment and works from theft, fire pilferage and any other damages and loss. It shall be the responsibility of the contractor to arrange for security till the works are finally taken over by the corporation.
 5. **EQUIPMENT INSURANCE:** -Contractor shall have to take comprehensive insurance policy against any loss, damage, theft, pilferage, fire etc. to the material for the complete period of erection and commissioning up to the time of taking over of the Sub Station / transmission line by the Board. The contractor shall deal directly and pursue the claim with the insurance company and shall be responsible in regard to maintenance of all insurance coverage as well as for settlement of claim. The proof of insurance policy taken by the successful contractor shall be furnished to Engineer-In-Charge. In absence of the above insurance policy, R. A. Bill payment will be with held.
 6. In the event of any damage, theft, loss, pilferage, fire etc. contractor will be responsible to lodge, pursue and settle all the claims with the insurance company for all items, materials and the corporation shall be kept informed about it. Contractor shall replace the lost/damaged materials/items promptly irrespective of the settlement of the claims by underwriter and ensure that the work progress is as per agreed schedule. The loss, if any, such replacement will have to be borne by the contractor and Board will not entertain any claim/representation in this regard. However it will be contractor's responsibility to insure the entire project till the line is taken over by the Board.
- P. DEPARTURE FROM SPECIFICATION AND DRAWINGS:-** Should the tenderer wish to depart from the specification in any respect, they should draw attention to such departure giving his reasons thereof and should get approved the same before doing any further work, unless this is done this specification shall held good. The working drawings are attached with the tenders. However in case of any clarification the decision of Engineer in charge will be final & binding to the Contractor.
- Q. TESTING AND COMMISSIONING :**
1. The contractor after completion of erection work will ensure that all works connected with line have been completed correctly as per Indian Electricity Rule and procedure, any extra cost involved due to incompleteness of work or bad workmanship found out subsequently shall be set right forth with by the contractor at his cost. The clearances at major crossing & earthing resistance value of H-frame / tower footing to be taken & data to be handed over to EIC.
 2. After the erection is completed in all respects, the line should be thoroughly patrolled and checked for continuity and clearances. The line should be meggered to check its insulating level. Afterwards, a line clear should be given to the Engineer-in-charge that the line is clear and free of men and materials and is fit to be charged. If on charging the line is found not to hold, the contractor should arrange to patrol the line and find out the causes for the tripping and rectify the defects.
- R. TECHNICAL PARTICULARS :** The general technical details of the type of towers to be erected conductors and earth wire to be strung and relevant loading particulars for the same are given in section of the specification.
- S. PROTECTION OF WORK**
- The Contractor shall have total responsibility for protecting his works till it is finally taken over by the Engineer. No claim will be entertained by the Owner or by the Engineer for any damage or loss to the Contractor's works and the Contractor shall be responsible for complete restoration of the damaged works to original conditions to comply with the specification and drawings.

V. EMPLOYMENT OF LABOUR



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebmail.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



1. The Contractor will be expected to employ on the work only his regular skilled employees with experience of his particular work. No person below the age of eighteen years shall be employed.
2. All traveling expenses including provisions of necessary transport to and from Site, lodging, allowances and other payments to the Contractor's employees shall be the sole responsibility of the Contractor.
3. In case the Owner becomes liable to pay any wages or dues to Labour or any Government agency under any of the provisions of the Minimum Wages Act, Workmen Compensation Act, Contract Labour Regulation Abolition Act or any other law due to act of omission of the Contractor, the Owner may make such payment and shall recover the same from the Contractor's bills.

W. FACILITIES TO BE PROVIDED BY THE OWNER

1. Space : Land for Contractor's Store, Workshop etc.

a) The Engineer shall at his discretion and for the duration of execution of the Contract make available at site, land for construction of Contractor's field office, workshop, stores, etc. required for execution of the Contract. Any such temporary construction shall be done by the Contractor at his cost. b) On completion of work the Contractor shall hand over the land duly cleaned to the Engineer. Until and unless the Contractor has handed over the vacant possession of land allotted to him for the above purpose, the payment of his final bill shall not be made.

2. Tools, tackles and scaffoldings

The Contractor shall provide all the construction equipments; tools, tackles and scaffoldings required for pre-assembly, erection, testing and commissioning of the equipment covered under the Contract. He shall submit a list of all such materials to the Engineer before the commencement of work at Site. These tools and tackles shall not be removed from the Site without the written permission of the Engineer.

3. First-aid

The Contractor shall provide necessary first-aid facilities for all his employees, representatives and workmen working at the Site. Enough number of Contractor's personals shall be trained in administering first-aid.

4. Cleanliness The Contractor shall be responsible for keeping the entire area allotted to him clean and free from rubbish, debris etc. during the period of Contract. The Contractor shall employ enough number of personnel to keep the work area clean. Materials and stores shall be so arranged to permit easy cleaning of the area. In areas where equipment might drip oil and cause damage to the floor surface, a suitable protective cover of a flame resistant, oil proof sheet shall be provided to protect the floor from such damage.

5. LINES AND GRADES All the works shall be performed to the lines, grades and elevations indicated on the drawings. The Contractor shall be responsible to locate and lay-out the works. Basic horizontal and vertical control points will be established and marked by the Engineer at site at suitable points. These points shall be used as datum for the works under the Contract. The Contractor shall inform the Engineer well in advance of the times and places at which he wishes to do work in the area allotted to him so that suitable datum points may be established and checked by the Engineer to enable the Contractor to proceed with his works. Any work done without being properly located may be removed and/or dismantled by the Engineer at Contractor's expense.

6. FIRE PROTECTION The work procedures that are to be used during the erection shall be those, which minimize fire hazards to the extent practicable. Combustible materials, combustible waste and rubbish shall be collected and removed from the Site at least once each day. Fuels, oils and volatile or inflammable materials shall be stored away from the construction and equipment and materials storage areas.

7. All the Contractor's supervisory personnel and select number of workers shall be trained for fire fighting. Enough of such trained personnel must be available at the Site during the entire period of the Contract.

8. SECURITY

The Contractor shall have total responsibility for all equipment and materials in his custody/stores, loose, semi-assembled and/or erected by him at Site. The Contractor shall make suitable security



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



arrangements ensure the protection of all materials, equipment and works from theft, fire, pilferage and any other damages and loss.

9. PRE-COMMISSIONING TRIALS AND INITIAL OPERATIONS

The pre-commissioning trials and initial operations of the equipment furnished and erected by the Contractor shall be the responsibility of the Contractor as detailed in relevant clauses of Technical Specifications. The Contractor shall provide, in addition, test instruments, calibrating devices, etc and labour required for successful performance of these trials. If it is anticipated that the above test may prolong for a long time, the Contractor's workmen required for the above test shall always be present at Site during such trials.

**SIGNATURE OF CONTRACTOR
WITH SEAL/STAMP**

TECHNICATION SPECIFICATION

SPECIFICATION FOR D/C TOWER / H-FRAME LINE :

1.1 GENERAL TECHNICAL PARTICULARS FOR ERECTION OF 66 KV LINES.

1.1.1 SCOPE :

The erection work covered under these sections consists mainly of

- (i) Taking delivery of tower materials/line materials from the GETCO's store
- (ii) Distribution of all materials to erection site.
- (iii) Stub setting.
- (iv) Tower Erection.
- (v) Stringing.
- (vi) Testing and commissioning and Guarantee of Line.

1.1.2 The contractor shall be fully responsible for completing all the above works and till them are taken over by the GETCO.

1.1.3 The methods of erection are dealt within details, but are left to the contractor who shall exercise his own judgment with regards to actual handling of materials and in deciding upon the best methods to be adopted in the erection of the towers, conductors and other materials.

1.2 WAY LEAVE/TREE CUTTING AND OTHER CONSTRUCTION :

1.2.1 The GETCO will arrange for write off way and for tree cutting clearance, the contractor will instruct his laborers & staff to use minimum area while doing the work where there are standing crops. No person of the contractor should pick in items from standing crops of fruits. The contractor should take all possible steps to avoid or minimize damage to standing crops etc.

1.2.2 The contractor should immediately notify and obstruction or hindrance from local villages or the local authorities in the prosecution of the work to the concerned Engineer-in-charge, but should not deal directly in the matter. The Engineer-in-charge will arrange to remove the obstacles as soon as possible.

1.3 ACCESS TO LOCATIONS :

1.3.1 It will be the contractor's sole responsibility to take the materials up to the locations required. Any path way, temporary road or temporary bridge required will have to be provided by the contractor at his cost. If for any reasons the above is not feasible the contractor at his own cost shall have to arrange transportation by Head roads.

1.4 DISTRIBUTION OF MATERIALS :

1.4.1 The contractor has to take delivery of tower materials/lines materials from the GETCO's store and transport it to the respective tower erection sites and will be responsible for any damages to or loss of



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



all materials at any stage during the Transportation or erection. The materials that will be issued by the GETCO will be in 'AS IS WHERE IS' conditions at the store centre of the GETCO in the area during working hours days. All the materials received by the contractor shall be got insured for storages and erection risk by the contractor at his own cost. An indemnity Bond/Bonds have to be issued by the contractor for the materials take over by him for erection.

1.4.2 On completion of the work all surplus tower and line materials including the excess Bolts & Nuts and stub materials shall be returned by the contractor to the nearest respective stores of the GETCO as per the instructions of the Engineer-in-charge of the works at no extra cost to the GETCO.

1.4.3 The contractor shall submit the complete material account immediately after the works is completed and in case not late than one month of completion and Handing over of the line.

1.5 **STUB SETTING AND FOUNDATIONS :-**

1.5.1 The contractor shall be fully responsible for correct setting of stubs in accordance with approved methods at the exact locations and alignments and in precisely correct level; stub setting templates to the supplied by the GETCO should be used for proper setting of stubs. The contractor will be responsible for constructing the foundations in accordance with the design of each type of foundations supplied to him by the GETCO and as per approved final schedules.

1.5.2 The foundation work includes stone revetment, concrete or earth filling above ground level where necessary and stacking and tamping on the site of all surplus excavated soil. Surplus stone should be stacked within the tower base.

1.5.3 Classification of Soil :

1. Normal soil : Which can be readily removed ordinary spades, shovels viz
Normal Soil, Black cotton soil, Hard & Soft Morrum and Yellow clay.
2. Soft Rock : Literate, line stone or rock which break away chips or slabs.
3. Hard-Rock : Rock which may need chiseling or blasting.
4. wet Soil : Soil encounters in wet location.

1.5.4 **EXCAVATION FOR FOUNDATION :**

1.5.4.1 The tenderer should quote different rates for different types of soil. The contractor will be intimated the alternative that will be operated, the payment for excavation will be limited to guaranteed volume as per approved excavation drawings that will be furnished by the GETCO to the contractor even though the contractor may excavates more the sake or his own convenience. If the excavated depth is more than the depth shown in approved drawings, the additional depth should be filled in with lean concrete (1:4:8) at contractor's cost.

1.5.5 **CONCRETE :**

1.5.5.1 The cement required shall be supplied by the contractor. A list of suppliers is as under.

1. Narmada cements Company Ltd.
2. Gujarat Ambuja Cement Co. Ltd.
3. Saurashtra Cement & Chemicals.
4. Siddhi Cement.
5. J.K.Cement
6. L&T Cement (Uitrated)
7. Shri Digvijay Cement Co.Ltd.
8. Sanghi Cement.
9. Binani Cement.
10. Laxmi Cement.
11. Hi-bond cement

1.5.5.2 All cement is used shall be accountable. If the quantity of cement utilized in the work is observed to be more than the permissible quantities worked out bases on the finally approved foundation drawings and subject to the maximum as per the guaranteed volumes, irrespective of the fact that the cost of cement is recovered from the contractor's Bills.

The cement consumption for difference types of concrete shall be considered as follows:-

1. M-20 Mix (1:1.5:3) 8.2 bags.



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



2. M-15 Mix (1:2:4) 6.5 bags.

- 1.5.5.3 The sand shall be of best quality containing hard siliceous materials, clean and of snap angular grit type and free from earth or organics matter of salts and to the satisfaction of the Engineer-in-charge. The sand shall be washed before use. No. salty or Darkish water shall be used for concreting.
- 1.5.5.4 The aggregate shall be of the best quality to the satisfaction of the Engineer-in-charge and brakes to maximum size of 40mm for thick concrete and 20mm thin concrete section. It should also be free from grit and dirt.
- 1.5.5.5 The mixture of concrete to be used shall be such as to produce a sound : compact and water proof concrete and shall not be weaker than 1:2:4 ratio with 20mm stone metal for chimney portion and 40mm stone metal for mass concreting pyramid portion or slab portion, unit rates may be quoted for concrete of M-15 Mix ratio. The concrete shall be mixed as stiff as the requirements of placing the concrete in the form of moulds with case and degree to which concrete resists segregations will permit. Hence the quantity of water used should not be too much.
- 1.5.5.6 Proper forms or moulds adequately braced to retain proper shape while concreting should be used for chimney or pyramid and slab portions. Form boxes should be water tight so as not to allow cement cream to come out leaving only sand and jelly to form money coml. in concrete. Form excess boxes should be cleaned and oiled before using for concreting.
- 1.5.5.7 All wet locations must be kept completely dewatered both during the placing of concrete and for 24 hours after completion. There should be no disturbance of concrete by water during this period.
- 1.5.5.8 Form boxes should not be removed before 24 hours after concreting. Concrete surface where required should be set right with tick cement and mortar immediately after removal of the forms.
- 1.5.5.9 After 24 hours of pouring, the concrete should be cured by keeping it continuously wet for 14 days. The pit may be back filled with selected earth sprinkled with necessary amount of water and well consolidated layers not exceeding 150mm after 48 hours and thereafter both the exposed top and the fill shall be kept wet for the remainder of the prescribed time.
- 1.5.5.10 Payment for the quantity of excavation and concreting for each type of tower shall be made on prorate basis of actual work done subject to the maximum of guaranteed volumes as per the approved drawings to be furnished by the purchaser.
- 1.5.5.11 The supply of steel for reinforcement, if required is to be supplied by the Contractor

1.5.6 EXCAVATION IN ROCK :

- 1.5.6.1 Where towers are to be planted in rock, suitable holes should be drilled, but if drilling is difficult, blasting may be resorted to, but sufficient care should be taken to eliminate the possibility of serious cracking of the rock.

Care should also be taken to minimize the concreting for filling blasted areas. Stubs may be shortened suitably in case of drilled holes as per design drawings.

1.6 ERECTION OF TOWERS :

- 1.6.1 The superstructure of towers should be erected on foundations after 14 days of concreting. However, the method adopted for erection of towers is left to the decision of the contractor subject to the condition that he takes responsibility for any damages to materials. No. tower member should get strained or bent during erection. The tower must be truly vertical after erection and no straining would be allowed to bring it in alignment. Maximum tolerance in verticality that will be permitted is one mm per 360mm of tower height. All bolts and nuts shall be made fully tight and finally the bolt threads shall be centre punched to avoid nuts becoming loose, punching of bolts shall be made by chamfering the threads with centre punch at least at three places equally spaced on contact surface of bolts and nuts.
- 1.6.2 Tower erection shall include erection of all accessories and fittings including attachment for step bolts, ladders, platform, 'U' Bolts shackles, Hangers, strain plates etc. and punching of bolts and nuts so that towers are completed in all respect.
- 1.6.3 Suitable tower extension shall be erected to get desired ground clearance whenever required. Which have been determined at the time of final survey.

1.7 GROUNDING :



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebmail.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



1.7.1 It is necessary that in no case tower footing resistance should be more than 10 ohms. During dry weather.

1.7.2 PIPE TYPE EARTHING :

1.7.2.1 At location where footing resistance does not exceeds 10 ohms the pipe type earthing as per method shown under drawing No. TR/TL/TCJ/339 would be followed. The contractor will have to supply all materials required for grounding including salt, finely broken coke/charcoal, G.I. Pipe G.I. Wire clamp & Nuts-Bolts etc.

1.7.3 COUNTERPOISE EARTHING :

1.7.3.1 In place of high receptivity soil conditions, counterpoise earthing shall be adopted as shown in under drawing No. TR/TL/TCJ/340 to bring down the tower footing resistance below 10 ohms. The counterpoise earthing shall be buried 600mm below ground level and for this purpose some space should be left out in chimney coping portion at the time of stub setting. Coping should be complete after installation of counterpoise earthing. All materials are to be supplied by the contractor.

1.8 INSULATOR HOISTINGS:

1.8.1 Suspension Insulator strings shall be used on all tangent type towers with deviation up to 2 and tension insulator string on all shall medium, large angle and dead end type towers on all lines.

1.8.2 Insulators string shall be assembled on ground. These shall be cleaned and examined for their cracks ships or defective glazing (not exceeding half centimeter square) and then hoisted by careful handling, the work will include fitting of all hard wares and fitting in their proper places and order.

1.9 STRINGING OF CONDUCTOR AND GROUND WORK :

1.9.1 Before commencing of stringing work, tower healthiness certificate of each & every tower location must be submitted to Engineer in charge in writing.

1.9.2 Before commencing of stringing work, contractor must obtain approval of sag tension charts showing initial and final sags and tensions for various temperature and spans.

1.9.3 The contractor shall be responsible and will take care of proper handling of drums from stores to site, sufficient numbers of aluminum sketch blocks shall be used for laying out the A.C.S.R. Conductors. Necessary precautions shall be taken to avoid conductor rubbing on the ground by providing adequate ground rollers on supports. Additional rollers shall also be provided to cross thorny hedges, forcing and other obstructions to avoid scratching of conductors. The conductor and ground wire shall be made to sag correctly as per stringing charts before they are finally transferred to the hard wares for conductors and to clamps for ground wire, No joints should be made at less than 30 meters from the tower and that no joint shall be permitted in Railway, River & Road crossing spans. There shall not be more than one joint in a span of each conductor. All conductors shall be stressed to their maximum working load at the time of stringing.

The minimum clearance between the lowest point of conductor and ground shall not be less than required those. All compression joints should be carefully made and a record of initial and final length of the joints, jointly signed by contractor's and GETCO's representatives should be maintained. Dynamometer shall be used in tensioning the conductors, check for sag should also be made at intervals when conductors are drawn up. Over stressing, causing damage to towers, should be avoided care should be exercised not to over tension the conductor. An extra sag if 150mm should be allowed at all important tension points like Railway and River crossing.

1.9.4 After being pulled the conductor/ground wire shall not be allowed to hang in the stringing sheaves for more than 72 hours before being pulled to the specified sag. During the time the conductor/ground wire is on the stringing sheaves before sagging in, it shall be ensured that the conductors/ground wire is not damaged to wind, vibration vehicles or other causes.

1.9.5 The conductor shall be pulled up to desired sag, and left in Arial stringing sheaves for at least one hours after which the sag shall be rechecked and adjusted, if necessary, before clipping in an transferring the conductors from the Arial stringing sheaves to the suspension clamps.



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebm.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



- 1.9.6 Conductor shall be clamped within 24 hours of sagging in. The sag will be checked the first and last span of the section in case of sections up to eight spans and in one intermediate open also for section with more than eight spans.
- 1.9.7 The stringing sheaves, when suspended on the transmission structure for sagging, shall be so adjusted that the conductor will be on the sheaves at the same height as the suspension clamp to which it is secured.
- 1.9.8 All the line conductors shall be terminated at sub-station structures whose details shall be furnished by the GETCO, at the appropriate times, The contractor shall fix strain insulators on the sub-station structures.
- 1.9.9 P.A Rods and Vibration Dampers shall be fitted at each suspension towers before final clamping of conductor with insulator string. Vibration damper are to be fixed using aluminum tape with each clamping bolt and in correct vertical position in relation to conductor. Compression type joints are to be used for jointing of conductors. Each part connected with joints shall be perfectly cleaned by wire brush and properly greased before final compression. All the joints of conductors and earth wire shall be made in the best workmanship manner and shall be perfectly straight and having maximum possible strength.
- 1.9.10 Stringing work includes the hoisting insulators, fixing hardware, lifting anchor rods, and vibration dampers, making joints, repair sleeve etc. All stringing tools and hydraulic compressor machine should be arranged by the contractor.

Contractor Signature with stamp

SPECIFICATION FOR "H" FRAME/TOWER STRUCTURES

A. TOWER STRUCTURES :-

1. COMPENSATION AGAINST DAMAGED CROP ETC :-

- 1.1 The GETCO will secure all rights or way leaves for the work. The permission for falling trees which would obstruct the erection of line or for cutting the trees in order to obtain requisite clearance from the ground to conductors shall be obtained by the GETCO. Trees falling within strips of 6.0 mtr. i.e. 3.0 mtr. on either side of the wire shall have to be cut and cleared by the contractors at his own cost. Clearance wherever necessary shall be arranged by the GETCO.
- 1.2 The GETCO will arrange to pay compensation to owners for damage to trees, fences, crops and any other properties required for erection work except the damages caused due to the negligence of the contractor or his staff. The compensation for the damage due to contractor's negligence shall have to be paid by the contractor.

2. GENERAL TECHNICAL PARTICULARS FOR ERECTION OF 66 kV D/C TOWER LINES.

- 2.1 **SCOPE :** The erection work covered under these sections consists mainly of
- Check survey:- GETCO will provide the details of the line alignment as per survey carried out for taking reference to proceed further for the work of check survey.
 - Taking delivery of tower materials/line materials from the GETCO's store centre situated at any store centre under GETCO & storing the same in safe custody.
 - Distribution of all materials to erection site.
 - Stub setting.
 - Tower Erection.
 - Stringing.
 - Testing and commissioning and Guarantee of Line.
- 2.1.1 The contractor shall be fully responsible for completing all the above works and till they are taken over by the GETCO.
- 2.1.2 The methods of erection are dealt within details, but are left to the contractor who shall exercise his own judgment with regards to actual handling of materials and in deciding upon the best methods to be adopted in the erection of the towers, conductors and other materials.

2.2 WAY LEAVE/TREE CUTTING AND OTHER CONSTRUCTION :

Tender for Stub Strengthening of 220KV Nakhatrana Panandhrao D/C line and 220KV Nakhatrana Nanikhakhar D/C line under Nakhatrana AM Division under Anjar AM Circle (Work approved under R&M 2026-27) Seal and signature of contractor



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



2.2.1 The GETCO will arrange for Right off way and for tree cutting clearance, the contractor will instruct his laborers & staff to use minimum area while doing the work where there are standing crops. No person of the contractor should pick in items from standing crops of fruits. The contractor should take all possible steps to avoid or minimize damage to standing crops etc.

2.2.2 The contractor should immediately notify and obstruction or hindrance from local villages or the local authorities in the prosecution of the work to the concerned Engineer-in-charge, but should not deal directly in the matter. The Engineer-in-charge will arrange to remove the obstacles as soon as possible.

2.3 ACCESS TO LOCATIONS :

2.3.1 It will be the Bidders sole responsibility to take the materials up to the location. Any path way, temporary road, temporary bridge required will have to be provided by the Bidder at his own cost. If, for any reasons the above is not feasible, the Bidder at his own cost shall have to arrange transportation by head loads.

2.3.2 The Bidder will be deemed to be very well familiar with the route of the transmission line before submitting an offer. Notwithstanding the difficulties of terrain, location approaches, way leave and other obstructions the price quoted for all the items of erection shall not undergo any change at any stage or granted by the GETCO for any special rates/consideration.

2.3.3. FIXING OF LOCATIONS :-

The poles, guys and earthing position will be located by the department before commencement of erection work. The Contractor will be shown the type of support to be erected at each pole position on joint detailed survey. The route map attached is a proposed and likely to change a little at the time of actual peg marking. The GETCO will arrange surveyor for survey only if not mentioned in schedule-B. Other labours required are to be provided by the contractor.

1. **PRECAUTION FOR ERECTION** :- Structures and guys must not be set along the angle of cuts of embankment where soil is liable to be washed out unless special precaution is taken to ensure the durable foundation. If it is found that any structure set along the edge of cuts and embankment the same will have to re-erect by the contractor. Ground level shall maintain between any two locations as per instruction without any extra cost. Where ever high ground level shall come between any two locations and at the time of stringing, it is felt that the specified clearance as per prevailing rules not be achieved the contractor shall have to cut that much of ground as per the instruction of Engineer-in-charge.

2. **RATES :-** Before tendering rates for the works the contractor must examine the route of the line, the condition of terrain of land and the strata of land. Also rates quoted by him for each item the rate should be reasonable and proportions to tender. In case the tender has quoted very exaggerated of work the tender will be rejected. Also the contractor should read the term and conditions and specifications for this work very carefully and include the cost of materials to be supplied by him in the unit rate of the corresponding item of work.

3. MATERIALS :

3.1 DISTRIBUTION OF MATERIALS :

3.1.1 The contractor has to take delivery of tower materials/lines materials from the GETCO's store Anywhere under GETCO and transport it to the respective tower erection sites and will be responsible for any damages to or loss of all materials at any stage during the Transportation or erection. The materials that will be issued by the GETCO will be in 'AS IS WHERE IS' conditions at the store

3.1.2 centre of the GETCO in the area during working hours days. All the materials received by the contractor shall be got insured for storages and erection risk by the contractor at his own cost. An indemnity Bond/Bonds have to be issued by the contractor for the materials take over by him for erection.

3.1.2 On completion of the work all surplus tower and line materials including the excess Bolts & Nuts and stub materials shall be returned by the contractor to the nearest respective stores of the GETCO as per the instructions of the Engineer-in-charge of the works at no extra cost to the GETCO.

3.1.3 The contractor shall submit the complete material account immediately after the works is completed and in case not late than one month of completion and Handing over of the line.



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



3.2 MATERIALS TO BE SUPPLIED BY THE CONTRACTOR:-

1. All required material require to complete the work and as per Instruction of Engineer Incharge.
2. Cement, Sand, Stone, Crusher, metal, gravels and morrum.
3. G.I. Clamps with bolts, nuts and washers for fixing number plates and Danger board, anti-climbing devices complete.
4. Coke, Salt and G.I. wire and all earthing requirements.
5. Earthing pipe 32 mm dia, 2 mtr. long G.I. pipe of approved make and fabricated as per specification.
6. Any other materials which shall be required to complete the work satisfactorily in all respects and not specified, in clause No. 8 above for supply of materials by the GETCO.
7. Enameled Danger Board and Number plates, G.I. Barbed wire with clamps for anti climbing devices and bolts.
8. G.I. Bolts / Nuts for assembling D.P. Structures and for guy sets.

4. STUB SETTING AND FOUNDATIONS :-

1. The contractor shall be fully responsible for correct setting of stubs in accordance with approved methods at the exact locations and alignments and in precisely correct level; stub setting templates to the supplied by the GETCO should be used for proper setting of stubs. The contractor will be responsible for constructing the foundations in accordance with the design of each type of foundations supplied to him by the GETCO and as per approved final schedules.
2. The foundation work includes stone revetment, concrete or earth filling above ground level where necessary and stacking and tamping on the site of all surplus excavated soil. Surplus stone should be stacked within the tower base
3. The rates for stub setting are inclusive of cutting of stubs (if any), setting of stubs, leveling at correct level, dismantling of template after concrete, back-filling work etc.

5. Classification of Soil.

- a) Normal Dry Soil: The soil readily removable with ordinary spades and shovels viz. Murram, hard murram etc. and to be used for location in normal dry cohesive or non cohesive soils. If the black cotton soil is encountered up to 500 mm below ground level, normal dry soil foundation shall have to be adopted. (The normal dry soil foundation designs shall be inclusive of this stipulation)
- b) Sandy dry soil: To be used for locations where cohesion less pure sand or negligible cohesive sand mixed with soil are met in dry condition
- c) Sandy wet soil: To be used in location where water table is met from top
- d) Fully submerged black cotton Soil: To be used at locations where soil is clay type, not necessarily black in color, which shrinks when dry and swells when wet, resulting in differential movement extending to a max., depth of 3.5 meter below ground level. For designing foundation for this location the soil is to be considered submerged in nature. If the black cotton soil is encountered only up to 500 mm from ground level, normal dry soil foundation shall be adopted. (This foundation design shall be inclusive of this stipulation).
- e) Soft Rock: Soft rock to be used at locations where decomposed or fissured rock, hard gravel, kankar, lime stone, laterite or any other soil of similar nature is met. Undercut type foundation is to be used for soft rock locations.
- f) Hard Rock: To be used at locations where chiseling, drilling, and blasting is required.
- g) Fully submerged soil: To be used at locations where sub soil water table is met at less than 1.50 meter below ground level and up to complete depth of foundation.
- h) Partially submerged soil: To be used at the locations where the submerged soil water table is met at 1.5m or more than 1.5 m below the ground level, the top portion of the strata being normal dry soil. Soil strata for adopting various types of foundations

1. FOUNDATION :

a. EXCAVATION

- i. The excavation will be limited to the volumes as per approved excavation drawings even though the Bidder may excavate more for the sake of his own convenience or for any reasons. If the excavated dimension/s



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebmail.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



- is/are more than the dimension/s shown in the approved drawing, the additional excavated volume should be filled in with M10 mixture concrete at Bidders cost in respect of materials, labours etc.
- ii. In case of rock soil, the extra excavated rock portion on all sides shall be filled with M20 mix concrete at his owncost in respect of materials, laboursetc.
- iii. The rates indicated in scheduleforexcavationworkin each soil shall be applicabieto all the locations as peractualcondition of the soil stratairrespective ofclassification of type of foundation.
- iv. The rates forexavation indicated in schedule shall also beapplicable for benching work, if required.
- b. **EXCAVATION IN ROCK :** Where towers are to be planted in rock, suitable holes should be drilled, but if drilling is difficult, blasting may be resorted to, but sufficient care should be taken to eliminate the possibility of serious cracking of the rock. Care should also be taken to minimize the concreting for filling blasted areas. Stubs may be shortened suitably in case of drilled holes as per design drawings.
- c. **Curing and back-filling :**
- i. After 24 hours of pouring, the concrete should be cured by keeping it continuously wet for 14 days. After 48 hours of pouring, the pit may be backfilled with excavated selected earth (which is free from grass, dung, wooden waste, postures and fodder woods, shrubs, thorn etc.) sprinkled with necessary amount of water and well compressed and consolidated in layers not exceeding 150 mm. If the excavated soil consists of large boulders/stone, the same shall be broken to maximum size 80 mm and mixed with soil to be back filled. At the locations where borrowed earth is required for back filling, this shall be done by the Bidder at his own cost, irrespective of transportation from any land. Thereafter, the exposed top end fill shall be kept wet for the remainder of above prescribed curing period. The uncovered portion of concrete chimney above the back filled earth shall be kept wet by providing empty gunny bags fully wrapped around the concrete chimney for curing and ensure that the bags are kept wet by frequent pouring of water on them.
- ii. Extra ordinary care shall be taken during back filling. The Bidder and GETCO Engineer at site shall ensure that the back filling is done in the manner referred above so that back-filled earth become homogeneous with surrounding parent soil with the passage of time. The record for the same with day/date of curing, back filling etc be maintained in the register and duly signed by the Bidder and GETCO representative. The quantities of excavated earth obtained from a particular location shall be generally utilized in back filling work in protection of tower footing of same location unless it is unsuitable for such purpose. In the later case, the back filling shall be done with borrowed earth of suitable quality irrespective of land and the consolidation of earth shall also be done free of cost.
- iii. The excavation of pits shall be of size 2'x 2'x 7' (600 x 600 x 2100mm) where the condition of soil is normal and size of the pits should be 2'x 2'x 7 1/2' (600 x 600 x 2500mm) where very soft soil is encountered and in this case bottom 6" (150mm) shall be first concreted (Ratio 1:3:6 / M-15) and well settled before the structure is erected only if so directed by Engineer in charge of work. The concrete otta of size 0.4 x 0.4 x 0.3 Mtr. shall be provided and it shall be slopping towards all sides as per instruction of Engineer in charge. If size of pits are increased more then the given specification no extra payments shall be paid to the contractor. Due to this the extra concreting will have to be done at the cost of contractor. The excavation in HR / SR for any items shall be paid extra.

Back filling on the structures shall be done after fixing of earth wire so that wire may not remain out and with mixture of murrum and field metal for back filling the excavated stuff can be used if it is found suitable for doing so and it is not of very soft nature. The consolidated back filling materials, should be well wetted and rammed and packed tight. Any sub sequent sinking of the soil or any fitting of the structure will have to be attended by the contractor free of cost and to the satisfaction of the concern Deputy Engineer / Executive Engineer. When very hard rock is encountered the depth of the excavation shall be 6' (1800mm) or shall be reduced by more with written permission of Executive Engineer, where as resulting in tapering excavation, but in no case the bottom of the pit should be less than 1' x 1' (300 x 300 mm).

- iv. All the structures and metal parts will be given one coat of red oxide paint before erection and two coats of Asian / Burgor / Nerolac make Silver Aluminum after erection including supply of paint. Lowest portion



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebmail.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



of about 7' (2100 mm) shall be painted with two coats of good quality of black bituminous anti-corrosive paint. After complete drying of the red oxide coat, the coat of silver paint will be applied as a final coat before applying any paint, all steel members are to be completely cleaned with wire brush or rust remover, if initial coat of primer is not given to the issued items. The paint should be get approved before supplied for change if any.

- v. Only girders will be issued at one end of the line. The work under the item (erection of structure) includes transportation of structures with all accessories from the specified center to the work site, lifting of the all members, excavation in all sort of soil, erection, painting, numbering, fitting of anti-climbing device, danger boards, muffing etc. The NP, DP, and ACD are to be supplied by the contractor. Rates for concreting of structure shall be paid extra.
- vi. A first coat of primer (Red oxide) is to be applied (after wire brushing the surface) before erection of D.P. structure.
- d. **SHORING, SHUTTERING AND DEWATERING :** The Bidder has to arrange for shoring, shuttering and dewatering work during activities of excavation, stub setting and concreting. These shall be done at his own cost.
- i. **CONCRETE:** The rates indicated in schedule for concrete work shall be applicable to all the locations irrespective of soil strata and type of foundation adopted. The Bidder shall have to procure cement from the open market according to line requirement and keep sufficient quantities to avoid delay in work. Same quantity of cement is to be utilized from his own stock. Account of cement utilized at each location duly certified by concerned GETCO supervisor and engineer in charge of work, is required to be maintained and submitted with each R.A Bill. No wastage is permitted as same is to be procured by the Bidder of brand approved by the GETCO at his own cost from the authorized dealer.
- ii. All Structures are to be fully concreted, and the pit should be dug in a such a way that concrete should have a direct bond to the structure and each cement concrete will be in the ratio of M15. The cement bags shall have to be used for 6.5 bag / cmt. of concrete.
- iii. If needed the contractor shall bind to show to the Executive Engineer or Superintending Engineer, the concrete portion of 1' support of guy for every 50 No such supports of guys after excavation earth all around. The contractor will be intimated in writing three days in advance for such inspection, if required to be done in case of any eventuality will be done free of charge by the contractor.
- iv. The sand should be cleaned, gritty and composed of hard siliceous grains. It should be free from clay and other organic materials. If there is any trace of earthing metal in the sand the same must be washed for this purpose and should be got approved from the Executive Engineer.
- v. Aggregate crusher metal should be of sound, hard and durable stone to pass through a net ½" to ¾". As far as possible all metal should be perfectly cleaned, washed and free of sulfur. All concrete should be mixed on a water tight platform. The work when finished, it must be kept wet continuously for a period of 10 days. Muffing of 0.4mm dia x 0.3mtr. height by M15 cement concrete should be carried out per each leg of 'H' frame structure as per instruction of Engineer in charge by providing form box of 0.4mm dia x 0.3 mtr. height.
- e. **SPECIAL CONDITION FOR USE OF CEMENT IN WORK:-**
 - 1. The rate in Schedule "B" is inclusive of Cement Cost. Contractor has to purchase fresh 43 grade cement confirming to as per IS-8112 and of approved brand by GETCO.
 - 2. Contractor has to construct "Pucca Godown" at site of the work so that Cement bags can be properly preserved to avoid damage due to any kind of Water.
 - 3. The contractor shall have to procure cement by purchasing from the open market according to line requirement and keep sufficient quantities to avoid delay in work. Same quantity of cement is to be utilized from his own stock. Account of cement utilized at each location duly certified by concerned GETCO's supervisor and engineer in charge of work. The account is required to be maintain and submitted with each RA bill. No payment shall be made toward cost of cement bags utilized in each running bills without submission of cement consumption details. No wastage is permitted as same is to



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebmail.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



be procured by the contractor at his own cost from the authorized dealer approved by the GETCO. No wastages towards cement is permitted.

4. Cement should give the required strength of cement concrete.
5. To bring sufficient and timely cement at site is full responsibility of contractor. Nothing extra will be paid on account of any reason to maintain progress of work and to complete the work in Schedule time.
6. Contractor has to submit material A/c for consumption of cement used with every bill. In case of not submitting the same, bill will not be passed. Contractor has to submit the copy of cement purchase Bill along with each RA Bill/ Final Bill.
7. No negative variation will be allowed for consumption in cement then prescribed as per Booklet of Technical Specification of GETCO/Mix Design and nothing will be paid extra for over consumption.
8. Contractor is fully responsible for safety of cement at site, nothing will be paid extra on account of safety.
9. If GETCO's authorized representative wants to check cement stock at site, contractor has to allow for the same at any time.
10. Contractor has to maintain day-to-day cement consumption/balance at site.
11. As far as possible, Contractor has to maintain supply of cement of only one brand & grade throughout the work and on account of closer/shortage of approved brand, cement of other brand in accordance No.(01) will be allowed by Engineer-in-Charge.
12. Minimum cement Consumption considered for cement concrete:-
M15 – 6.5 Bags per CMT
M20 – 8.2 Bags per CMT
(Cement concrete shall be done as per M15 instead of 1:3:6 & M20 instead of 1:2:4)
13. Contractor will be allowed to carry out work only after Physical Verification of cement brought at site.
14. The tor Steel bards required for RCC type foundation shall be procured by the contractor in advance to avoid delay in the work.
15. No wastage is permitted for reinforcement steel and as reinforcement steel is to be procured by the contractor at his own cost. NO over lapping of RCC is permitted in foundation work.
16. GETCO reserves right to test the quality of steel and cement procured by the contractor at any Govt. Recognized Laboratory and intended to be used for the tower foundation works. The test results shall be binding to the contractor closer /shortage of approved brand, cement of other brand in accordance of condition No.(01) will be allowed by Engineer-in-Charge.
17. The Cement and Steel of the fallowing companies/suppliers who are manufacturing for supplying are to be provided by contractor.

Sr. No.	Name of Manufacturer of Cement	Name of Manufacturer/supplier of structural steel/coils/bars/etc.
1	Narmada Cement Company Ltd.	Steel Authority of India.
2	Gujarat Ambuja Cement Co. Ltd.	Tata Iron & Steel Co. Ltd.
3	Saurashtra Cement	Jindal
4	Siddhi Cement	Lloyds
5	J.K. Cement	Essar Steel Ltd.
6	L & T Cement (Ultratech)	Ispat
7	ShriDigvihaya Cement Co. Ltd.	Bhawalka Steel Industries Ltd. Mumbai.
8	Binani Cement	Sun Vijay Rolling and Engineer, Nagpur.
9	Vikram Cement	ShriBajranga Alloys Ltd. Raipur.
10	Sanghi Cement	Unique Structres and Towers Ltd. Raipur.
11	Hi bond Cement	Shah Alloys Ltd. Ahmedabad.
12		Gallant metal
13		Varsanalspat
14		Nilkanth steel



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



f. **PROTECTION OF TOWER FOOTING:** Quantities of various protection works like stone revetment, concrete revetment, brick masonry and random stone masonry to the foundations are to be executed by the successful Bidder if indicated in the schedule and payment for such quantity shall be as per unit rates accepted.

7. ERECTION OF STRUCTURE:-

I The super structure of towers should be erected on foundations after 14 days of concreting. However, the method adopted for erection of towers is left to the decision of the contractor subject to the condition that he takes responsibility for any damages to materials. No. tower member should get strained or bent during erection. The tower must be truly vertical after erection and no straining would be allowed to bring it in alignment. Maximum tolerance in verticality that will be permitted is one mm per 360mm of tower height. All bolts and nuts shall be made fully tight and finally the bolt threads shall be centre punched to avoid nuts becoming loose, punching of bolts shall be made by chamfering the threads with centre punch at least at three places equally spaced on contact surface of bolts and nuts.

i. Complete tower erection shall include erection of all accessories like danger board, number plate, phase plate, C.I. Plate, Anti-climbing devices and fittings including attachments like step bolts, ladders, platforms, 'U' bolts, shackles, hangers, strain plates etc. in all respect.

ii. Suitable tower extension shall be erected to get desired ground clearance whenever required, as determined at the time of survey and profiles.

iii. To avoid pilferage of bolts and nuts and tower members, the bolts of the two bottom most panels (say up to 10 meters) shall be tack welded at three places on the nuts diametrically. The zinc rich paint shall be procured by the Bidder at his own cost and shall be applied immediately following the tack welding.

7.1 ERECTION OF GUY SETS: - Pits of 2' x 2' x 5' (600 x 600 x 1500 mm) are to be dug and the guy anchor rod will have to be concrete completely or partially as per instructions. Rates for concreting shall be paid extra. Items of work includes transportation of materials to site, excavation in all sorts of soils, fixing of guy wire, binding and tensioning of guy wire, painting of guy set and clamps.

7.2 GROUNDING : The Bidder shall measure the tower footing resistance of each tower after it has been erected and before stringing of the earth wire during dry weather. Each tower shall be earthed; the tower footing resistance shall not exceed 10 ohms. Pipe type and counter poise type earthing which ever required shall be done in accordance with the latest edition and revision of IS : 3043 (code of practice for earthing).The Bidder shall measure the footing resistance of each location and prepare the record for submission and approval of Engineer-in-Charge for deciding the type of grounding to be provided.

7.3 EARTHING :- The arrangement shall be of pipe or counter poise type as per specification and drawing. The work of earthing must be carried out as per drawing. Necessary earthing materials like pipe, GI flat 50 X 6 mm , coke, salt etc. will have to be supplied by the contractor. Suitable holes will be provided in the girder and shall be connected to earthing.

7.3.1 PIPE TYPE EARTHING: At locations where footing resistance does not exceed 10 Ohms., the pipe type earthing as per appended drawing shall be provided. The Bidder will have to supply all the materials required for grounding like pipe, flat, bolt- nuts, salt, fine broken coke/charcoal etc. The earthing is to be done by making a bore hole for insertion of pipe away from the tower leg excavation line as per attached drawings.

7.3.2 COUNTERPOISE EARTHING: At locations, where footing resistance exceeds 10 Ohms, counterpoise earthing as per appended drawing shall be provided to bring down the tower footing resistance below 10 Ohms. The Bidder will have to supply all the materials required for grounding like lugs, G.I. wire, bolts, nuts etc. The counterpoise earthing shall be buried 600 mm below ground level and for this purpose some space should be left out in chimney coping portion at the time of stub setting. Coping should be complete after installation of counterpoise earthing. All materials are to be supplied by the contractor.

8.6 CUTTING OF STEEL SECTION AND DRILLING OF HOLES:- In case during execution of work , steel poles or steel sections are required to be put hole to be drilled or rammed according to the requirement in size, the contractor shall be asked to do the work and the extra shall be paid for the same. The rates for each cuts or



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



holes or ramming of holes shall be quoted separately and contractor shall have to take the prior written approval of the Engineer in charge for the job.

2.1 SCOPE:

- 2.2.2 The tender not accompanied by EMD will not be considered and will be ignored and out rightly rejected.
- 2.2.3 If the bidder fails to accept// or fails to fulfill the conditions of tender, the Board will forfeit the amount of EMD.
- 2.2.4 The EMD so paid will be refunded to the Bidder on submission of original receipt of EMD paid together with advance stamp receipt to SE (TR), if the Board does not accept their offer, and the contract is awarded to any other bidder.
- 2.2.5 No interest will be allowed on amount of EMD paid.
- 2.2.6 In case of successful bidder, the EMD paid will be kept as security deposit and will be refunded after completion of contract by the successful bidder in all respect and to the full satisfaction of Engineer in charge and SE TR Anjar.

2.3 DAMAGES TO THE BOARD'S PROPERTY:

- 2.3.1 The successful bidder shall compensate the Board for the damages caused to the Board's property or property / crop of the farmers while dismantling / removing of old line material from the work/erection site.

Instructions for the work of repairing the deteriorated tower stub and chimney on existing tower line:-

1. For tower locations work to be done as per GETCO approved drawing no: **GETCO/TR-IX 116**
2. Excavation and back filling to be done as per: GETCO/TR-IX 116, fig no-2
3. Installation of reinforcement: refer drg. GETCO/TR-IX 116. Fig. No.5
- The placement of the chimney bar and stirrups shall be as per drawing. Welding with proper overlap shall be done if existing chimney with reinforcement.
4. Concreting with M 20 grade (Drawing no GETCO/TR-IX 116, fig no-5)
After chimney concrete is broken and existing deteriorated stub is properly welded with cleat & plates, the broken chimney portion along with the repaired (welded) stub will be encased in RCC muffing. The size of muffing shall be the width of existing chimney + 300mm (square) and maximum up to 1200mm length. However the length of chimney can be changed looking to the stub condition and shall be decided by the concern Engineer In charge.
5. Welding of cleat & plates to the stub (Drawing No. GETCO/TR-IX/116, fig no-3)



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebmail.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



The continuous line welding is to be done on supported cleat & plates supporting the stub with good quality of welding rod supplied by the contractor as per instruction of Engineer In Charge. Payment of welding shall be done made as per RMtr. Bases.

6. Cost of stub cleat & plates.

The bidder is totally responsible for supply of fabricated MS cleat, MS angle, MS plate with cutting, punching, drilling, grinding, notching as per site requirement. The section and thickness of inside cleat and the plate shall be of same as the stub size or one size lower than the stub size. Payment for supply shall be made per MT bases.



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebmail.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



Detail Scope of work:

Stub strengthening and construction of revetments wall on various locations of 220 KV

Nakhatrana - Panandhra & Kukma - Panandhra line is as under.

PART - I : Stub Strengthening :

Procedure / method of execution of the strengthening of stub shall be as per the drawing no. TR IX - 116 attached herewith. Detail scope of work is as under.

When stub is deteriorated more than 50 % :

1. The main tower led shall be unbolted from the joint at stub top.
2. A new piece of stub with identical bolt holes is to be kept ready.
3. The existing deteriorated stub shall be cut from a point 200 mm below the line of deterioration by means of gas cutter.
4. The new piece of stub then shall be cut to the required size, with proper slope angle and shall be fastened to the main leg of tower at top end.
5. Bottom end of the new stub piece shall be bolted and welded on the existing stub.
6. The bolt welded portion shall then be covered by inside cleat and outside plates.
7. The length of the cleat or plate shall be such as to provide 300 mm cover to bolts & welded joints of the stub piece on bottom and top. (length shall be at least $300 + 300 = 600$ mm)
8. Inside cleat shall be heel grinded and and shall be of the size which fit inside the stub leaving at least 10 mm on the flange.
9. Outside plate shall be made face to face with the corner of the stub angle.
10. The cleat and plate shall be welded to the stub for their entire length plus top and bottom portion **with continuous line welding**.
11. The concrete cover to the reinforcement shall be 50 mm all around.
12. The RCC collar will be fitted on the broken chimney with cover of 200 mm below the broken chimney level.
13. While drilling holes in the new stub, the shear edge distance shall be 25 mm minimum.
14. Zinc rich paint of ISI mark should be applied to the welded assembly before concreting.

When stub is deteriorated less than 50 % :

1. The deteriorated stub need not be unbolted from the joint at stub top.
2. The deteriorated portion shall be cleaned with sand paper and cloth and thereafter a coating of zinc rich paint shall be applied over it.
3. After the paint dried, the deteriorated stub shall be covered by inside cleat & outside plates with bolting & welding.
4. The length of the cleat or plate shall be such as to provide 300 mm cover to deterioration of the stub piece on bottom and top. (length shall be at least $300 + 300 = 600$ mm)
5. Inside cleat shall be heel grinded and and shall be of the size which fit inside the stub leaving at least 10 mm on the flange.
6. Outside plate shall be made face to face with the corner of the stub angle.
7. The cleat and plate shall be welded to the stub for their entire length plus top and bottom portion **with continuous line welding**.
8. The concrete cover to the reinforcement shall be 50 mm all around.
9. The RCC collar will be fitted on the broken chimney with cover of 200 mm below the broken chimney level.
10. While drilling holes in the new stub, the shear edge distance shall be 25 mm minimum.

Seal & Signature of Bidder



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110


Email: seanjar.getco@gebm.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



Chief Engineer (Project)

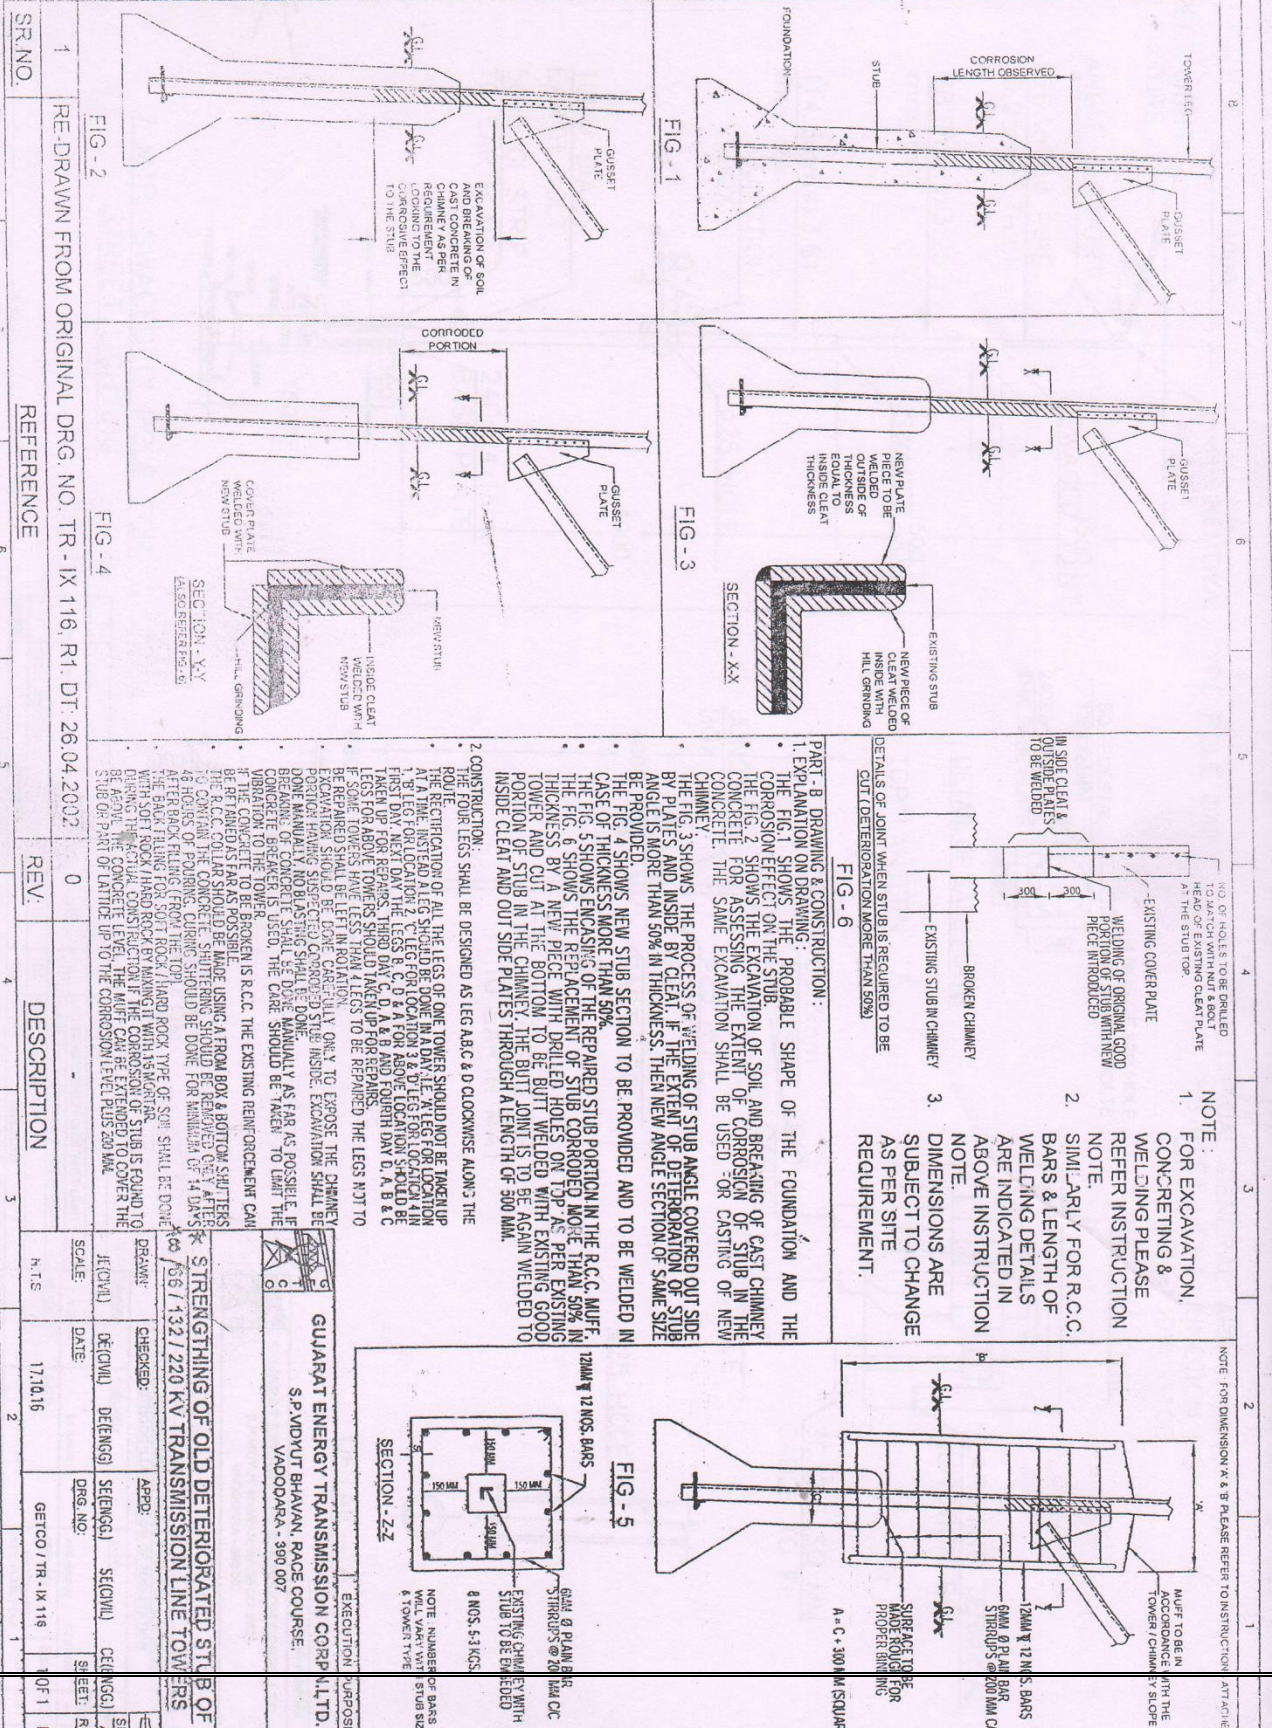

*. Applicable for 400 KV lines also.

**GUJARAT ENERGY TRANSMISSION CORPORATION LTD**

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebmail.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com**APPENDICES**

(To be submitted on Bidder's firm letterhead with authorized signatory & firm's seal)

Annexure-I (on Bidder's letterhead)**Details of the Firm****Name of the Firm****A****1 Address of registered office****2 Contact personnel****3 Designation****4 Residential Address****5 Phone No.****Office****Residential****6 Fax No.****7 Telegraphic code****8 E-mail address****B****1 Address of WORK****2 Contact personnel****3 Designation****4 Residential Address****5 Phone No.****Office****Residential****6 Fax No.****7 Telegraphic code****8 E-mail address**

**GUJARAT ENERGY TRANSMISSION CORPORATION LTD**

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebmail.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com**Annexure-II (On Bidder's letterhead)****Details of experience in last three years from the due date of tender**

Sr. No.	Name of s/s	Order reference no. & Date	Order value	Nos. of sub-stations/feeder bays	Due date of completion	Actual Date of completion	Order fully executed Yes/No	Status if order under execution
A	Gujarat Energy Transmission Corporation Ltd.							
1								
2								
3								
4								
5								
B	Other state electricity board							
1								
2								
3								
4								
5								
C	Private Firms							
1								
2								
3								
4								
5								

Annexure-III (On Bidder's letterhead)**List of work completion certificate submitted with technical bid**

Sr.No.	Name of work	Name of the authority by whom the work completion certificate issued	Reference No. & Date
1			
2			
3			
4			
5			



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



APPENDIX -IV (On Bidder's letterhead)

TENDERER'S EXPERIENCE

A List of Similar jobs executed by the Contractor & Name with address of a Person whom reference can be made, by the Corporation, if required necessary.

[Tenderers shall submit the information in the Format detailed here under]

Sr. No	Description of Work	Value Of Work Executed Rs.	Construction Period as per Contract	Actual Construction Period for the Completion of the work	Date Of Completion	Client	Persons to whom Reference may be made	Principal Features
1	2	3	4	5	6	7	8	9

Contractor's Representative legible signature: _____

Name of the person: _____

Seal of the company

Date & place:

**GUJARAT ENERGY TRANSMISSION CORPORATION LTD**

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebmail.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com**Gujarat Energy Transmission Corporation Ltd.****APPENDIX – V (On Bidder's letterhead)****WORKS TENDERED / IN HAND**

Details of other Works, tendered for & in hand, as on the date of the Submission of this tender
[Tenderer shall submit the information in the Format detailed here under]

Sr. No	Name of work with location and address	Work in hand			Work Tender for			Remarks
		Tender Cost	Cost of Remaining work	Anticipated Date of Completion	Estimated Cost	Date when decision is Expected	Stipulated Date or period of Completion	
1	2	3	4	5	6	7	8	9

Contractor's Representative legible signature: _____

Name of the person: _____

Seal of the company Date & place: _____

**GUJARAT ENERGY TRANSMISSION CORPORATION LTD**

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebmail.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com**Gujarat Energy Transmission Corporation Ltd.****GETCO****APPENDIX-VI (On Bidder's letterhead)****TENDERER'S DETAILS OF PERSONNEL**

The List of Technical Personnel intended to be placed at the Work by the Contractor.

[Tenderers shall submit in the Format detailed here under]

Sr. No.	Description & Details of position	Name	Qualification	Professional Experience & details of works carried out	Remarks
1	2	3	4	5	6

Contractor's Representative legible signature: _____

Name of the person: _____

Seal of the company

Date & place: _____

**GUJARAT ENERGY TRANSMISSION CORPORATION LTD**

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com

**Gujarat Energy Transmission Corporation Ltd.****APPENDIX-VII(On Bidder's letterhead)****TENDERER'S DETAILS OF MACHINERY**

The List of Technical Personnel intended to be placed at the Work by the Contractor.
[Tenderer shall submit in the Format detailed here under

Sr. No.	Description & Details machinery	Capacity	Numbers	Make	Remarks
(a)	(b)	(c)	(d)	(e)	(f)

Contractor's Representative legible signature: _____

Name of the person: _____

Seal of the company

Date & place: _____

**GUJARAT ENERGY TRANSMISSION CORPORATION LTD**

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com

**Gujarat Energy Transmission Corporation Ltd.****APPENDIX-VIII (On Bidder's letterhead)****PERFORMA, SHOWING THE DETAILS OF SITE VISIT DONE BY AGENCY BEFORE QUOTING THE TENDER.**

[Tenderers shall submit in the Format detailed here under]

Sr. No.	Name of firm	Name of Authorized representative of firm who has visited the site.	Qualification	Designation / post holding in company.	Remarks.
(a)	(b)	(c)	(d)	(e)	(f)

Contractor's Representative legible signature: _____

Name of the person: _____

Seal of the company

Date & place: _____

**GUJARAT ENERGY TRANSMISSION CORPORATION LTD**

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebmail.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com**Gujarat Energy Transmission Corporation Ltd.****APPENDIX – IX (On Bidder's letterhead)
Qualification Requirement.****Contractor must fill up below details & should place at the top of the Technical Bid.**

Sr No:	List of Documents	
1	Registration	Class – with valid up to
2	P.F. No.	GJ/
3	Partnership deed/Proprietor (Notarized copy)	
4	Power of Attorney (Notarized copy)	
5	Bl. Sheet / P&L A/C, Statement of last three years.	
6	Latest Solvency certificate.	Rs. Lacs issued by Bank, branch dtd.
7	GST Registration No.	
8	PAN NO	
9	Experience certificate – form 3A of last 5 years (minimum value of similar work done should be equal to or more than 50% of estimated cost	

Signature of Tenderer

Company's Round Seal

Date :

Place



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



Gujarat Energy Transmission Corporation Ltd.

APPENDIX - X (On Bidder's letterhead)

Qualification Requirement. Contractor must fill up below details

1.	PRICES: [FIRM ONLY] (Please Specify YES / NO.)	
2.	PENALTY TERMS AGREED (Please Specify YES / NO.)	
3.	SECURITY TERMS AGREED: (Please Specify YES / NO.)	
4.	TERMS AGREED: (Please Specify YES / NO.)	
5.	VALIDITY Of the offer for 180 DAYS From the date of opening of the Technical Bid: AGREED: (Please Specify YES / NO.)	
6.	PAYMENT TERMS AGREED: (Please Specify YES / NO.)	
7.	MOBILE NOS., TELEPHONE NOS. & FAX NO:	
8.	Authorized person of the firm :	
9.	Name of the proprietor, partners, directors [as the case may be], along with address, telephone, fax no. etc.	

Signature of Tenderer

Company's Round Seal

Date :

Place:



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



APPENDIX – 14(On Bidder's letterhead)

(UNDERTAKING IN REGARD TO STOP DEAL/BANNED FOR USED BUSINESS DEALING /BLACK LIST THEREOF.)

Sub: UNDERTAKING IN REGARD TO STOP DEAL/BANNED FOR USED BUSINESS DEALING /BLACK LIST THEREOF

Ref:-Tender No. Anj/CMC/R&M/e-Tn-118 /2026

Name of Work: Stub Strengthening of 220KV Nakhatrana Panandhroa D/C line and 220KV Nakhatrana Nanikhakhar D/C line under Nakhatrana AM Division under Anjar AM Circle (Work approved under R&M 2026-27)

I/We _____

Authorized signatory of M/s. _____

and thereby certified that M/s. _____

and their proprietor/any partner/any director of the firm is not stop deal and /or banned for business dealing and /or black listed by GUVNL/or their any subsidiary company viz.
GSECL/GETCO/MGVCL/PGVCL/UGVCL/DGVCL.

Signature of tenderer

Seal of firm



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



Tender Acceptance letter (UNDERTAKING IN REGARD ON BIDDER'S LETTER HEAD)

TENDER NO. : **ANJ/CMC/R&M/e-Tn-118 /2026**

Sub: **Stub Strengthening of 220KV Nakhatrana Panandhroa D/C line and 220KV Nakhatrana Nanikhakhar D/C line under Nakhatrana AM Division under Anjar AM Circle (Work approved under R&M 2026-27)**

In connection with above subject, I/we are the authorized signatory for _____

(Name of bidder) and I/We confirm the following:

- 1) I / We, the undersigned, have read, understood and examined all the terms, conditions and parameters on each page/document of above tender documents in detail.
- 2) I/We further undertake that the information given in this tender are true and correct in all respect and I/We hold the responsibility for the same.
- 3) I / we declare that we accept all the conditions of the above tender unconditionally. I / We don't have any objection for any clause, point or condition. If there will be any deviation found, in bid, the offer shall be out rightly rejected without assigning any reason thereof by GETCO and I/We will have no objection for the same.
- 4) I/We undertake that the work shall be carried out as per the specifications given in Notice Inviting tender or as per the Engineer in charge at the time of work execution.
- 5) In any legal implications in future if any, this document can be used as authentic consent from our side.

Seal of the firm

Signature of the tenderer



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



BANK SOLVENCY DETAILS (TO BE SUBMITTED ON BIDDER'S FIRM LETTER PAD)

Date:

TENDER NO. : _____

NAME OF TENDER: _____

In connection with above subject, I/we _____ (Name of bidder) have submitted the bank solvency as per tender terms & conditions. The details in respect to bank solvency are as under:

1. Name of Bank and Branch Code who has issued Bank Solvency Certificate

2. E-mail ID of branch for confirmation of Bank Solvency.

3. Contact Number of the branch who has issued Bank Solvency

4. Date of Bank Solvency

5. Amount of Bank Solvency

6. Validity Period of Bank Solvency.

Seal of the Bidder's firm

Signature of the Bidder



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



CA Certificate

To,
EE / SE
GETCO,
(Location Address)

Sub.: CA Certificate for payment of GST and uploading of the invoice details on GSTN portal

This is to certify that M/s (Name of the Party and Address) have completed the work / supply of (Nature of Work) against (Work Order No. and date). It is further certified that the GST charged on the bills of the said work order are paid to Government and accurate & correct details of such invoices are also uploaded on the GSTN portal within the stipulated time. It is further certified that GST charged from GETCO has neither been refunded nor is refund claim pending with GST Department.

Name of Firm

Name of CA

Designation

M No.

Firm Registration No.



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



UNDERTAKING (ON LETTERHEAD OF COMPANY/FIRM)

To,
EE / SE
GETCO,
(Location Address)

Sub.: (Nature of Work with Order No. of GETCO) -- Submission of Undertaking thereof

I/we hereby undertake that if GST Charged on the invoices of the above stated order is not paid/ short paid to government or if I/we fail to upload the details or uploads inaccurate particulars on GSTN portal within the stipulated time limit, GETCO shall have the right to recover the amount of GST along with penal interest at the rate of 15 % p.a.

I/we, hereby undertake that in the event of any refund of GST either full or part if received by me/us in future in respect of the goods and/or services for the above state order, I/we shall pass on the same to GETCO without any formal claim to that effect from GETCO.

Thanking You,

Name of the Supplier / Contractor
Name, Signature of the Authorised Signatory

Date:

Place:



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



Letter Head of party

(This Performa should be submitted by party
on **letter Pad** along with Tech. Bid for RTGS)
Ignore if already submitted to concern office

To,
The Superintending Engineer(Tr.),
GETCO, Transmission Circle,
Old power house, Station Plot,
Anjar

Sub:- Submission of detail regarding payments of our bills through RTGS/NEFT.

Dear Sir,

Reference to subject cited above, the details of our Bank Account for payment of ours bills through RTGS/NEFT are as under.

Sr. No.	Particulars	
1	Name of Party / Firm	
2	Name of Bank	
3	Account Number	
4	Type of Account	
5	Branch name & Address	
6	Contact No. of Branch	
7	IFSC No.	
8	e-mail ID & cancelled Cheque(Original)	

You are requested to do payment of bills through RTGS / NEFT.

Yours Faithfully,

(Name & Seal of Bidder)



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



Confirmation Regarding Site Verification(On Bidder's letterhead)

Date:

To,
The Superintending Engineer (TR)
Circle Office,

Sub: Confirmation Regarding Site Verification.

Ref: Tender No. Anj/CMC/R&M/e-Tn-118 /2026

Name of Work: **Stub Strengthening of 220KV Nakhatrana Panandhroa D/C line and 220KV Nakhatrana Nanikhakhar D/C line under Nakhatrana AM Division under Anjar AM Circle (Work approved under R&M 2026-27)**

Dear Sir,

In context to above reference tender, I hereby confirmed that I have visited the site/sites as mentioned in tender. And after keeping familiar myself completely about site & situation I am applying in tender and accepting all terms and condition mentioned in tender in to.

Thanking You.

Yours faithfully

Authorized signatory Name & signature

Seal of the Firm

Signature of the Tenderer



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



For Proprietorship firm only

Self-Affidavit for proprietorship firm (On Rs.300/- stamp paper duly notarized)

I the undersigned _____ hereby solemnly declare on oath that I am the sole proprietor of the firm _____. The proprietorship concern is solely owned, managed and controlled by me.

The signature appearing in the contract agreement is signed by me and is true.

I hereby state that whatever is stated herein above is true and correct to the best of my knowledge and belief.

Hence solemnly affirmed on this _____ day of _____ of 2026.

Deponent

Place:

Date



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



(On the letter pad of the company)

Date:

Declaration Of Conflict On Interest

To,

The Superintending Engineer (AM)

Gujarat Energy Transmission Corporation Ltd,

Circle office,

Anjar.

Ref: Tender No _____

Name of Tender _____

With reference to above your tender Notice No.....

For the work of.....

We do not have any conflict of interest with any other bidder who has submitted the bid in this tender.

Yours Faithfully,



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



DECLARATION FOR RELATIONSHIP WITH EMPLOYEE **(ON TENDERER'S FIRM LETTER PAD)**

Date: _____

Ref: Tender No. _____

Name of Work: _____

I/We _____ S/o or D/o of Shri _____ are the authorized signatory of _____ (Name of tenderer's firm) hereby declares that the interest (i.e. shareholding in company and share in partnership firm) of no employee of GUVNL or its subsidiary companies i.e. GETCO, GSECL, PGVCL, DGVCL, UGVCL or MGVL or his / her relative as defined in Section 2(77) of the Company's Act 2013 is 10% or more in our company / partnership firm.

In case at any stage, it is found that the information given by me is false/incorrect, GETCO has the absolute right to take any action as deemed fit without any prior intimation to our company / partnership firm. Non disclosure of such facts would immediately disqualify the tenderer for further dealing with GETCO.

Seal & Signature of the tenderer



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



Annexure - B

ON STAMP PAPER OF Rs. 300 (Duly Notarized)

(TO BE OBTAINED EACH CONTRACTWISE YEARWISE)

Date:

Addl. Chief Engineer (Proc.)/Superintending Engineer/Executive Engineer
Corporate Office/ Circle Office / Division Office

Respected Sir,

I, _____ (Name of the Authorized Signatory) aged about _____
_____ years, _____ in _____ my _____ capacity
as _____ (Designation) _____ of M/S. _____ (Name of the
Seller with address) having PAN _____ (10 Digits) do hereby state that GETCO
has awarded the order of _____ (Description of
Supply Order EPC order) _____ having _____ (Order
No and Date) _____ and we hereby declare that we, M/S _____
have aggregate annual turnover of more than / less than (Strike out whichever is not applicable)
Rs. 50.0 Crores in the current financial year and the provisions of e-invoicing under GST Acts are
applicable/Not-applicable to M/s _____.

We hereby undertake to comply with all the applicable provisions of e-invoicing under GST Acts
and indemnify GETCO for any financial / non-financial loss that GETCO may suffer due to non-
compliance of e-invoicing provisions under GST Acts and rules thereunder including non-
availability of Input Tax Credit (ITC) of GST to GETCO within the prescribed time limit. (Strike Out
if not applicable)

For,

(Name of Authorised Signatory)

Designation:



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebmail.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



SAFETY CUM INDEMNITY BOND

(On Non-judicial Stamp paper of value not less than Rs.300.00)

KNOW ALL MEN BY THESE PRESENTS that we, By this SAFETY CUM INDEMNITY BOND Executed on this _____ Day of 2023. I/We Having Registered Office (here in after called "THE CONTRACTOR" which expression shall mean and includes my/our heirs, executors, administrators and legal representatives, successors and permitted assigns) do hereby binds myself/ ourselves and also our company/firms after having the power to bind by this promise and undertaking in favour of the Gujarat Energy Transmission Corporation Limited (GETCO), Anjar State Transmission Utility under The Electricity Act, 2003 having its registered office at Sardar Patel Vidyut Bhavan, Racecourse, Vadodara. (here in after called as GETCO, which expression shall mean and include its legal representative, administrators as signs) has agreed under the terms and conditions of the contract no. Dated _____ made between and _____ for the contract of the value of Rs _____ inter alia on Production of Safety cum Indemnity Bond.

We do hereby undertake and agree to Indemnify and keep Indemnified GETCO from time to time to the extent of Rs. _____ Rupees only against any losses or damages, costs, charges and expenses caused to or suffered by reason of the CONTRACTOR while Project, R&M, O&M work including work carried out by outsourcing agency, failing to take proper care or not complying the guidelines given hereunder as per Annexure-A and instructions which may be given from time to time during the continuance of the contract and we further undertake to unconditionally pay the amount claimed by the GETCO on demand and without demur to the extent aforesaid.

Whereas the CONTRACTOR has/ have been awarded to execute the job/works under order no., dated _____ for _____ issued by the GETCO after having observing necessary formalities, the details of which is described in the order no. dated _____ and whereas the said job/works will be /likely to be done in places covered under Employees' State Insurance Act, 1948 (ESI) and /or the Workmen Compensation Act, 1923 and /or other laws relating to the Labour Management and Welfare Act. (Respective Amendments)

And whereas according to the condition of the Contract the CONTRACTOR is under obligation to execute this Safety cum Indemnity Bond before the commencement of actual execution of work Now the indenture witnesses that I/We the CONTRACTOR do hereby undertake to follow the guidelines as per Annexure-A prepared by the GETCO.

Further we the CONTRACTOR agree that the GETCO shall be sole judge of and as to whether there has been any breach of the guidelines as per Annexure-A of this bond and as to the extent of the loss, damages, costs, charges and expenses caused to or suffered by the GETCO.

We the CONTRACTOR further agree that our liability under this bond shall not be discharged because of the change in the constitution of the GETCO or for the extension of the time limit or for any other reason.

We the CONTRACTOR further agrees to the given terms and conditions:

- That the CONTRACTOR undertakes /undertake to indemnify and keep harmless the GETCO from all claims, actions, proceedings and risk, damage danger to any person whether belonging or not belonging to the CONTRACTOR.
- That the CONTRACTOR shall keep harmless the GETCO from all claims, compensation, damages any proceedings in respect of any of its employee / workmen under the Workmen Compensation Act or any other laws for the time being in force.
- That, if during the course of execution of work as stated in the contract order mentioned hereinabove issued by the OBLIGEE, it is found that the CONTRACTOR has not complied with guidelines as per Annexure-A or terms and conditions / formalities within the meaning of Employees' State Insurance Act, 1948 (ESI) or Workmen Compensation Act 1923 or any other laws relating to the Labour Welfare for the time being in force, and also has not observed the safety norms in accordance with the law prevailing at the place of work/job to the satisfaction of the



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebm.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



GETCO, the GETCO shall have the right to stop the execution of work/job and the period of such stoppage shall not be taken into account for the calculation of the total period of completion of work for which the CONTRACTOR is responsible to complete the work/job and it will be deemed that discontinuance was due to default of the CONTRACTOR.

- d. That, if any time, due to exigency, GETCO as the Principle Employer, becomes liable to pay any such compensation mentioned hereinabove, whether on failure of the CONTRACTOR or for any other reason, the GETCO shall have the right to recover the said amount from any amount receivable by GETCO or any bank guarantee deposited or anything payable whether in connection with this contract or other contract by the CONTRACTOR to the OBLIGEE.
- e. That the CONTRACTOR is/are aware and accept that for the persistent or repeated violation of any guidelines as per Annexure-A and terms and conditions mentioned in this Safety cum Indemnity Bond, GETCO shall have right to terminate the contract of work issued to the CONTRACTOR.
- f. In case if any safety related fatal Electrical / Mechanical accident occurred to any employee of agency or outsider due to negligence or non-compliance of GETCO safety norms then in addition to the compensation and liability as per statutory requirement, contractor / agency is hereby agreed to pay the penalty amount as given below:

Sr.No	Amount of Contract in Rs.	Penalty amount
1	Up to 1Lac	Rs.5000/- plus APPLICABLE TAXES (IF ANY) as applicable
2	Above 1Lac to 10Lacs	Rs.25000/- plus APPLICABLE TAXES (IF ANY) as applicable
3	10 to 100 Lacs	Rs.100,000/- plus APPLICABLE TAXES (IF ANY) as applicable
4	>100Lacs	1.0% of contract value plus APPLICABLE TAXES (IF ANY) as

- g. I/We the CONTRACTOR here by confirm that in case of any dispute/ difference for settlement of claims under this Safety Cum Indemnity bond the courts in Gujarat State wherever job/ work is performed or as per GETCO norms shall have the jurisdiction to decide the rights & liabilities of the parties while adjudicating the matter of claims under this Safety Cum Indemnity Bond.
- h. This Safety cum Indemnity Bond shall continue and hold good until it is released by the GETCO in Writing on the CONTRACTOR's application after the Contractor has discharged all his obligations under the order mentioned hereinabove and submitted a "NO DEMAND CERTIFICATE" from the GETCO under the said order. The Safety cum Indemnity Bond shall be valid for a CONTRACT PERIOD and renewable thereof (Claim Period).
- i. This Safety cum Indemnity Bond and the guidelines as per Annexure-A herein contained are in addition to And not by way of limitation or substitution for any other guarantee, indemnities Hereto before given to the GETCO by the CONTRACTOR and this indemnity does not Revoke or limit such indemnities or guarantees. IN WITNESS WHEREOF the Parties hereto have executed this indenture the day the year First hereinabove written.

(Signature with seal of The CONTRACTOR)

In the presence of:



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebmail.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



INDEMNITY BOND

(Non Judicial Stamp Paper of Rs. 300/-)

INDEMNITY BONDKNOW ALL MEN BY THESE PRESENTS that we, Messer's _____

(hereinafter called "the Contractor" which expression shall, where the context so admits, include their heirs, executors, administrators and legal representatives, successors and permitted assigns) are hereby held and firmly bind unto the Gujarat Energy Transmission Corporation Ltd (hereinafter called "the GETCO" which expression shall, where the context so admits, include its successors and assigns) to refund the full amount of materials supplied by the GETCO under the terms and conditions of A/T No. _____ dated _____ against any loss damage or deterioration of whatsoever nature occurs to said materials supplied by the GETCO and which are in the custody of the contractor at their works site, on behalf of the GETCO, at _____ (name of S/S / line) _____ and / or if any of the said materials, when inspected by any officer authorized by the GETCO in this behalf, is found to be damaged, lost, deteriorated in quality or quantity, the contractor hereby agrees to bind himself to indemnify and at all times keep indemnified the GETCO against all loss, damage and deterioration to the any material supplied by the GETCO during his custody and shall pay in cash on demand from the GETCO within 30 days the market value of such materials which is lost, damaged or deteriorated in full to the GETCO and shall also hereby authorize the GETCO to deduct the said sum from any sum due to the contractor or any sum which may at any time become due to the contractor under the above referred contract or any other contract entered into by the contractor with the GETCO.

AND WHEREAS the contractors do hereby agree to be responsible for the safe custody and protection and preservation of the said materials against all risks (excluding war risks) and against loss, damage and deterioration of whatsoever nature in respect of the said materials while it remains in the custody and possession of the contractor.

AND WHEREAS the said materials shall at all times be open for inspection by any officer authorized by the GETCO

Now the conditions of the above written bond are such that the contractor shall pay the full amount forthwith to the GETCO in the event of loss, damage or deterioration or whatsoever except due to circumstances arising out of war in respect of the materials supplied by the GETCO and shall fully and effectually indemnify and keep indemnified to the GETCO against such loss, damage and deterioration.

The contractor shall keep the said materials open at all times for inspection by the officers authorized by the GETCO and produce at anytime when demanded.

THE WITNESS WHERE OF: We the

Said M/S _____

(Signature of contractor)

(Seal of Firm)

Here to signed at _____

this day _____

In the presence of

1. _____ Name _____
_____ address _____

(Signature)

2. _____ Name _____
_____ address _____

(Signature)



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebmail.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



PROFORMA FOR CONTRACT AGREEMENT

(Non Judicial Stamp Paper of Rs. 300/-)

This Agreement is made at Anjar the _____ day of _____ in the Christian Year Two thousand four between M/s. _____ (address of office) _____ (hereinafter referred to as "THE CONTRACTOR" which expression shall unless excluded by or repugnant to the contract include its successors or permitted assigns) of the ONE PART and the Gujarat Energy Transmission Corporation Ltd, having their Head office at Vidyut Bhavan, Race Course, Baroda 390 007 (hereinafter called "The GETCO" which expression shall unless excluded by or repugnant to the context include its successors or assigns) of the other part.

WHEREAS the aforesaid GETCO has accepted the tender of the aforesaid contractors for

_____ as per GETCO's Order No. _____ hereinafter called "the works" and more particularly described and enumerated or referred to in the specification, terms and conditions prescribed in the order letter, covering letter and other letters and schedule of price which for the purpose of identification have been signed by Shri _____ on behalf of the contractors and by _____ on behalf of the GETCO, a list whereof is made out in the Schedule hereunder written and all of which said documents are deemed to form part of this contract and included in the expression "The works" wherever herein used, upon the terms and subject to the conditions hereinafter mentioned.

AND WHEREAS THE GETCO has accepted the tender of contractors for the construction of the said works for the sum of Rs. _____ Rupees (_____) upon the terms and subject to the conditions herein mentioned.

NOW THIS AGREEMENT WITNESSESS AND IT IS HEREBY AGREED AND DECLARED THAT.

2. The contractors shall do and perform all works and things in this contract mentioned and described or which are implied therein or there from respectively or are reasonably necessary for the completion of the works as mentioned and at the times, in the manner and subject to the terms and conditions and stipulations contained in this contract, and in consideration of the due provision, executions, supply and completion of the works agreed to by the contractor as aforesaid the Board doth hereby covenant with the contractor to pay all the sums of moneys as and when they become due and payable to the contractors under the provisions of the contract. Such payment to be made at such times and in such manner as is provided by the contract.
3. The conditions and covenants stipulated here-in-before in this contract are subject to and without prejudice to the rights of the Board to enforce penalty for delays and / or any other rights whatsoever including the right to reject and cancel on default or breach by the contractor of the conditions and the covenants as stipulated in the general conditions, specifications, forms or tender schedule etc. attached with GETCO's Order No. _____.
The contract value, extent of supply & erection works, delivery dates, specifications and other relevant matters may be altered by mutual agreement and if so altered shall not be deemed or construed to mean or apply to affect or alter other terms and conditions of the contract and the general conditions and the contract so altered or revised shall be and shall always be deemed to have been subject to and without prejudice to said stipulation.



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



SCHEDULE

List of documents forming part of the contract:

1. GETCO's Tender Specification No. _____ and contractor's offer opened on dated ____/____/____
2. GETCO order No. _____ Dtd. ____ / ____ / ____
3. Contractor's acceptance of order vide letter no. _____.
4. Contractor's Partnership Deed dtd. _____.
5. Contractor's Power of Attorney / Board Resolution authorizing person to sign on behalf of Firm.

In witness whereof the parties here to have set their hands and seals this day and month, year first above written.

- 1) Signed, sealed and delivered by
(Signature with name, Designation and official seal)

For and behalf of M/s. _____

(Signature)

Address: _____

In the presence of (Full Name, Address and Signatures)

i) _____

(Signature)

ii) _____

(Signature)

- 2) Signed, sealed and delivered by

(Signature with name, Designation and official seal)

for and on behalf of Gujarat Energy Transmission Corporation Ltd Circle office. Anjar.

In the presence of name, Full address and Signature:

(1) _____

(2) _____



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



Format for Letter of Acceptance

(To be submitted on firms letter-head. Duly stamped & signed)

Ref. No.

Date :

To,
Superintending Engineer (TR)
Gujarat Energy Transmission Corporation Ltd
Circle Office, Bhuj Road
Anjar – Kutch - 370110

Sub: Latter of acceptance of LOI

Ref: Tender No. _____
AT/LOI No: _____, dated _____
Tender Name: **Stub Strengthening of 220KV Nakhatrana Panandhroa D/C line and 220KV Nakhatrana Nanikhakhar D/C line under Nakhatrana AM Division under Anjar AM Circle (Work approved under R&M 2026-27)**

We hereby agree, admit and acknowledge the receipt of your above referred Acceptance of Tender for the **Stub Strengthening of 220KV Nakhatrana Panandhroa D/C line and 220KV Nakhatrana Nanikhakhar D/C line under Nakhatrana AM Division under Anjar AM Circle (Work approved under R&M 2026-27)** We hereby further agree to all the terms and conditions mentioned in the tender, LOI and A/T unconditionally.

Thanking You,
Yours faithfully,

for _____

(Authorized Signature)
Designation _____
(Official Stamp)



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



(ON STAMP PAPER OF RS. 300/-)

To,
The Superintending Engineer (TR)
Gujarat Energy Transmission Corporation Ltd,
Circle office,
Anjar.

BG. No.
Issue Date:
Expiry Date:
Claim Expiry Date:
Amount:

FORM OF BANKER'S UNDERTAKING

[Combined Performance Guarantee (PBG) towards Execution / Supply Period and Guarantee / Warranty Period as per Commercial terms and condition of Tender]

We, _____ (Name of the Bank and Address of the Branch giving the Bank Guarantee) having our registered office at _____ (Address of Bank's registered office) hereby give this Bank Guarantee Number _____ Dated: _____ and hereby agree Unequivocally and Unconditionally to pay immediately on demand in writing from the Beneficiary Company **Gujarat Energy Transmission Corporation Limited** or any officer authorized by it in this behalf any amount up to not exceeding Rs. _____ (Amount of combined Performance Guarantees towards Execution / Supply Period and Guarantee / Warranty Period) (Rupees _____ (in words)) to the said **Gujarat Energy Transmission Corporation Limited** on behalf of M/s _____ who have entered into a contract for the supply/works specified below:

L.O.I No. _____ Dated: _____

This agreement shall be valid and binding on this Bank up to and inclusive of _____ (Date of validity of the Bank Guarantee) and shall not be terminable by notice or by change in the constitution of the Bank or the firm of Contractors / Suppliers or by any other reasons whatsoever and our liability hereunder shall not be impaired or discharged by any extension of time or variations or alterations made, given conceded or agreed, with or without our knowledge or consent, by or between parties to the said within written contract.

Notwithstanding anything contrary contained in any law for the time being in force or banking practice, this Guarantee shall not be assignable, transferable by the Beneficiary **Gujarat Energy Transmission Corporation Limited**. Notice or invocation by any person such as assignee, transferee or agent of beneficiary shall not be entertained by the Bank. Any invocation of the Guarantee can be made only by the beneficiary directly.

NOTWITHSTANDING anything contained herein before, our liability under this guarantee is restricted to Rs. _____ (Rupees _____ in words)). Our guarantee shall remain in force until _____ (Date of validity of the Bank Guarantee). Unless demands or claims under this Bank Guarantee are made to us in writing on or before _____ (Date of validity of the Bank Guarantee), all rights of the Beneficiary under this Bank Guarantee shall be forfeited and we shall be released and discharged from all liabilities there under:

Place:

Date:

Signature of the Bank's Authorized Signatory

(Bank Name) with Official Round Seal

(Branch Code)

(Complete Postal Address of the Bank)

(Telephone Number)

(Fax Number)



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebmail.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



PARTY TO TAKE NOTE PLEASE BEFORE SUBMITTING THEIR BANK GUARANTEES

1. A/T no. and date to be written on every page, of Bank Guarantee & its Extension.
2. If B/G amount is more than Rs.1 Lac kindly take sign of two bank officer with their respective Employee code no.
3. Valid Confirmation letter of the concerned Bank in an approved format should be attached with every Bank Guarantee & its Extension.
4. Stamp paper should be valid & recent one and date of issuing of stamp paper should not be beyond six months, in any case.
5. Round seal and signature of two Bank officers should be affixed on every B/G paper.

(FORMATE)

BANK GUARANTEE (Extension of Validity)

(To be executed on non-judicial stamp paper of Rs.300/-)

(Name and address of the Bank issuing the Bank Guarantee extension.)

To,
 Superintending Engineer
 Gujarat Energy Transmission Corporation Ltd
 Circle Office, Bhuj Road Expiry Date
 Anjar – Kutch - 370110 Amount

BG. No.
 Issue Date

EXTENSION OF BANK GUARANTEE NO. _____ dtd. _____ of Rs. _____ (Amt, in words _____)

The validity period of our subject Bank Guarantee issued in your favor on behalf of M/s. _____ is hereby extended from date _____ to date _____.

Notwithstanding anything mentioned herein before, our liability under this guarantee is restricted to an amount not exceeding Rs. _____ (Rupees _____ only) and it will remain in force till _____. (Date of validity / Expiry)

We are liable to pay the guarantee amount or any part thereof under this Bank Guarantee only if you serve upon us a written claim or demand on or before dated _____ (Date of expiry of BG +30 Days claim period)

All other terms and conditions mentioned in the original Bank Guarantee will remain unaltered. This extension forms an integral part of the above quoted original Bank Guarantee and may be kept thereto.

Place: _____

Date: _____

Round seal & signature of Two Bank Officers with Sign Code No.



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



Application for refund of EMD

To,
The Superintending Engineer (TR)
Transmission Circle
GETCO, Anjar

Sub: - Application for refund of EMD

Respected Sir,

I request your good self to refund my EMD for the tender mentioned below as soon as the price bids are opened and if I/We am/are not the L1 for the same. The details are as under...

Tender No.	
Tender ID	
Name of Work Sub-etc.	
EMD) Amount	
EMD) DD No., Date & Name of Bank	
Name of Bidder	
Contact No.	
E-mail address	
Bank detail for RTGS into which EMD is required to be refunded	

Thanking you,
Your's faithfully,

(Name & Seal of Bidder)



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebmail.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



CONFIRMATION OF DETAILS OF BIDDER

Bidders are required to furnish following information specifying YES / NO

- | | | |
|----|--|-----------|
| 1) | Whether the Bid is on percentage basis as called for. | Yes / No |
| 2) | Whether rebate furnished is in percentage basis as called for. | Yes / No |
| 3) | Whether the Bid is submitted by RPAD. | Yes / No |
| 4) | Whether all pages of Bid Specifications are sealed and signed by the Bidder. | Yes / No |
| 5) | a) Whether the Bidder is registered with for erection | Yes / No |
| | b) In case of "Yes", please furnish following details: | |
| | i) Registration Letter No. & date. | |
| | ii) Class of Registration | |
| | iii) Validity | |
| | c) Whether Bidder is having PF Code No. | Yes / No |
| 6) | a) Whether EMD paid. (DD / BG) | Yes / No |
| | b) In case "Yes", furnish details | |
| 7) | Whether following documents as specified are submitted. | |
| | a) Human Resources detail. | Yes / No |
| | b) Availability of tools, equipment's etc. | Yes / No |
| | c) Details of orders executed / on hand | Yes / No |
| | d) Financial capability. | Yes / No |
| | e) Experience as specified. | Yes / No |
| | f) Latest Income-tax certificate | Yes / No |
| | g) Company's Articles Of Association | Yes / No |
| | h) Details Of Partners / Directors | Yes / No |
| | i) B.R./P.A. Authorizing Person | Yes / No |
| | j) Power of Attorney of Consortium Members | Yes / No. |

Signature of Authorized Representative of
Company/Agency

NAME: _____

STATUS: _____

Name _____ of _____ tendering
Company

**GUJARAT ENERGY TRANSMISSION CORPORATION LTD**

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebmail.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com

PRICE B I D

SCHEDULE – B

Tender No. Anj/CMC/R&M/e-Tn-118 /2026**Name of Work : Stub Strengthening of 220KV Nakhatrana Panandhroa D/C line and 220KV Nakhatrana Nanikhakhar D/C line under Nakhatrana AM Division under Anjar AM Circle (Work approved under R&M 2026-27)**

SR.NO	Special SOR25-26 for Anjar Circle Item no	Description	Quantity		Total Qty	UOM	Rate	Amount
			220KV NKT PAN LINE	220KV NKT NKKR LINE				
1	PART-A-3	Excavation excluding back filling but including, shoring shuttering, dewatering tree cutting for tower footings etc						
a	PART-A-3(a)	Normal soil either dry or wet/Sandy soil	154.900	224.200	379.100	Cubic meter	384.00	145574.40
b	PART-A-3(b)	Black Cotton Soil either dry or wet	47.700	69.000	116.700	Cubic meter	763.00	89042.10
c	PART-A-3(e)	Soft Rock	23.900	34.500	58.400	Cubic meter	1246.00	72766.40

Tender for Stub Strengthening of 220KV Nakhatrana Panandhroa D/C line and 220KV Nakhatrana Nanikhakhar D/C line under Nakhatrana AM Division under Anjar AM Circle (Work approved under R&M 2026-27) Seal and signature of contractor



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebmail.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel VidyutBhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



d	PART-A-3(f)	Hard Rock Rock	12.000	17.300	29.300	Cubic meter	2583.00	75681.90
2	PART-A-4	Installation of steel reinforcement in concrete foundation including supply of GETCO Approved M.S. bars, binding wire. Work also includes their cutting, bending, shaping and binding with binding wire and fixing in position of TMT bars as per drawing before the concrete work and as per instruction of the EIC	1.500	2.180	3.680	MT	120022.00	441680.96
3	PART-A-6	Concreting of foundation by M20/M15/M25 mixture including shoring, shuttering, compaction, dewatering etc. for normal tower / tower with extension upto 25mtr. After completion of concrete work, curring (watering to concerte) is to be done as per instruction of EIC. (Rates are inclusive of supply of GETCO approved Cement only.) M20 Mixture	55.900	80.900	136.800	Cubic meter	15475.00	2116980.00
4	PART-A-7	Grounding of towers with pipe type earthing including excavation and back filling, with supply of all materials like 32mm dia heavy duty 3 mtr. long G.I. Pipe, 50 x 6 mm G.I. flat, GI bolt-nuts, with GI spring washer, salt, charcoal etc. as per drawing and as per instruction of EIC.	19.000	39.000	58.000	No	11542.00	669436.00

**GUJARAT ENERGY TRANSMISSION CORPORATION LTD**

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110

Email: seanjar.getco@gebmail.com, Phone No: 99252 11151

Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007

(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com

7	Part- I-9	Breaking of cast concrete for tower leg/ H frame RCC chimney up to 1.5 mtr depth and throwing of broken portion of concreting as directed to the lead of 300 mtr Radius and dressing thereof, as per Instruction of EIC	18.300	26.400	44.700	CMT	1506.00	67318.20
8	Part I-10	Providing & Fixing of MS Plate, Ms Angle, MS Channels, MS Bolts /Nuts etc. required for strengthening of stub as per requirement (i.e. Various sections for various type of towers/H frames) including drilling, punching, grinding, transportation at site, This job includes scrapping surface with scrubber and applying 1 coat of red oxide and 2 coats of approved silver paint ISI mark of asian , burger, Delux etc as per directives of EIC.	1.800	2.600	4.400	MT	79837.00	351282.80
9	Part I-11	Welding of MS angle and MS plate with stub section, supply of approved quality of welding rod and arrangement of power supply to be made by the contractor at site as per directives of Engineer In Charge (For stub strengthening)	620.000	897.300	1517.300	RMtr.	479.00	726786.70
Sub Total (Rs.)								4756549.46
GST 18%(Rs.)								856178.90
Total (Rs.)								5612728.36

In Words: Rupees Fifty Six Lacs Twelve Thousand Seven Hundred Twenty Eight and Thirty Six Paise Only

SIGNATURE OF CONTRACTOR
(With rubber stamp/seal of the company)

SUPERINTENDING ENGINEER (AM)
GETCO, CO, Anjar.



GUJARAT ENERGY TRANSMISSION CORPORATION LTD

(Government of Gujarat undertaking)

ASSET MANAGEMENT CIRCLE OFFICE ANJAR

220kV Anjar S/S Compound on Bhuj road, Anjar - Kutch-370110
Email: seanjar.getco@gebmail.com, Phone No: 99252 11151
Reg. Corporate office: Sardar Patel Vidyut Bhavan, Race Course, Vadodara-390007
(CIN): U40100GJ1999SGC036018, Web: www.getcogujarat.com



Note :-

- (1) Welfare Cess shall be reimbursed separately on production of proof of such payment made by the contractor to the appropriate department.
- (2) Final bill shall be passed & paid only if contractor has duly discharged its GST liability related to the contract and submit C.A. certificate and under taking.
- (3) Contractor shall have to take suitable storage-cum-erection insurance cover (comprehensive Marine cum Erection (MCE) insurance policy) at his cost to the extent of 100% cost of s/s or line materials, which are required to complete the line work as per tender conditions above.
- (4) Work should be carried out as per GETCO's standards by implementing FQP/ISO .Other terms & conditions as per tender.
- (5) All safety norms must be implemented .

Notes:-

- (1) The Steel materials such as GI strip for earthing MS plates, MS angle, MS Cleats, MS bar gusset plates, N/B with washer and zinc paint welding electrodes welding Machines Generator water and other all equipments are to be arranged by contractor also any all types of materials transportation with loading and unloading by contractor for which no separate amount will be paid
- (2) Width of chimney should be width of existing chimney (+300) mm or maximum up to 1200mm length for both Tension and suspension location. As per drawing and specification.
- (3) Fabrication and loading unloading of materials at site, arrangement of power supply to be made by the contractor, back filling of hard rock soft rock materials, any type of welding, cutting, drilling or required mechanical strengthening of new stub fixing on tower (all sides) work should be complete as per approved drawing at no extra cost to be claim by contractor.

SIGNATURE OF CONTRACTOR
(With rubber stamp/seal of the company)

SUPERINTENDING ENGINEER (AM)
GETCO, CO, Anjar.