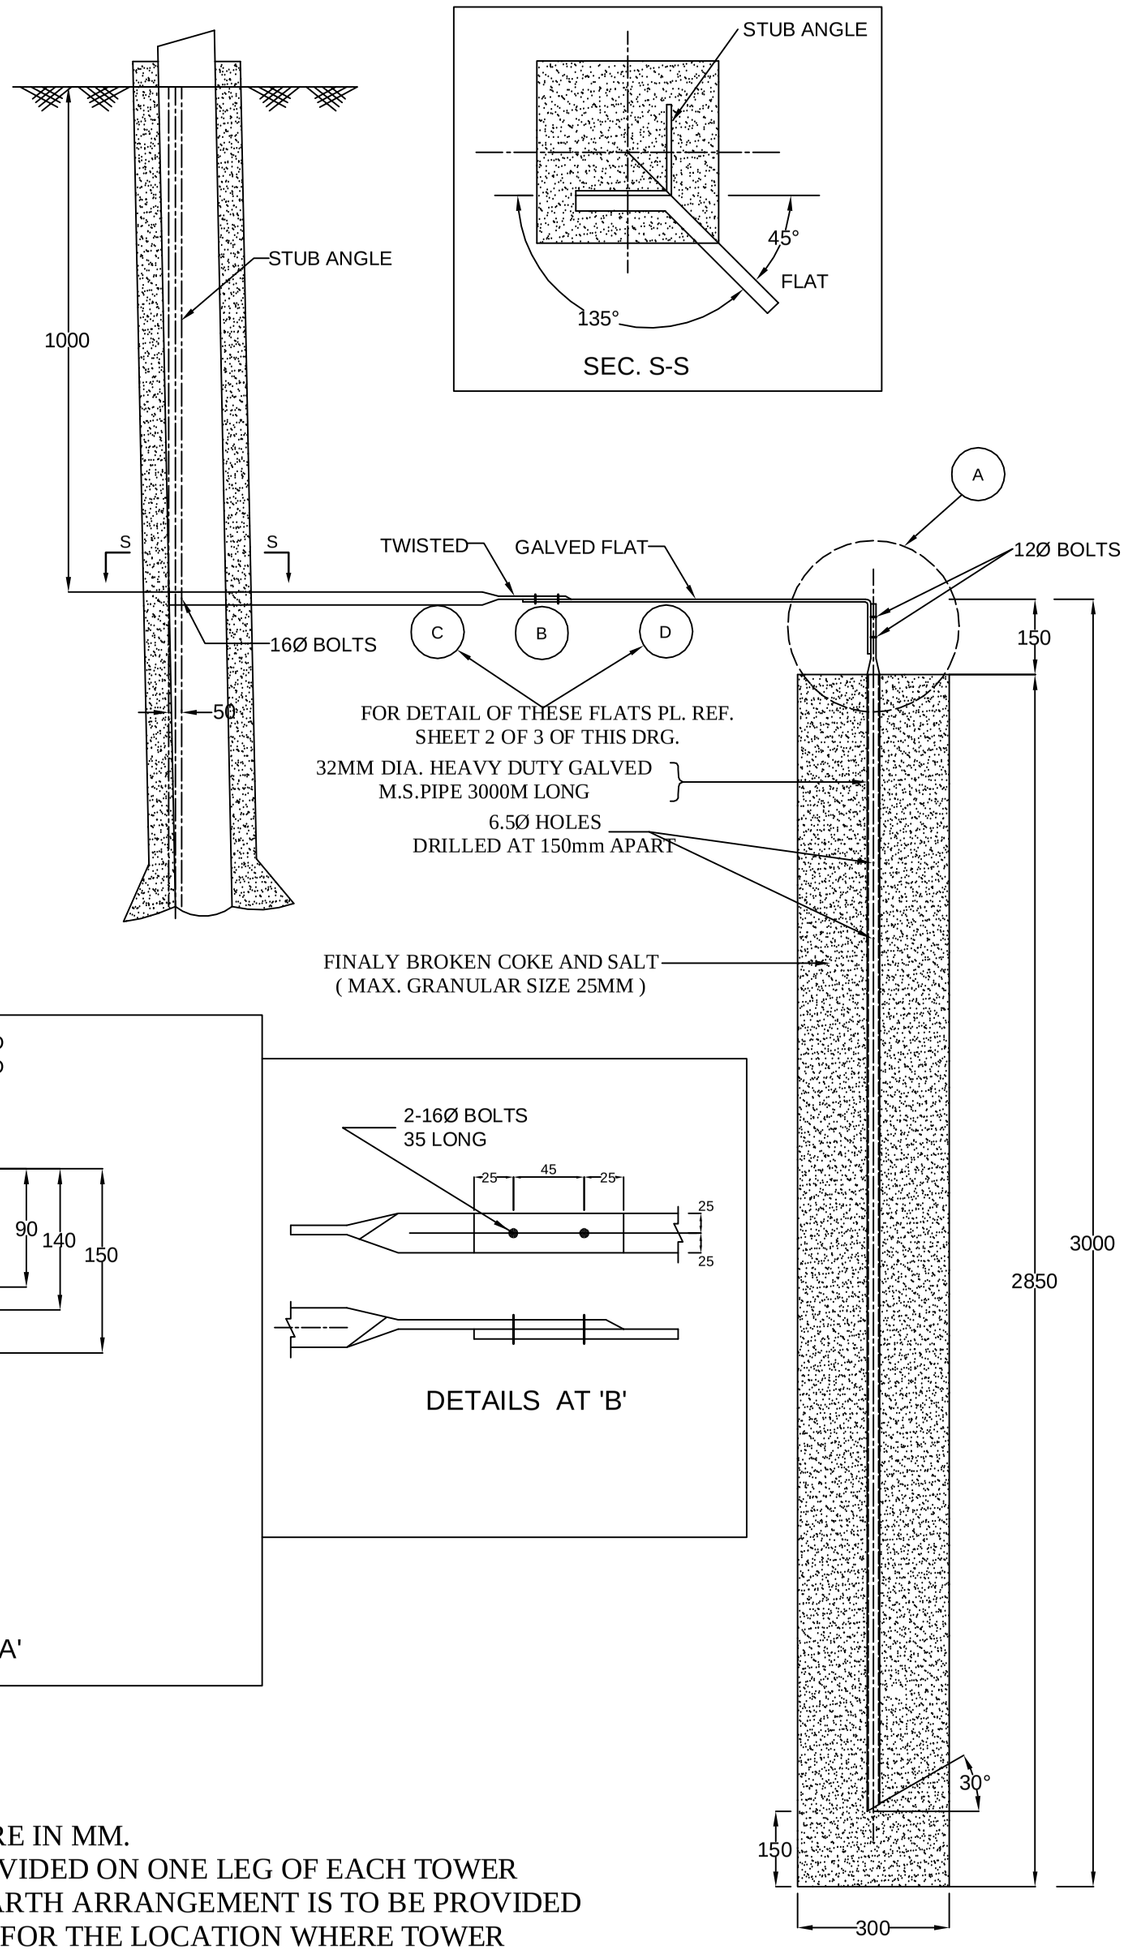

NOTES:-

1. ALL DIMENSION ARE IN MM.
2. STRIP IS TO BE PROVIDED ON ONE LEG OF EACH TOWER
3. STRIP WITH PIPE EARTH ARRANGEMENT IS TO BE PROVIDED ON ONLY ONE LEG FOR THE LOCATION WHERE TOWER FOOTING RESISTANCE IS MORE THAN 10 OHMS
4. 17.5MMØ HOLES SUITABLE FOR 16MMØ BOLTS FOR EARTHING DEVICES
5. FOR COUNTER POISE EARTHING STRIP 'C' SHALL BE CONNECTED WITH COUNTER POISE WIRE THROUGH 'A' LUG

TENDER PURPOSE

GUJARAT ENERGY TRANSMISSION CORPN.LTD.
S.P.VIDYUT BHAVAN, RACE COURSE,
VADODARA - 390 007

Details of Pipe Type Earthing

		DRAWN:	CHECKED:	APPD:		SIZE A4
R-1	32MM Ø HEAVY DUTY GALVED M.S.PIPE	SCALE: N.T.S.	DATE:	DRG. NO: GETCO / E / 4L-STD /EARTHING-041/001	SHEET: 1 OF 3	REV R1
REV:	DESCRIPTION:					