


THE DRAWING BEING PROPERTY OF GETCO,MUST NOT BE COPIED / REPRODUCED IN ANY FORM WITHOUT WRITTEN PERMISSION

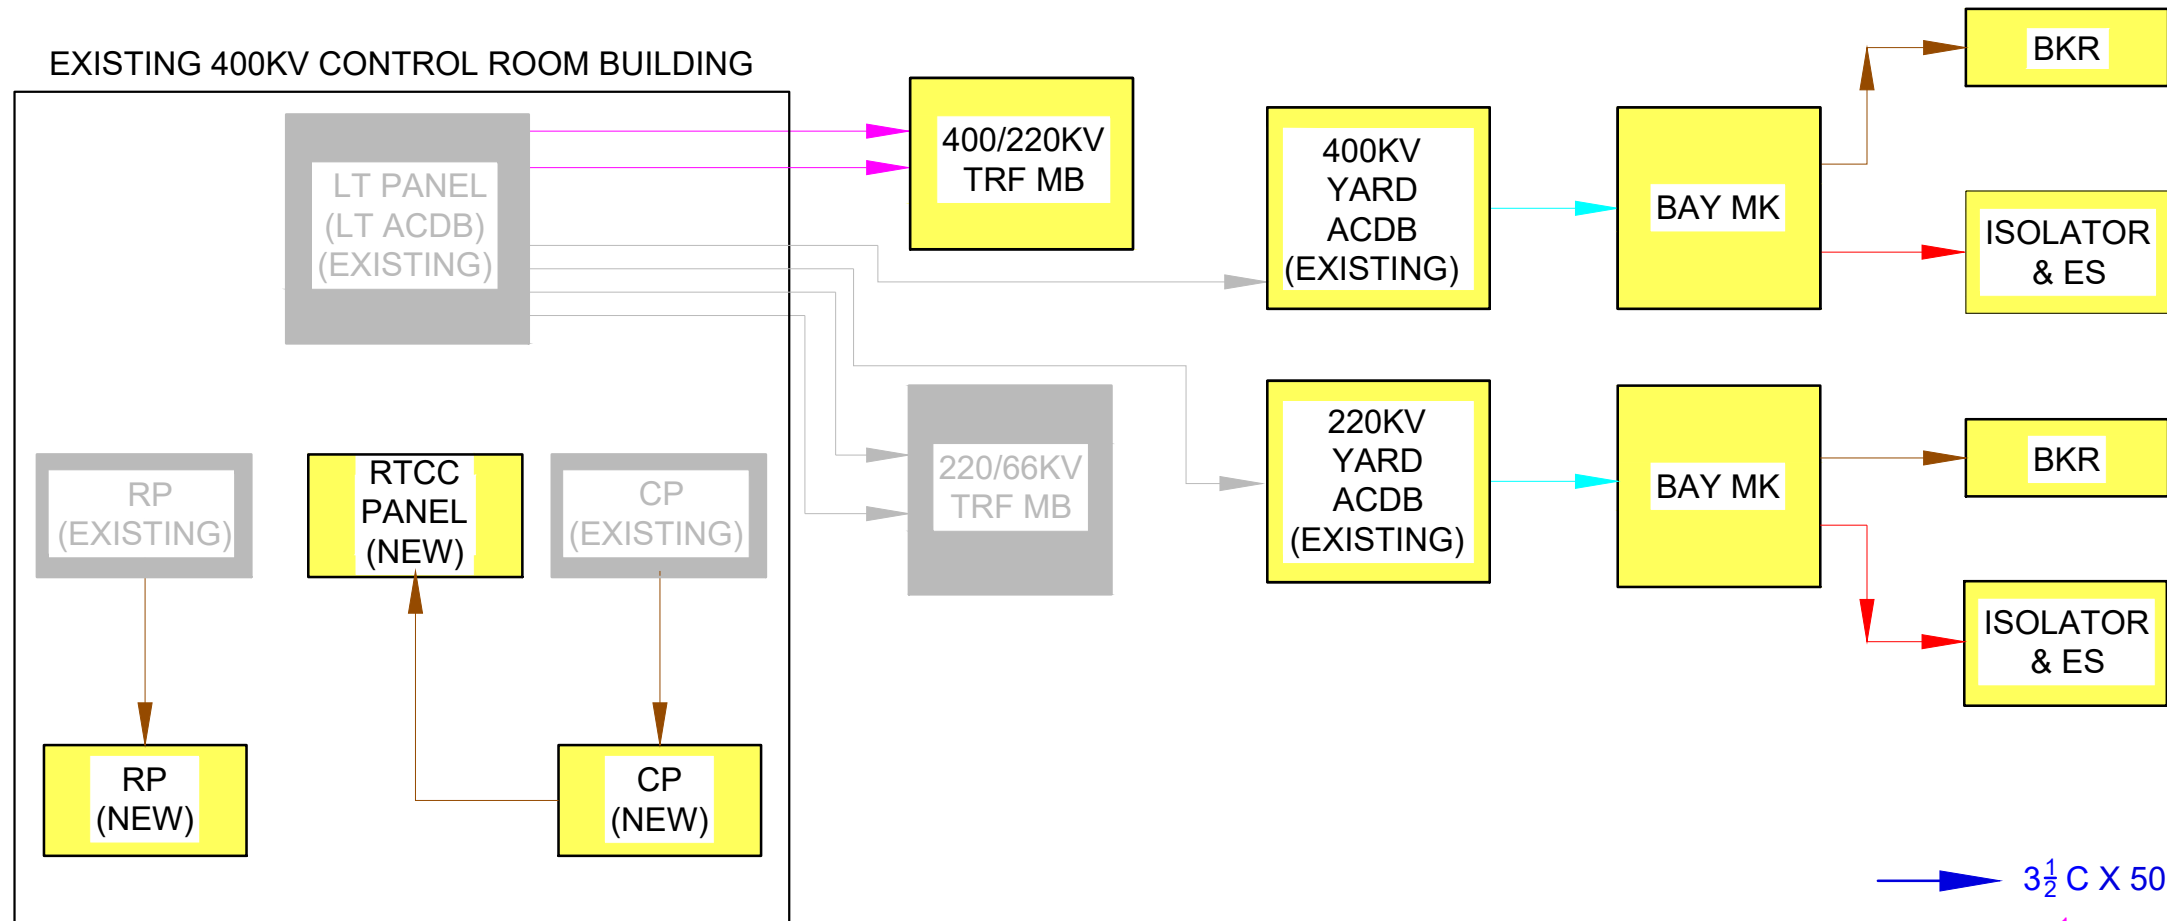

- 3 1/2 C X 50 SQ. MM AL.CABLE
- 3 1/2 C X 25 SQ. MM AL. CABLE
- 4C X 10 SQ. MM AL. CABLE
- 4C X 2.5 SQ. MM CU. CABLE
- 2C X 2.5 SQ. MM CU. CABLE

- Philosophy shown are typical only and for reference purpose.
- Quantity and size of cables shall be derived by bidders based on GIS & LCC scheme requirement.
- All the cables shall be laid through minimum possible route and accordingly the quantity of cables shall be calculated and considered as per actual measurement.

REV:	DESCRIPTION
R0	FIRST PREPARATION

TENDER PURPOSE			
 GUJARAT ENERGY TRANSMISSION CORPN.LTD. S.P.VIDYUT BHAVAN, RACE COURSE, VADODARA - 390 007			
Typical AC Power Cable Block Diagram for 400kV SOJA SUB-STATION			
DRAWN:	CHECKED:	APPD:	 SIZE: A3
DE (ENGG.)	EE (ENGG.)	SE (ENGG.) I/C.ACE (ENGG.)	
SCALE:	DATE:	DRG. NO:	SHEET:
N.T.S	22.07.2026	GETCO / E / 4S- 152 / P-031	1 OF 2
			REV: R0